


**10 TON CONDENSING UNIT 60HZ.  
REFRIGERANT R-410A**

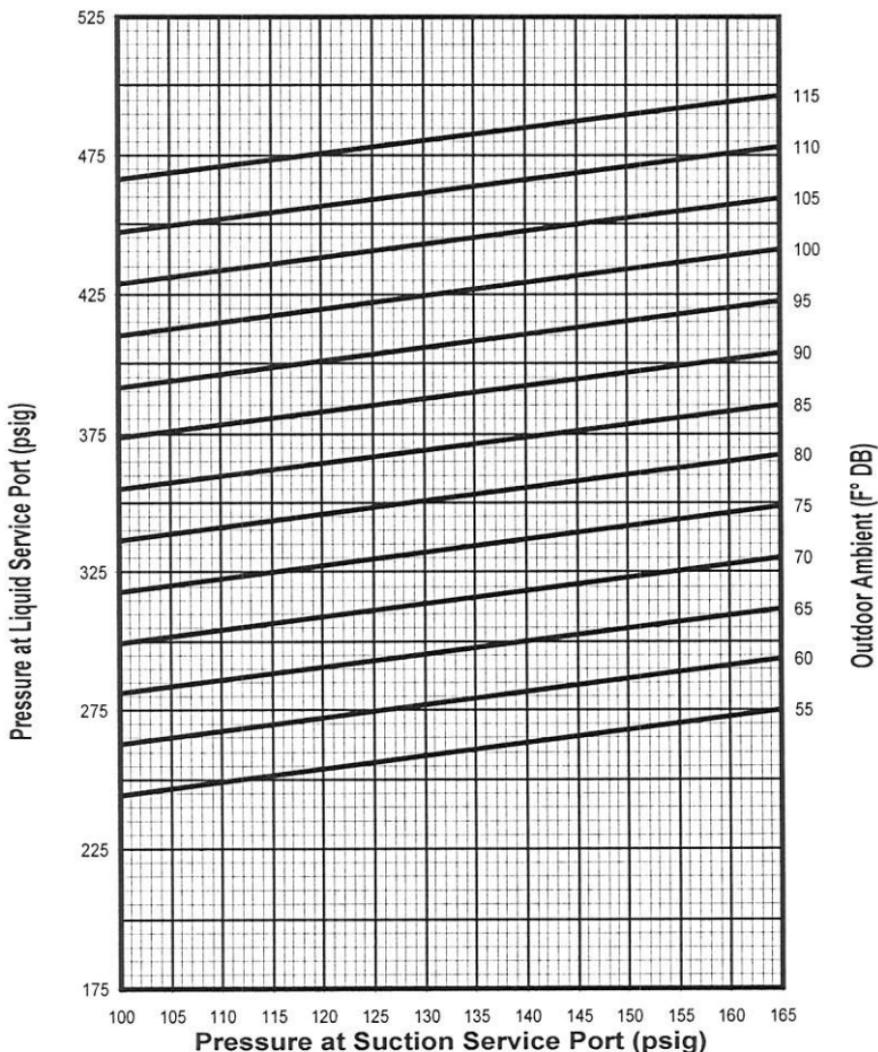

| REQUIRED OUNCES R-410A<br>CHARGE PER FOOT OF TUBING |                |               |
|---|----------------|---------------|
| TUBE SIZE<br>O.D. IN.                               | LIQUID<br>LINE | VAPOR<br>LINE |
| 1/2   | 1.06           |               |
| 5/8   | 1.65           |               |
| 1-1/8   |                | .22           |
| 1-3/8   |                | .34           |

REFRIGERANT REQUIRED: 339 OZ. WITH 0 FT. OF SUCTION AND LIQUID LINE.

**CAUTION:** BEFORE FINAL REFRIGERANT CHECK, INDOOR AIR TEMPERATURE SHOULD BE AT COMFORT CONDITIONS FOR MOST ACCURATE RESULTS.

**INSTRUCTIONS:**

1. CONNECT PRESSURE GUAGES TO SUCTION AND LIQUID PORTS ON UNIT.
2. MEASURE AIR TEMPERATURE TO OUTDOOR COIL.
3. PLACE AN "X" ON THE APPROPRIATE CHART WHERE THE SUCTION AND LIQUID PRESSURES CROSS.
4. IF "X" IS BELOW AMBIENT TEMPERATURE LINE, ADD CHARGE AND REPEAT STEP 3.
5. IF "X" IS ABOVE AMBIENT TEMPERATURE LINE, RECOVER EXCESS CHARGE AND REPEAT STEP 3.
6. IF CONDENSER FANS ARE NOT RUNNING, THE HEAD PRESSURE CONTROL MAY REQUIRE JUMPERING.