



Air

Package Air Conditioner  
RLRL-C/H Series

The new degree of comfort.™

## Rheem *Commercial Prestige Series*™ Package Air Conditioner



### **RLRL-C Series**

With ClearControl™

Nominal Sizes 7.5 & 10 Tons [26.4 & 35.2 kW]  
ASHRAE 90.1-2007 Compliant Models

### **RLRL-H Series**

With ClearControl™ & VFD Technology

Nominal Sizes 7.5 & 10 Tons [26.4 & 35.2 kW]  
ASHRAE 90.1-2010 Compliant Models



INTEGRATED AIR & WATER

FORM NO. S11-961 REV. 1

## TABLE OF CONTENTS

Unit Features & Benefits .....	3-8
Model Number Identification .....	9
Options .....	10
Selection Procedure .....	11
General Data	
RLRL-C/H Series .....	12-15
Gross Systems Performance Data	
RLRL-C/H Series .....	16
Airflow Performance	
RLRL-C/H Series .....	17-20
Electrical Data	
RLRL-C/H Series .....	21-24
Units with Heater Kits .....	25-29
Dimensional Data .....	30-33
Accessories .....	34-56
Mechanical Specifications .....	57-62
Wiring Diagrams .....	63-64
Limited Warranty .....	65




## RLRL-C/H STANDARD FEATURES INCLUDE:

- R-410A HFC refrigerant.
- Complete factory charged, wired and run tested.
- Scroll compressors with internal line break overload and high-pressure protection.
- Two stage operation, two independent circuits.
- Convertible airflow—vertical downflow or horizontal sideflow.
- TXV refrigerant metering system on each circuit.
- High Pressure and Low Pressure/Loss of charge protection standard on all models.
- Solid Core liquid line filter drier on each circuit.
- Single slab, single pass designed evaporator and condenser coils facilitate easy cleaning for maintained high efficiencies.
- Cooling operation up to 125 degree F ambient.
- Foil faced insulation encapsulated throughout entire unit minimizes airborne fibers from the air stream.
- Hinged major access door with heavy-duty gasketing, 1/4 turn latches and door retainers.
- Slide Out Indoor fan assembly for added service convenience.
- Powder Paint Finish meets ASTM B117 steel coated on each side for maximum protection. G90 galvanized.
- One piece top cover and one piece base pan with drawn supply and return opening for superior water management.
- Forkable base rails for easy handling and lifting.
- Single point electrical connections.
- Internally sloped slide out condensate pan conforms to ASHRAE 62 standards.
- High performance belt drive motor with variable pitch pulleys and quick adjust belt system.
- Permanently lubricated evaporator, condenser and gas heat inducer motors.
- Condenser motors are internally protected, totally enclosed with shaft down design.
- 2 inch filter standard with slide out design.
- 24 volt control system with resettable circuit breakers.
- Colored and labeled wiring.
- Copper tube/Aluminum Fin Evaporator coils.
- MicroChannel condenser coil.
- Molded compressor plug.
- Supplemental electric heat provides 100% efficient heating.
- Factory Installed Direct Digital Control (DDC) and sensors which can connect to LonWorks™ or BACnet® BAS systems for remote monitoring and control.
- -H models with supply fan Variable Frequency Drive (VFD) meets ASHRAE 90.1-2010 and California Title 24.



Rheem Package equipment is designed from the ground up with the latest features and benefits required to compete in today's market. The clean design stands alone in the industry and is a testament to the quality, reliability, ease of installation and serviceability that goes into each unit. Outwardly, the large Rheem *Commercial Series*™ label (1) identifies the brand to the customer. The sheet-metal cabinet (2) uses nothing less than 18-gauge material for structural components with an underlying coat of G90. To ensure the leak-proof integrity of these units, the design utilizes a one-piece top with a 1/8" drip lip (3), gasket-protected panels and screws. The Rheem hail guard (optional) (4) is its trademark, and sets the standard for coil protection in the industry. Every Rheem package unit uses the toughest finish in the industry, using electro deposition baked-on enamel tested to withstand a rigorous 1000-hour salt spray test, per ASTM B117.

Anything built to last must start with the right foundation. In this case, the foundation is 14-gauge, commercial-grade, full-perimeter base rails (5), which integrate fork slots and rigging holes to save set-up time on the job site. The base pan is stamped, which forms a 1-1/8" flange around the supply and return cover and has eliminated the worry of water entering the conditioned space (6). The insulation has been placed on the underside of the basepan, removing areas that would allow for potential moisture accumulation, which can facilitate growth of harmful bacteria. All insulation is secured with both adhesive and mechanical fasteners, and all edges are hidden. The drainpan (7) is made of material that resists the growth of harmful bacteria and is sloped for the latest IAQ benefits. Furthermore, the drain pan slides out for easy cleaning.

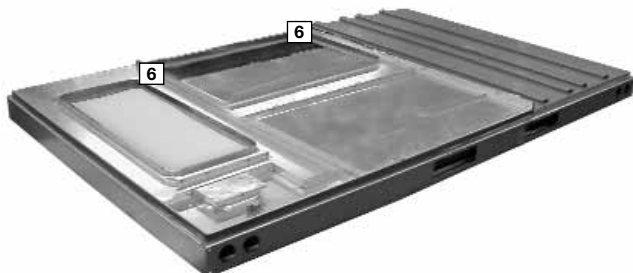



During development, each unit was tested to U.L. 1995, AHRI 340-370 and other Rheem-required reliability tests. Rheem adheres to stringent ISO 9002 quality procedures, and each unit bears the U.L. and AHRI certification labels located on the unit nameplate (8). Contractors can rest assured that when a Rheem package unit arrives at the job, it is ready to go with a factory charge and quality checks.

Access to all major compartments is from the front of the unit, including the filter and electrical compartment, blower compartment, heating section, and outdoor section. Each compartment has 1/4 turn fasteners and hinged access. Each panel is permanently embossed with the compartment name (control/filter access, blower access and electric heat access).


Electrical and filter compartment access is through a large, hinged-access panel. On the outside of the panel is the unit nameplate, which contains the model and serial number, electrical data and other important unit information.

The unit charging chart is located on the inside of the electrical and filter compartment door. Electrical wiring diagrams are found on the control box cover, which allows contractors to move them to more readable locations. To the right of the control box the model and serial number can be found. Having this information on the inside will assure model identification for the life of the product. The production line quality test assurance label is also placed in this location (9). The two-inch throwaway filters (10) are easily removed on a tracked system for easy replacement.

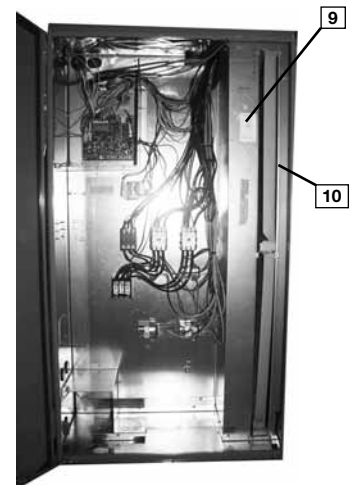


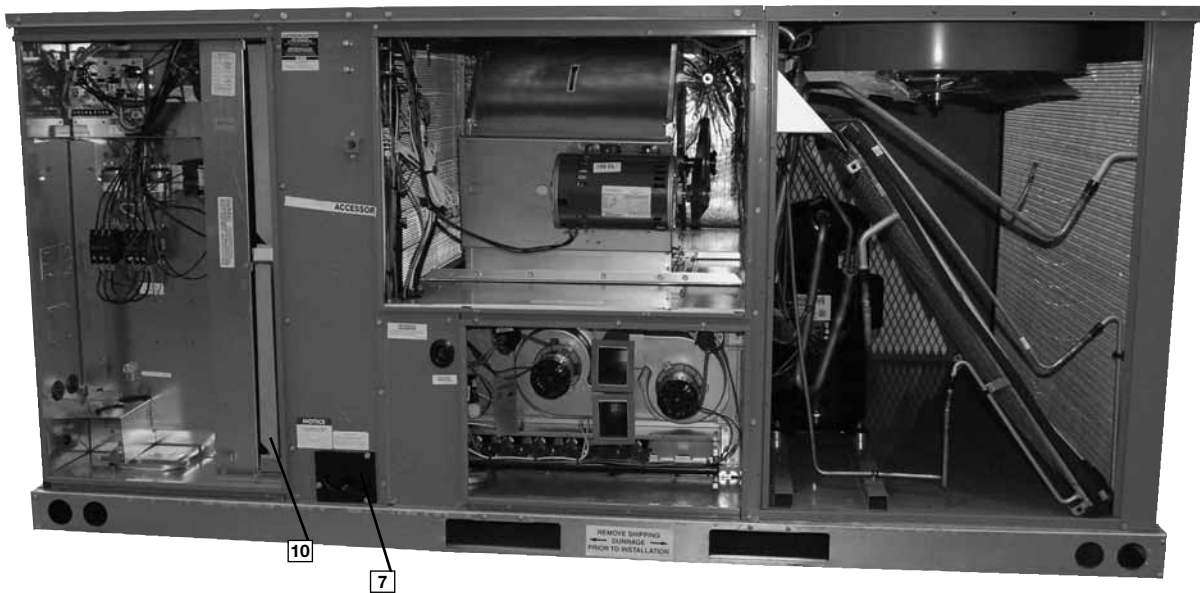

Inside the control box (11), each electrical component is clearly identified with a label that matches the component to the wire diagram for ease of trouble shooting. All wiring is numbered on each end of the termination and color-coded to match the wiring diagram. The control transformer has a low voltage circuit breaker that trips if a low voltage electrical short occurs. There is a blower contactor and compressor for each compressor.

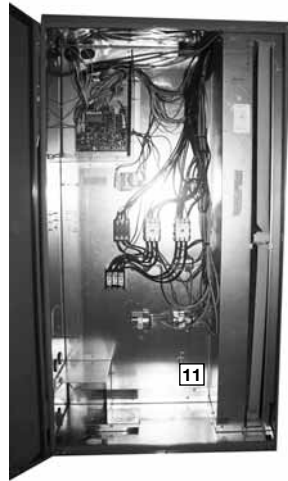

As part of the ClearControl™ system which allows real time monitoring and communication between rooftop units, the RLRL-C/H Package Air Conditioner has a Rooftop Unit Controller (RTU-C) factory mounted and wired in the control panel. The RTU-C is a solid-state microprocessor-based control board that provides flexible control and extensive diagnostics for all unit functions. The RTU-C through proportional/integral control algorithms perform specific unit functions that govern unit operation in response to: zone conditions, system temperatures, system pressures, ambient conditions and electrical inputs. The RTU-C features a 16 x 2 character LCD display and a five-button keypad for local configuration and direct diagnosis of the system. (12) New features include a clogged filter switch (CFS), fan proving switch (FPS), return air temperature sensor (RAT), discharge air temperature sensor (DAT) and outdoor air temperature sensor (OAT). Freeze sensors (FS) are used in place of freezestats to allow measurement of refrigerant suction line temperatures. The RLRL-C/H Package Air Conditioner with ClearControl™ is specifically designed to be applied in four distinct applications:

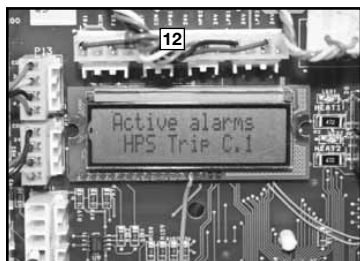

The RLRL-C/H is compatible with a third party building management system that supports the BACnet Application Specific Controller device profile, with the use of a field installed BACnet Communication Module. The BACnet Communication Module plugs onto the unit RTU-C controller and allows communication between ClearControl™ and the BACnet MSTP network. A zone sensor, a BACnet network zone sensor, a BACnet thermostat or DDC controller may be used to send the zone temperature or thermostat demands to the RTU-C. The BACnet Communication Module is compatible with MSTP EIA-485 daisy chain networks communicating at 38.4 bps. It is compatible with twisted pair, shielded cables.

The RLRL-C/H is compatible with a third party building management system that supports the LonMark Space Comfort Controller (SCC) functional profile or LonMark Discharge Air Controller (DAC) functional profile. This is accomplished with a field installed LonMark communication module. The LonMark Communication Module plugs onto the RTU-C controller and allows communication between ClearControl™ and a LonWorks Network. A zone sensor, a LonTalk network zone sensor, or a LonTalk thermostat or DDC controller may be used to send the zone temperature or thermostat demands to the RTU-C. The LonMark Communication Module utilizes an FTT-10A free topology transceiver communicating at 78.8 kbps. It is compatible with Echelon qualified twisted pair cable, Belden 8471 or NEMA Level 4 cables. The Module can communicate up to 1640 ft. with no repeater. The LonWorks limit of 64 nodes per segment applies to this device.

The RLRL-C/H is compatible with a programmable 24 volt thermostat. Connections are made via conventional thermostat screw terminals. Extensive unit status and diagnostics are displayed on the LCD screen of the RTU-C.

The RLRL-C/H is compatible with a zone sensor and mechanical or solid state time clock connected to the RTU-C. Extensive unit status and diagnostics are displayed on the LCD screen of the RTU-C.

A factory or field installed Comfort Alert® module is available for power phase-monitoring protection and additional compressor diagnostics. The alarms can be displayed on the RTU-C display, through the (BAS) network, or connected to the "L-Terminal" of a thermostat for notification.



-H models with factory installed supply fan, VFD (Variable Frequency Drive) optimizes energy usage year round by providing a lower speed for first stage cooling operation improving IEER's by up to 33% over the conventional constant fan system. Furthermore, operating in the constant fan mode at the reduced speed can use as little as 1/8<sup>th</sup> of the energy of a conventional constant fan system. Also, by operating at a lower speed on first stage cooling up to 126% more moisture is removed improving comfort during low load operation. The VFD supply fan factory option meet's California Title 24 and ASHRAE 90.1-2010 requirements for multi blower speed control. VFD also ramps up to the desired speed reducing stress on the supply fan components and reducing the noise from sudden inrush of air. Because the airflow is cut in half during first stage cooling and constant fan operation, noise is much less during these modes of operation.



For added convenience in the field, a factory-installed convenience outlet (13) is available. Low and High voltage can enter either from the side or through the base. Low-voltage connections are made integrated cooling control. The high-voltage connection is terminated at the number 1 compressor contactor. The suggested mounting for the field-installed disconnect is on the exterior side of the electrical control box.




To the right of the electrical and filter compartment are the externally mounted gauge ports, which are permanently identified by embossed wording that clearly identifies the compressor circuit, high pressure connection and low pressure connection (14). With the gauge ports mounted externally, an accurate diagnostic of system operation can be performed quickly and easily. The blower compartment is to the right of the gauge ports and can be




accessed by 1/4 turn fasteners. To allow easy maintenance of the blower assembly, the entire assembly easily slides out by removing the 3/8" screws from the blower retention bracket. The adjustable motor pulley (15) can

easily be adjusted by loosening the bolts on either side of the motor mount. Removing the bolts allows for easy removal of the blower pulley by pushing the blower assembly up to loosen the belt. Once the pulley is removed, the motor sheave can be adjusted to the desired number of turns, ranging from 0 to 6 turns open. Where the demands for the job require high static, Rheem has high-static drives available that deliver nominal airflow up to 2" of static. By referring to the airflow performance tables listed in the installation instructions, proper static pressure and CFM requirements can be dialed in. The scroll housing (16) and blower scroll provide quiet and efficient airflow. The blower sheave is secured by an "H" bushing which firmly secures the pulley to the blower shaft for years of trouble-free operation. The "H" bushing allows for easy removal of the blower pulley from the shaft, as opposed to the use of a set screw, which can score the shaft, creating burrs that make blower-pulley removal difficult.


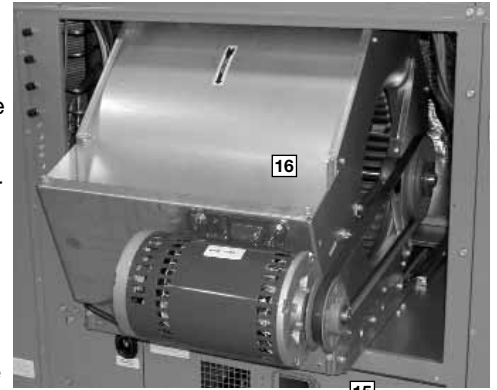


Also inside the blower compartment is the low-ambient control (17), low-pressure switch (18), high-pressure switch (19) and freeze sensor refrigerant safety device (20). The low-ambient control allows for operation of the compressor down to 0 degrees ambient temperature by cycling the outdoor fans on high pressure. The high-pressure switch will shut off the compressors if pressures in excess of 610 PSIG are detected, this may occur if the outdoor fan motor fails. The low-pressure switch shuts off the compressors if low pressure is detected due to loss of charge. The freeze sensor protects the compressor if the evaporator coil gets too cold (below freezing) due to low airflow, and allows monitoring of the suction line temperature on the controller display. Each factory-installed option is brazed into the appropriate high or low side and wired appropriately. Use of polarized plugs and schrader fittings allow for easy field installation.

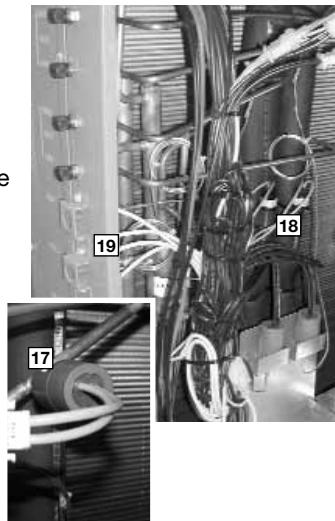

Inside the blower compartment the interlaced evaporator can also be viewed. The evaporator uses enhanced fin technology for maximum heat transfer. The TXV metering device assures even distribution of refrigerant throughout the evaporator. (Note: 6 ton single stage has an orifice refrigerant control.)


Wiring throughout the unit is neatly bundled and routed. Where wire harnesses go through the condenser bulkhead or blower deck, a molded wire harness assembly (20) provides an air-tight and water-tight seal, and provides strain relief. Care is also taken to tuck raw edges of insulation behind sheet metal to improve indoor air quality.

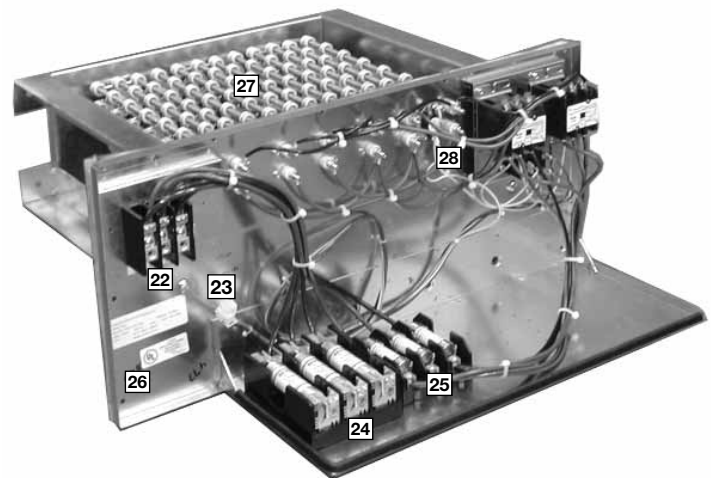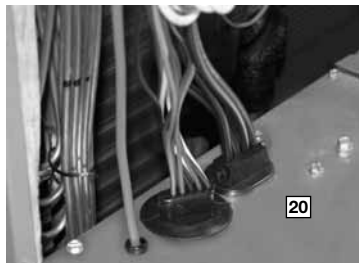

The heating compartment contains the latest electric furnace technology on the market. The 100% efficient electric furnace can be factory-installed or easily field-installed. Built with ease-of-installation in mind, the electric furnace is completely wired for slide-in, plug-and-play installation in the field. With choices of up to six kilowatt offerings, the contractor is assured to get the correct amount of heating output to meet the designed heating load.

Power hook-up in the field is easy with single-point wiring to a terminal block (22) and a polarized plug for the low-voltage connection (23). The electric furnace comes with fuses for the unit (24) and for the electric furnace (25), and is UL certified (26). The electric heating elements are of a wound-wire construction (27) and isolated with ceramic bushings. The limit switch (28) protects the design from over-temperature conditions. Each electric furnace has the capability to be converted from single-stage operation to two-stage operation by removing a jumper on the low-voltage terminal strip.

The compressor compartment houses the heartbeat of the unit. The scroll compressor (29) is known for its long life, and for reliable, quiet, and efficient operation. Each compressor has molded compressor plug eliminating potential for mis wiring. The suction and discharge lines are designed with shock loops (30) to absorb the strain and stress that the starting torque, steady state operation, and shut down cycle impose on the refrigerant tubing. Each compressor and circuit is independent for built-in redundancy, and each circuit is clearly marked throughout the system. Each unit has two stages of efficient cooling operation, first stage is approximately 50% of second stage (072 single stage).

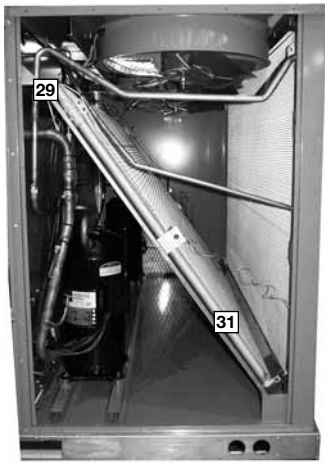


Each unit comes standard with filter dryer (31). The condenser fan motor (32) can easily be accessed and maintained through the compressor compartment. The polarized plug connection allows the motor to be changed quickly and eliminates the need to snake wires through the unit.

The outdoor coil uses the latest enhanced fin design (33) for the most effective method of heat transfer. The outdoor coil is protected by optional louvered panels, which allow unobstructed airflow while protecting the unit from both Mother Nature and vandalism.

Each unit is designed for both downflow or horizontal applications (34) for job configuration flexibility. The return air compartment can also contain an economizer (35).



Three models exist, two for downflow applications, and one for horizontal applications (A downflow economizer with factory installed smoke detector in the return section is available). Each unit is pre-wired for the economizer to allow quick plug-in installation. The economizer is also available as a factory-installed option. The economizer, which provides free cooling when outdoor conditions are suitable and also provides fresh air to meet local requirements, comes standard with single enthalpy controls. The controls can be upgraded to dual enthalpy easily in the field. The direct drive actuator combined with gear drive dampers has eliminated the need for linkage adjustment in the field. The economizer control has a minimum position setpoint, an outdoor-air setpoint, a mix-air setpoint, and a CO<sub>2</sub> setpoint. Barometric relief is standard on all economizers. Power Exhaust is easily field-installed. The power exhaust is housed in the barometric relief opening and is easily slipped in with a plug-in assembly. The wire harness to the economizer also has accommodations for a smoke detector.

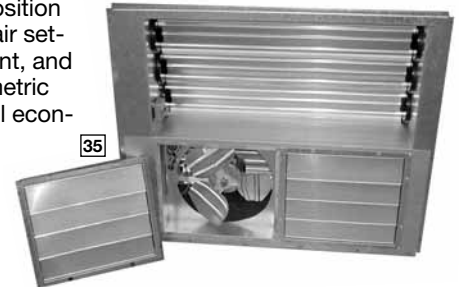

The damper minimum position, actual damper position, power exhaust on/off setpoint, mixed air temperature limit setpoint and Demand Controlled Ventilation (DCV) setpoint can be read and adjusted at the unit controller display or remotely through a network connection.


The Space CO<sub>2</sub> level, mixed air temperature, and Economizer Status (Free Cooling Available, Single or Dual Enthalpy) can be read at the unit controller display or remotely through a network connection. Economizer Faults will trigger a network Alarm and can be read at the unit controller display or remotely through a network connection.

The Rheem roofcurb (36) is made for toolless assembly at the jobsite by engaging a pin into the hinged corners of adjacent curb sides, which makes the assembly process quick and easy.





**R L R L — C 090 C L 000 X X X**

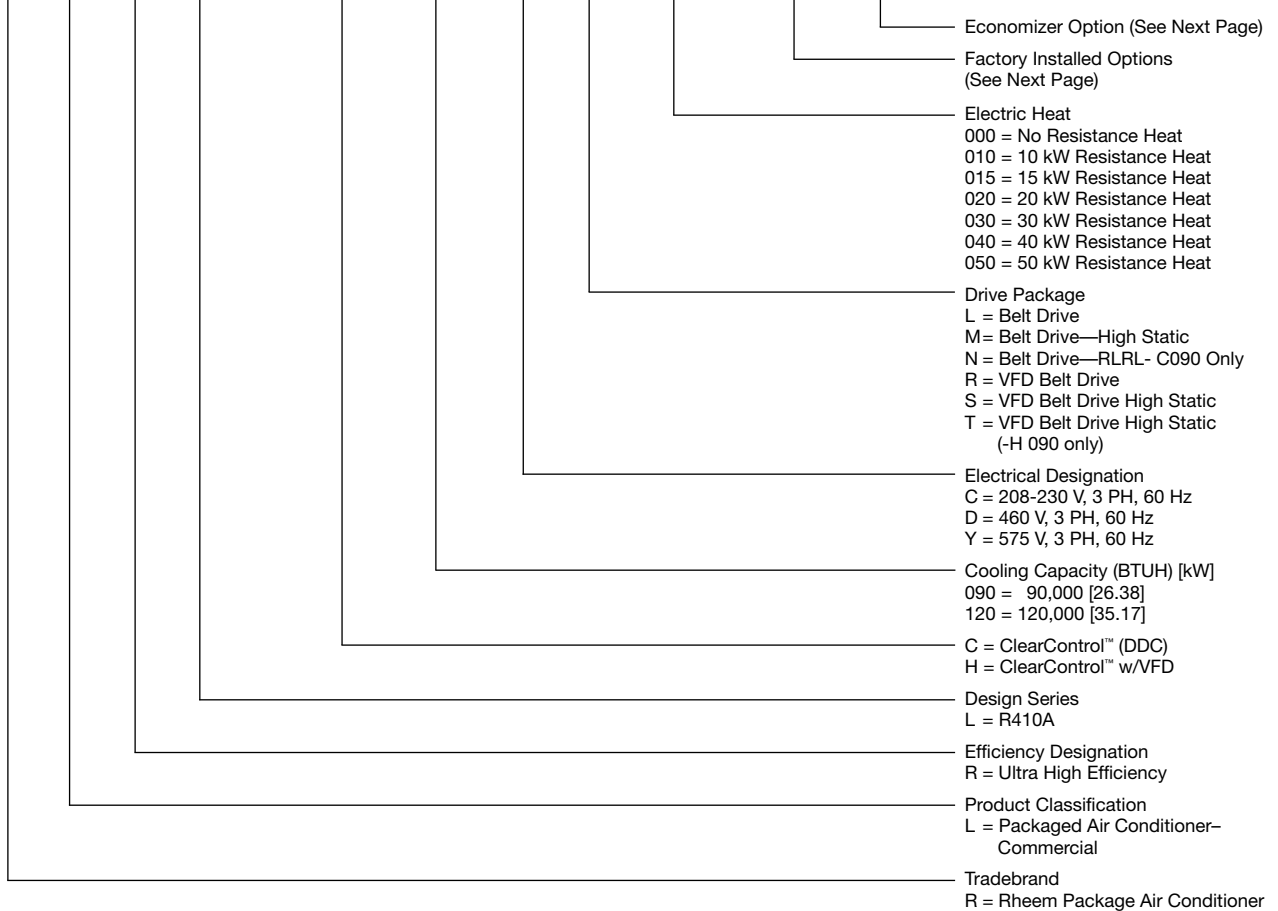

[ ] Designates Metric Conversions

## 6 TO 12.5 TON [21.1 TO 44.0 kW]

Option Code	Hail Guard	Non-Powered Convenience Outlet	Low Ambient/ Comfort Alert
AD	X		
AG		X	
AR			X
JD	X		X
BJ	X	X	
CZ	X	X	X
JE		X	X

"x" indicates factory installed option.

## ECONOMIZER SELECTION FOR LRL 7 TO 10 TON [26.4 TO 35.2 kW]

	No Economizer	DDC Single Enthalpy Economizer with Barometric Relief	DDC Single Enthalpy Economizer with Barometric Relief and Smoke Detector
A	X		
H		X	
J			X

"x" indicates factory installed option.

## Instructions for Factory Installed Option(s) Selection

**Note:** Three characters following the model number will be utilized to designate a factory-installed option or combination of options. If no factory option(s) is required, nothing follows the model number.

**Step 1.** After a basic rooftop model is selected, choose a *two-character* option code from the FACTORY INSTALLED OPTION SELECTION TABLE.

Proceed to Step 2.

**Step 2.** The last option code character is utilized for factory-installed economizers. Choose a character from the FACTORY INSTALLED ECONOMIZER SELECTION TABLE.

### Examples:

RLRL-C120CL000.....this unit has no factory installed options.

RLRL-C120CL000**ADA** .....this unit is equipped with *hail guards*.

RLRL-C120CL000**JDA** .....this unit is equipped with *hail guards, low ambient and comfort alert*.

RLRL-C120CL000**JDH** .....this unit is equipped as above *and* includes an *Economizer with single enthalpy sensor and with barometric relief*.

RLRL-C120CL000**AAJ** .....this unit is equipped with an *Economizer with single enthalpy sensor and barometric relief with smoke detector*.

[ ] Designates Metric Conversions

To select an RLRL-C/H Cooling and Heating unit to meet a job requirement, follow this procedure, with example, using data supplied in this specification sheet.

### 1. DETERMINE COOLING AND HEATING REQUIREMENTS AND SPECIFIC OPERATING CONDITIONS FROM PLANS AND SPECS.

#### Example:

Voltage—	208/240V 3 Phase
Total cooling capacity—	106,000 BTUH [31.26 kW]
Sensible cooling capacity—	82,000 BTUH [24.03 kW]
Heating capacity—	150,000 BTUH [43.96 kW]
*Condenser Entering Air—	95°F [35°C] DB
*Evaporator Mixed Air Entering—	65°F [18°C] WB; 78°F [26°C] DB
*Indoor Air Flow (vertical)—	3600 CFM [1699 L/s]
*External Static Pressure—	.40 in. WG

### 2. SELECT UNIT TO MEET COOLING REQUIREMENTS.

Since total cooling is within the range of a nominal 10 ton [35.2 kW] unit, enter cooling performance table at 95°F [35°C] DB condenser inlet air. Interpolate between 63°F [2°C] and 67°F [19°C] to determine total and sensible capacity and power input for 65°F [18°C] WB evap inlet air at 4000 CFM [1888 L/s] indoor air flow (table basis):

Total Capacity = 118,900 BTUH [34.80 kW]  
 Sensible Capacity = 99,950 BTUH [29.29 kW]  
 Power Input (Compressor and Cond. Fans) = 8,950 watts

Use formula  $[1.10 \times \text{CFM} \times (1 - \text{DR}) \times (\text{dbE} - 80)]$  in note ① to determine sensible capacity at 80°F [26.7°C] DB evaporator entering air:

Sensible Capacity = 92,268 BTUH [27.24 kW]

### 3. CORRECT CAPACITIES OF STEP 2 FOR ACTUAL AIR FLOW.

Select factors from airflow correction table at 3600 CFM [1699 L/s] and apply to data obtained in step 2 to obtain gross capacity:

Total Capacity,  $118,900 \times .98 = 116,522$  BTUH [34.15 kW]  
 Sensible Capacity,  $92,268 \times .95 = 87,655$  BTUH [25.67 kW]  
 Power Input  $11,650 \times .99 = 8,861$  Watts

These are Gross Capacities, not corrected for blower motor heat or power.

### 4. DETERMINE BLOWER SPEED AND WATTS TO MEET SYSTEM DESIGN.

Enter Indoor Blower performance table at 3600 CFM [1699 L/s]. Total ESP (external static pressure) per the spec of .40 in. includes the system duct and grilles. Add from the table "Component Air Resistance," .076 for wet coil, .13 for vertical air flow, for a total selection static pressure of .606 (.6) inches of water, and determine:

RPM = 796  
 WATTS = 1,650  
 DRIVE = L (standard 2 H.P. motor)

### 5. CALCULATE INDOOR BLOWER BTUH HEAT EFFECT FROM MOTOR WATTS, STEP 4.

$$\text{BTUH} = 1,650 \times 3.412 = 5,630$$

### 6. CALCULATE NET COOLING CAPACITIES, EQUAL TO GROSS CAPACITY, STEP 3, MINUS INDOOR BLOWER MOTOR HEAT.

$$\text{Net Total Capacity} = 116,522 - 5,630 = 110,892 \text{ BTUH [32.5 kW]}$$

$$\text{Net Sensible Capacity} = 87,655 - 5,630 = 82,025 \text{ BTUH [24.04 kW]}$$

### 7. CALCULATE UNIT INPUT AND JOB EER.

$$\text{Total Power Input} = 88,610 \text{ (step 3)} + 1,650 \text{ (step 4)} = 10,511 \text{ Watts}$$

$$\text{EER} = \frac{\text{Net Total BTUH [kW]} \text{ (step 6)}}{\text{Power Input, Watts (above)}} = \frac{110,892}{10,511} = 10.55$$

### 8. SELECT UNIT HEATING CAPACITY.

Units with heater kits section find unit heater kw and convert watts to BTU: add blower BTUH heat effect (step 5).

CC50C	Heater Kit
kW x 3412	= 163,776 BTUH [48.00 kW]
	+ 5,630 BTUH [ 1.65 kW]
Heating Capacity=	169,406 BTUH [49.65 kW]

### CHOOSE MODEL RLRL-C/H120CL050

\*NOTE: These operating conditions are typical of a commercial application in a 95°F/79°F [35°C/26°C] design area with indoor design of 76°F [24°C] DB and 50% RH and 10% ventilation air, with the unit roof mounted and centered on the zone it conditions by ducts.

[ ] Designates Metric Conversions

## NOM. SIZES 7.5-10 TONS [26.4-35.2 kW] ASHRAE 90.1-2010 COMPLIANT MODELS

Model RLRL- Series	C090CL	C090CM	C090CN	C090DL
Model RLRL- Series (with VFD)	H090CR	H090CS	H090CT	H090DR
<b>Cooling Performance<sup>1</sup></b>				<b>CONTINUED</b> →
Gross Cooling Capacity Btu [kW]	95,000 [27.83]	95,000 [27.83]	95,000 [27.83]	95,000 [27.83]
EER/SEER <sup>2</sup>	13/NA	13/NA	13/NA	13/NA
Nominal CFM/AHRI Rated CFM [L/s]	3000/2600 [1416/1227]	3000/2600 [1416/1227]	3000/2600 [1416/1227]	3000/2600 [1416/1227]
AHRI Net Cooling Capacity Btu [kW]	92,000 [26.96]	92,000 [26.96]	92,000 [26.96]	92,000 [26.96]
Net Sensible Capacity Btu [kW]	66,200 [19.4]	66,200 [19.4]	66,200 [19.4]	66,200 [19.4]
Net Latent Capacity Btu [kW]	25,800 [7.56]	25,800 [7.56]	25,800 [7.56]	25,800 [7.56]
IEER <sup>3</sup> (Standard / VFD)	14/15.8	14/15.8	14/15.8	14/15.8
Net System Power kW	7.04	7.04	7.04	7.04
<b>Compressor</b>				
No./Type	2/Scroll	2/Scroll	2/Scroll	2/Scroll
<b>Outdoor Sound Rating (dB)<sup>5</sup></b>				
	88	88	88	88
<b>Outdoor Coil—Fin Type</b>				
Tube Type	Louvered	Louvered	Louvered	Louvered
MicroChannel Depth in. [mm]	MicroChannel	MicroChannel	MicroChannel	MicroChannel
Face Area sq. ft. [sq. m]	1 [25.4]	1 [25.4]	1 [25.4]	1 [25.4]
Rows / FPI [FPcm]	27 [2.51]	27 [2.51]	27 [2.51]	27 [2.51]
	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]
<b>Indoor Coil—Fin Type</b>				
Tube Type	Louvered	Louvered	Louvered	Louvered
Tube Size in. [mm]	Rifled	Rifled	Rifled	Rifled
Face Area sq. ft. [sq. m]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Rows / FPI [FPcm]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]
Refrigerant Control	3 / 15 [6]	3 / 15 [6]	3 / 15 [6]	3 / 15 [6]
Drain Connection No./Size in. [mm]	TX Valves	TX Valves	TX Valves	TX Valves
	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
<b>Outdoor Fan—Type</b>				
No. Used/Diameter in. [mm]	Propeller	Propeller	Propeller	Propeller
Drive Type/No. Speeds	2/24 [609.6]	2/24 [609.6]	2/24 [609.6]	2/24 [609.6]
CFM [L/s]	Direct/1	Direct/1	Direct/1	Direct/1
No. Motors/HP	8000 [3775]	8000 [3775]	8000 [3775]	8000 [3775]
Motor RPM	2 at 1/3 HP	2 at 1/3 HP	2 at 1/3 HP	2 at 1/3 HP
	1075	1075	1075	1075
<b>Indoor Fan—Type</b>				
No. Used/Diameter in. [mm]	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
Drive Type	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]
No. Speeds (Standard / VFD)	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)
No. Motors	Single / Multiple	Single / Multiple	Single / Multiple	Single / Multiple
Motor HP	1	1	1	1
Motor RPM	2	2	3	2
Motor Frame Size	1725	1725	1725	1725
	56	56	56	56
<b>Filter—Type</b>				
Furnished	Disposable	Disposable	Disposable	Disposable
(NO.) Size Recommended in. [mm x mm x mm]	Yes	Yes	Yes	Yes
	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]
<b>Refrigerant Charge Oz. (Sys. 1/Sys. 2) [g]</b>				
	105.6/105.6 [2994/2994]	105.6/105.6 [2994/2994]	105.6/105.6 [2994/2994]	105.6/105.6 [2994/2994]
<b>Weights</b>				
Net Weight lbs. [kg]	1020 [463]	1020 [463]	1028 [466]	1020 [463]
Ship Weight lbs. [kg]	1057 [479]	1057 [479]	1065 [483]	1057 [479]

### NOTES:

- Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 340/360.
- EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
- Integrated Energy Efficiency Ratio (IEER) is rated in accordance with AHRI Standard 340/360.
- Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

[ ] Designates Metric Conversions

## NOM. SIZES 7.5-10 TONS [26.4-35.2 kW] ASHRAE 90.1-2010 COMPLIANT MODELS

Model RLRL- Series Model RLRL- Series (with VFD)	C090DM H090DS	C090DN H090DT	C090YL	C090YM
<b>Cooling Performance<sup>1</sup></b>				<b>CONTINUED</b> →
Gross Cooling Capacity Btu [kW]	95,000 [27.83]	95,000 [27.83]	95,000 [27.83]	95,000 [27.83]
EER/SEER <sup>2</sup>	13/NA	13/NA	13/NA	13/NA
Nominal CFM/AHRI Rated CFM [L/s]	3000/2600 [1416/1227]	3000/2600 [1416/1227]	3000/2600 [1416/1227]	3000/2600 [1416/1227]
AHRI Net Cooling Capacity Btu [kW]	92,000 [26.96]	92,000 [26.96]	92,000 [26.96]	92,000 [26.96]
Net Sensible Capacity Btu [kW]	66,200 [19.4]	66,200 [19.4]	66,200 [19.4]	66,200 [19.4]
Net Latent Capacity Btu [kW]	25,800 [7.56]	25,800 [7.56]	25,800 [7.56]	25,800 [7.56]
IEER <sup>3</sup> (Standard / VFD)	14/15.8	14/15.8	14	14
Net System Power kW	7.04	7.04	7.04	7.04
<b>Compressor</b>				
No./Type	2/Scroll	2/Scroll	2/Scroll	2/Scroll
<b>Outdoor Sound Rating (dB)<sup>5</sup></b>				
	88	88	88	88
<b>Outdoor Coil—Fin Type</b>				
Tube Type	MicroChannel	MicroChannel	MicroChannel	MicroChannel
MicroChannel Depth in. [mm]	1 [25.4]	1 [25.4]	1 [25.4]	1 [25.4]
Face Area sq. ft. [sq. m]	27 [2.51]	27 [2.51]	27 [2.51]	27 [2.51]
Rows / FPI [FPcm]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]	1 / 23 [9]
<b>Indoor Coil—Fin Type</b>				
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]	13.5 [1.25]
Rows / FPI [FPcm]	3 / 15 [6]	3 / 15 [6]	3 / 15 [6]	3 / 15 [6]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
<b>Outdoor Fan—Type</b>				
No. Used/Diameter in. [mm]	2/24 [609.6]	2/24 [609.6]	2/24 [609.6]	2/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	8000 [3775]	8000 [3775]	8000 [3775]	8000 [3775]
No. Motors/HP	2 at 1/3 HP	2 at 1/3 HP	2 at 1/3 HP	2 at 1/3 HP
Motor RPM	1075	1075	1075	1075
<b>Indoor Fan—Type</b>				
No. Used/Diameter in. [mm]	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]
Drive Type	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)
No. Speeds (Standard / VFD)	Single / Multiple	Single / Multiple	Single	Single
No. Motors	1	1	1	1
Motor HP	2	3	2	2
Motor RPM	1725	1725	1725	1725
Motor Frame Size	56	56	56	56
<b>Filter—Type</b>				
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]	(6)2x18x18 [51x457x457]
<b>Refrigerant Charge Oz. (Sys. 1/Sys. 2) [g]</b>				
	105.6/105.6 [2994/2994]	105.6/105.6 [2994/2994]	105.6/105.6 [2994/2994]	105.6/105.6 [2994/2994]
<b>Weights</b>				
Net Weight lbs. [kg]	1020 [463]	1028 [466]	1020 [463]	1020 [463]
Ship Weight lbs. [kg]	1057 [479]	1065 [483]	1057 [479]	1057 [479]

### NOTES:

- Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 340/360.
- EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
- Integrated Energy Efficiency Ratio (IEER) is rated in accordance with AHRI Standard 340/360.
- Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

[ ] Designates Metric Conversions





## NOM. SIZES 7.5-10 TONS [26.4-35.2 kW] ASHRAE 90.1-2010 COMPLIANT MODELS

Model RLRL- Series	C090YN	C120CL H120CR	C120CM H120CS	C120DL H120DR
<b>Model RLRL- Series (with VFD)</b>				<b>CONTINUED</b> →
<b>Cooling Performance<sup>1</sup></b>				
Gross Cooling Capacity Btu [kW]	95,000 [27.83]	124,000 [36.33]	124,000 [36.33]	124,000 [36.33]
EER/SEER <sup>2</sup>	13/NA	12.5/NA	12.5/NA	12.5/NA
Nominal CFM/AHRI Rated CFM [L/s]	3000/2600 [1416/1227]	4000/3575 [1888/1687]	4000/3575 [1888/1687]	4000/3575 [1888/1687]
AHRI Net Cooling Capacity Btu [kW]	92,000 [26.96]	120,000 [35.16]	120,000 [35.16]	120,000 [35.16]
Net Sensible Capacity Btu [kW]	66,200 [19.4]	87,600 [25.67]	87,600 [25.67]	87,600 [25.67]
Net Latent Capacity Btu [kW]	25,800 [7.56]	32,400 [9.49]	32,400 [9.49]	32,400 [9.49]
IEER <sup>3</sup> (Standard / VFD)	14	13.8/15.6	13.8/15.6	13.8/15.6
Net System Power kW	7.04	9.62	9.62	9.62
<b>Compressor</b>				
No./Type	2/Scroll	2/Scroll	2/Scroll	2/Scroll
<b>Outdoor Sound Rating (dB)<sup>5</sup></b>	88	88	88	88
<b>Outdoor Coil—Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	MicroChannel	MicroChannel	MicroChannel	MicroChannel
MicroChannel Depth in. [mm]	1 [25.4]	1 [25.4]	1 [25.4]	1 [25.4]
Face Area sq. ft. [sq. m]	27 [2.51]	27 [2.51]	27 [2.51]	27 [2.51]
Rows / FPI [FPcm]	1 / 23 [9]	2 / 23 [9]	2 / 23 [9]	2 / 23 [9]
<b>Indoor Coil—Fin Type</b>	Louvered	Louvered	Louvered	Louvered
Tube Type	Rifled	Rifled	Rifled	Rifled
Tube Size in. [mm]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Face Area sq. ft. [sq. m]	13.5 [1.25]	15.75 [1.46]	15.8 [1.47]	15.75 [1.46]
Rows / FPI [FPcm]	2 / 18 [7]	4 / 15 [6]	4 / 15 [6]	4 / 15 [6]
Refrigerant Control	TX Valves	TX Valves	TX Valves	TX Valves
Drain Connection No./Size in. [mm]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
<b>Outdoor Fan—Type</b>	Propeller	Propeller	Propeller	Propeller
No. Used/Diameter in. [mm]	2/24 [609.6]	2/24 [609.6]	2/24 [609.6]	2/24 [609.6]
Drive Type/No. Speeds	Direct/1	Direct/1	Direct/1	Direct/1
CFM [L/s]	8000 [3775]	8000 [3775]	8000 [3775]	8000 [3775]
No. Motors/HP	2 at 1/3 HP	2 at 1/3 HP	2 at 1/3 HP	2 at 1/3 HP
Motor RPM	1075	1075	1075	1075
<b>Indoor Fan—Type</b>	FC Centrifugal	FC Centrifugal	FC Centrifugal	FC Centrifugal
No. Used/Diameter in. [mm]	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]
Drive Type	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)
No. Speeds (Standard / VFD)	Single	Single / Multiple	Single / Multiple	Single / Multiple
No. Motors	1	1	1	1
Motor HP	3	2	3	2
Motor RPM	1725	1725	1725	1725
Motor Frame Size	56	56	56	56
<b>Filter—Type</b>	Disposable	Disposable	Disposable	Disposable
Furnished	Yes	Yes	Yes	Yes
(NO.) Size Recommended in. [mm x mm x mm]	(6)2x18x18 [51x457x457]	(3)2x18x18 [51x457x457] (3)2x18x24 [51x457x610]	(3)2x18x18 [51x457x457] (3)2x18x24 [51x457x610]	(3)2x18x18 [51x457x457] (3)2x18x24 [51x457x610]
<b>Refrigerant Charge Oz. (Sys. 1/Sys. 2) [g]</b>	107.5/110.7 [3048/3138]	153.6/156.8 [4355/4445]	153.6/156.8 [4355/4445]	153.6/156.8 [4355/4445]
<b>Weights</b>				
Net Weight lbs. [kg]	1028 [466]	1169 [530]	1177 [534]	1169 [530]
Ship Weight lbs. [kg]	1065 [483]	1206 [547]	1214 [551]	1206 [547]

### NOTES:

- Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 340/360.
- EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
- Integrated Energy Efficiency Ratio (IEER) is rated in accordance with AHRI Standard 340/360.
- Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

[ ] Designates Metric Conversions

## NOM. SIZES 7.5-10 TONS [26.4-35.2 kW] ASHRAE 90.1-2010 COMPLIANT MODELS

Model RLRL- Series	C120DM	C120YL	C120YM
Model RLRL- Series (with VFD)	H120DS		
<b>Cooling Performance<sup>1</sup></b>			
Gross Cooling Capacity Btu [kW]	124,000 [36.33]	124,000 [36.33]	124,000 [36.33]
EER/SEER <sup>2</sup>	12.5/NA	12.5/NA	12.5/NA
Nominal CFM/AHRI Rated CFM [L/s]	4000/3575 [1888/1687]	4000/3575 [1888/1687]	4000/3575 [1888/1687]
AHRI Net Cooling Capacity Btu [kW]	120,000 [35.16]	120,000 [35.16]	120,000 [35.16]
Net Sensible Capacity Btu [kW]	87,600 [25.67]	87,600 [25.67]	87,600 [25.67]
Net Latent Capacity Btu [kW]	32,400 [9.49]	32,400 [9.49]	32,400 [9.49]
IEER <sup>3</sup> (Standard / VFD)	13.8/15.6	13.8	13.8
Net System Power kW	9.62	9.62	9.62
<b>Compressor</b>			
No./Type	2/Scroll	2/Scroll	2/Scroll
<b>Outdoor Sound Rating (dB)<sup>5</sup></b>			
	88	88	88
<b>Outdoor Coil—Fin Type</b>			
Tube Type	Louvered	Louvered	Louvered
MicroChannel Depth in. [mm]	MicroChannel	MicroChannel	MicroChannel
Face Area sq. ft. [sq. m]	1 [25.4]	1 [25.4]	1 [25.4]
Rows / FPI [FPCm]	27 [2.51]	27 [2.51]	27 [2.51]
	2 / 23 [9]	2 / 23 [9]	2 / 23 [9]
<b>Indoor Coil—Fin Type</b>			
Tube Type	Louvered	Louvered	Louvered
Tube Size in. [mm]	Rifled	Rifled	Rifled
Face Area sq. ft. [sq. m]	0.375 [9.5]	0.375 [9.5]	0.375 [9.5]
Rows / FPI [FPCm]	15.75 [1.46]	15.75 [1.46]	15.75 [1.46]
Refrigerant Control	4 / 15 [6]	4 / 15 [6]	4 / 15 [6]
Drain Connection No./Size in. [mm]	TX Valves	TX Valves	TX Valves
	1/1 [25.4]	1/1 [25.4]	1/1 [25.4]
<b>Outdoor Fan—Type</b>			
No. Used/Diameter in. [mm]	Propeller	Propeller	Propeller
Drive Type/No. Speeds	2/24 [609.6]	2/24 [609.6]	2/24 [609.6]
CFM [L/s]	Direct/1	Direct/1	Direct/1
No. Motors/HP	8000 [3775]	8000 [3775]	8000 [3775]
Motor RPM	2 at 1/3 HP	2 at 1/3 HP	2 at 1/3 HP
	1075	1075	1075
<b>Indoor Fan—Type</b>			
No. Used/Diameter in. [mm]	FC Centrifugal	FC Centrifugal	FC Centrifugal
Drive Type	1/15x15 [381x381]	1/15x15 [381x381]	1/15x15 [381x381]
No. Speeds (Standard / VFD)	Belt (Adjustable)	Belt (Adjustable)	Belt (Adjustable)
No. Motors	Single / Multiple	Single	Single
Motor HP	1	1	1
Motor RPM	3	2	3
Motor Frame Size	1725	1725	1725
	56	56	56
<b>Filter—Type</b>			
Furnished	Disposable	Disposable	Disposable
(NO.) Size Recommended in. [mm x mm x mm]	Yes	Yes	Yes
	(3)2x18x18 [51x457x457]	(3)2x18x18 [51x457x457]	(3)2x18x18 [51x457x457]
	(3)2x18x24 [51x457x610]	(3)2x18x24 [51x457x610]	(3)2x18x24 [51x457x610]
<b>Refrigerant Charge Oz. (Sys. 1/Sys. 2) [g]</b>			
	153.6/156.8 [4355/4445]	153.6/156.8 [4355/4445]	153.6/156.8 [4355/4445]
<b>Weights</b>			
Net Weight lbs. [kg]	1177 [534]	1169 [530]	1177 [534]
Ship Weight lbs. [kg]	1214 [551]	1206 [547]	1214 [551]

### NOTES:

- Cooling Performance is rated at 95° F ambient, 80° F entering dry bulb, 67° F entering wet bulb. Gross capacity does not include the effect of fan motor heat. AHRI capacity is net and includes the effect of fan motor heat. Units are suitable for operation to ±20% of nominal cfm. Units are certified in accordance with the Unitary Air Conditioner Equipment certification program, which is based on AHRI Standard 340/360.
- EER and/or SEER are rated at AHRI conditions and in accordance with DOE test procedures.
- Integrated Energy Efficiency Ratio (IEER) is rated in accordance with AHRI Standard 340/360.
- Outdoor Sound Rating shown is tested in accordance with AHRI Standard 270.

[ ] Designates Metric Conversions





## GROSS SYSTEMS PERFORMANCE DATA—C/H090

		ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①									
wbE		71°F [21.7°C]			67°F [19.4°C]			63°F [17.2°C]			
CFM [L/s]		3600 [1699]	2600 [1227]	2400 [1133]	3600 [1699]	2600 [1227]	2400 [1133]	3600 [1699]	2600 [1227]	2400 [1133]	
DR ①		.0	.03	.05	.0	.03	.05	.0	.03	.05	
OUTDOOR DRY BULB TEMPERATURE °F [°C]	75 [23.9]	Total BTUH [kW] Sens BTUH [kW] Power	121.5 [35.6] 82.0 [24.0] 5.2	113.6 [33.3] 61.6 [18.0] 5.0	112.0 [32.8] 57.8 [16.9] 5.0	115.0 [33.7] 95.3 [27.9] 5.1	107.5 [31.5] 73.3 [21.5] 5.0	106.0 [31.1] 69.2 [20.3] 4.9	109.4 [32.1] 105.8 [31.0] 5.1	102.3 [30.0] 82.6 [24.2] 4.9	100.9 [29.6] 78.3 [22.9] 4.9
	80 [26.7]	Total BTUH [kW] Sens BTUH [kW] Power	118.2 [34.6] 80.8 [23.7] 5.5	110.5 [32.4] 60.8 [17.8] 5.3	108.9 [31.9] 57.1 [16.7] 5.3	111.6 [32.7] 94.0 [27.5] 5.4	104.4 [30.6] 72.5 [21.2] 5.3	102.9 [30.1] 68.5 [20.1] 5.2	106.1 [31.1] 104.6 [30.6] 5.4	99.2 [29.1] 81.8 [24.0] 5.2	97.8 [28.7] 77.5 [22.7] 5.2
	85 [29.4]	Total BTUH [kW] Sens BTUH [kW] Power	114.8 [33.6] 79.4 [23.3] 5.8	107.3 [31.4] 59.8 [17.5] 5.6	105.8 [31.0] 56.2 [16.5] 5.6	108.2 [31.7] 92.6 [27.1] 5.8	101.2 [29.7] 71.5 [20.9] 5.6	99.7 [29.2] 67.5 [19.8] 5.5	102.7 [30.1] 102.7 [30.1] 5.7	96.0 [28.1] 80.8 [23.7] 5.5	94.7 [27.7] 76.6 [22.4] 5.5
	90 [32.2]	Total BTUH [kW] Sens BTUH [kW] Power	111.3 [32.6] 77.6 [22.7] 6.2	104.0 [30.5] 58.5 [17.1] 6.0	102.6 [30.1] 55.1 [16.1] 5.9	104.7 [30.7] 90.8 [26.6] 6.1	97.9 [28.7] 70.2 [20.6] 5.9	96.5 [28.3] 66.3 [19.4] 5.9	99.2 [29.1] 99.2 [29.1] 6.1	92.7 [27.2] 79.5 [23.3] 5.9	91.4 [26.8] 75.4 [22.1] 5.8
	95 [35]	Total BTUH [kW] Sens BTUH [kW] Power	107.7 [31.6] 75.6 [22.2] 6.6	100.7 [29.5] 57.1 [16.7] 6.3	99.3 [29.1] 53.7 [15.7] 6.3	101.2 [29.7] 88.9 [26.0] 6.5	94.5 [27.7] 68.7 [20.1] 6.3	93.2 [27.3] 65.0 [19.0] 6.3	95.6 [28.0] 95.6 [28.0] 6.5	89.4 [26.2] 78.1 [22.9] 6.2	88.1 [25.8] 74.0 [21.7] 6.2
	100 [37.8]	Total BTUH [kW] Sens BTUH [kW] Power	104.0 [30.5] 73.2 [21.4] 7.0	97.2 [28.5] 55.3 [16.2] 6.7	95.9 [28.1] 52.1 [15.3] 6.7	97.5 [28.6] 86.6 [25.4] 6.9	91.1 [26.7] 67.0 [19.6] 6.7	89.8 [26.3] 63.3 [18.5] 6.7	92.0 [27.0] 92.0 [27.0] 6.9	85.9 [25.2] 76.3 [22.4] 6.6	84.7 [24.8] 72.4 [21.2] 6.6
	105 [40.6]	Total BTUH [kW] Sens BTUH [kW] Power	100.3 [29.4] 70.8 [20.7] 7.4	93.7 [27.5] 53.4 [15.6] 7.2	92.4 [27.1] 50.2 [14.7] 7.1	93.7 [27.5] 84.0 [24.6] 7.4	87.6 [25.7] 65.1 [19.1] 7.1	86.4 [25.3] 61.6 [18.0] 7.1	88.2 [25.8] 88.2 [25.8] 7.3	82.4 [24.1] 74.4 [21.8] 7.1	81.3 [23.8] 70.7 [20.7] 7.0
	110 [43.3]	Total BTUH [kW] Sens BTUH [kW] Power	96.5 [28.3] 67.9 [19.9] 7.9	90.2 [26.4] 51.3 [15.0] 7.6	88.9 [26.0] 48.2 [14.1] 7.6	89.9 [26.3] 81.1 [23.8] 7.8	84.0 [24.6] 62.9 [18.4] 7.6	82.9 [24.3] 59.6 [17.5] 7.5	84.4 [24.7] 84.4 [24.7] 7.8	78.9 [23.1] 72.3 [21.2] 7.5	77.8 [22.8] 68.6 [20.1] 7.5
	115 [46.1]	Total BTUH [kW] Sens BTUH [kW] Power	92.5 [27.1] 64.8 [19.0] 8.4	86.5 [25.3] 48.9 [14.3] 8.1	85.3 [25.0] 46.0 [13.5] 8.1	86.0 [25.2] 78.1 [22.9] 8.4	80.4 [23.6] 60.6 [17.8] 8.1	79.2 [23.2] 57.3 [16.8] 8.0	80.5 [23.6] 80.5 [23.6] 8.3	75.2 [22.0] 69.9 [20.5] 8.0	74.1 [21.7] 66.3 [19.4] 8.0

## GROSS SYSTEMS PERFORMANCE DATA—C/H120

		ENTERING INDOOR AIR @ 80°F [26.7°C] dbE ①									
wbE		71°F [21.7°C]			67°F [19.4°C]			63°F [17.2°C]			
CFM [L/s]		4800 [2266]	3575 [1687]	3200 [1510]	4800 [2266]	3575 [1687]	3200 [1510]	4800 [2266]	3575 [1687]	3200 [1510]	
DR ①		.0	.04	.07	.0	.04	.07	.0	.04	.07	
OUTDOOR DRY BULB TEMPERATURE °F [°C]	75 [23.9]	Total BTUH [kW] Sens BTUH [kW] Power	156.5 [45.9] 105.2 [30.8] 7.1	147.3 [43.2] 81.5 [23.9] 6.9	144.5 [42.3] 74.8 [21.9] 6.8	148.9 [43.6] 123.2 [36.1] 7.0	140.2 [41.1] 97.5 [28.6] 6.8	137.5 [40.3] 90.2 [26.4] 6.7	142.7 [41.8] 137.2 [40.2] 6.9	134.4 [39.4] 110.0 [32.2] 6.7	131.8 [38.6] 102.1 [29.9] 6.6
	80 [26.7]	Total BTUH [kW] Sens BTUH [kW] Power	152.4 [44.7] 103.7 [30.4] 7.5	143.5 [42.0] 80.5 [23.6] 7.2	140.7 [41.2] 73.9 [21.7] 7.2	144.9 [42.5] 121.8 [35.7] 7.3	136.4 [40.0] 96.5 [28.3] 7.1	133.8 [39.2] 89.3 [26.2] 7.1	138.7 [40.6] 135.8 [39.8] 7.2	130.5 [38.2] 108.9 [31.9] 7.0	128.0 [37.5] 101.2 [29.7] 7.0
	85 [29.4]	Total BTUH [kW] Sens BTUH [kW] Power	148.2 [43.4] 101.8 [29.8] 7.9	139.5 [40.9] 79.1 [23.2] 7.6	136.8 [40.1] 72.7 [21.3] 7.6	140.6 [41.2] 119.8 [35.1] 7.8	132.4 [38.8] 95.1 [27.9] 7.5	129.9 [38.1] 88.1 [25.8] 7.5	134.5 [39.4] 134.1 [39.3] 7.7	126.6 [37.1] 107.7 [31.6] 7.4	124.2 [36.4] 100.1 [29.3] 7.4
	90 [32.2]	Total BTUH [kW] Sens BTUH [kW] Power	143.8 [42.1] 99.6 [29.2] 8.3	135.4 [39.7] 77.5 [22.7] 8.1	132.8 [38.9] 71.2 [20.9] 8.0	136.3 [39.9] 117.7 [34.5] 8.2	128.3 [37.6] 93.5 [27.4] 8.0	125.9 [36.9] 86.6 [25.4] 7.9	130.1 [38.1] 130.1 [38.1] 8.1	122.5 [35.9] 106.1 [31.1] 7.9	120.1 [35.2] 98.6 [28.9] 7.8
	95 [35]	Total BTUH [kW] Sens BTUH [kW] Power	139.3 [40.8] 97.2 [28.5] 8.8	131.2 [38.4] 75.7 [22.2] 8.5	128.7 [37.7] 69.6 [20.4] 8.5	131.8 [38.6] 115.3 [33.8] 8.7	124.1 [36.4] 91.7 [26.9] 8.4	121.7 [35.7] 84.9 [24.9] 8.3	125.6 [36.8] 125.6 [36.8] 8.6	118.2 [34.6] 104.2 [30.5] 8.3	116.0 [34.0] 97.0 [28.4] 8.2
	100 [37.8]	Total BTUH [kW] Sens BTUH [kW] Power	134.7 [39.5] 94.4 [27.7] 9.3	126.8 [37.2] 73.5 [21.5] 9.0	124.4 [36.4] 67.6 [19.8] 8.9	127.2 [37.3] 112.5 [33.0] 9.2	119.7 [35.1] 89.5 [26.2] 8.9	117.4 [34.4] 82.9 [24.3] 8.8	121.0 [35.5] 121.0 [35.5] 9.1	113.9 [33.4] 102.1 [29.9] 8.8	111.7 [32.7] 95.0 [27.8] 8.7
	105 [40.6]	Total BTUH [kW] Sens BTUH [kW] Power	129.9 [38.1] 91.3 [26.8] 9.8	122.3 [35.8] 71.1 [20.8] 9.5	120.0 [35.2] 65.4 [19.2] 9.4	122.4 [35.9] 109.4 [32.1] 9.7	115.2 [33.8] 87.1 [25.5] 9.4	113.0 [33.1] 80.7 [23.6] 9.3	116.2 [34.0] 116.2 [34.0] 9.6	109.4 [32.1] 99.7 [29.2] 9.3	107.3 [31.4] 92.8 [27.2] 9.2
	110 [43.3]	Total BTUH [kW] Sens BTUH [kW] Power	125.0 [36.6] 87.8 [25.7] 10.4	117.6 [34.5] 68.3 [20.0] 10.1	115.4 [33.8] 62.9 [18.4] 10.0	117.4 [34.4] 105.8 [31.0] 10.3	110.5 [32.4] 84.3 [24.7] 10.0	108.4 [31.8] 78.2 [22.9] 9.9	111.2 [32.6] 111.2 [32.6] 10.2	104.7 [30.7] 96.9 [28.4] 9.9	102.7 [30.1] 90.3 [26.5] 9.8
	115 [46.1]	Total BTUH [kW] Sens BTUH [kW] Power	119.9 [35.1] 84.0 [24.6] 11.0	112.9 [33.1] 65.4 [19.2] 10.6	110.7 [32.4] 60.1 [17.6] 10.5	112.3 [32.9] 102.0 [29.9] 10.9	105.7 [31.0] 81.3 [23.8] 10.5	103.7 [30.4] 75.4 [22.1] 10.4	106.1 [31.1] 106.1 [31.1] 10.7	99.9 [29.3] 93.9 [27.5] 10.4	98.0 [28.7] 87.5 [25.6] 10.3

DR —Depression ratio  
dbE —Entering air dry bulb  
wbE —Entering air wet bulb

Total —Total capacity x 1000 BTUH  
Sens —Sensible capacity x 1000 BTUH  
Power —KW input

NOTES: ① When the entering air dry bulb is other than 80°F [27°C], adjust the sensible capacity from the table by adding [1.10 x CFM x (1 - DR) x (dbE - 80)].

[ ] Designates Metric Conversions



# AIRFLOW PERFORMANCE—7.5 TON [26.4 kW]—60 Hz—SIDEFLOW

Air Flow CFM [L/s]	Model RLRL-C090 Voltage 208/230, 460, 575 — 3 Phase 60 Hz																							
	External Static Pressure—Inches of Water [kPa]																							
	0.1 [0.02]	0.2 [0.05]	0.3 [0.07]	0.4 [0.10]	0.5 [0.12]	0.6 [0.15]	0.7 [0.17]	0.8 [0.20]	0.9 [0.22]	1.0 [0.25]	1.1 [0.27]	1.2 [0.30]	1.3 [0.32]	1.4 [0.35]	1.5 [0.37]	1.6 [0.40]	1.7 [0.42]	1.8 [0.45]	1.9 [0.47]	2.0 [0.50]				
2400 [1133]	—	550 [810]	582 [845]	614 [883]	645 [924]	677 [968]	708 [1015]	740 [1066]	771 [1119]	802 [1175]	833 [1234]	864 [1296]	895 [1361]	924 [1435]	955 [1508]	985 [1584]	1016 [1663]	1046 [1744]	1076 [1829]	1104 [1916]				
2500 [1180]	—	559 [839]	590 [876]	622 [916]	653 [959]	684 [1004]	715 [1053]	745 [1105]	776 [1160]	807 [1218]	837 [1279]	867 [1343]	897 [1410]	927 [1490]	957 [1564]	987 [1641]	1017 [1721]	1047 [1804]	1077 [1890]	1105 [1979]				
2600 [1227]	—	569 [872]	600 [910]	630 [952]	661 [999]	691 [1044]	722 [1095]	752 [1149]	782 [1205]	812 [1265]	842 [1328]	871 [1394]	901 [1462]	931 [1546]	961 [1622]	990 [1701]	1019 [1782]	1049 [1866]	1078 [1954]	1106 [2044]				
2700 [1274]	549	870 [579]	908 [610]	948 [640]	992 [670]	1038 [699]	1088 [729]	1140 [759]	1196 [788]	1255 [818]	1316 [847]	1381 [876]	1448 [905]	1519 [935]	1606 [964]	1683 [993]	1763 [1022]	1846 [1050]	1931 [1079]	2020 [1107]	2111			
2800 [1321]	561	909 [591]	948 [620]	990 [650]	1036 [679]	1084 [708]	1135 [737]	1190 [766]	1247 [795]	1308 [824]	1371 [853]	1437 [881]	1507 [910]	1579 [940]	1667 [968]	1746 [996]	1827 [1025]	1911 [1052]	1998 [1080]	2088 [1108]	2181			
2900 [1368]	573	951 [602]	992 [631]	1036 [660]	1083 [689]	1134 [718]	1187 [746]	1243 [775]	1302 [803]	1365 [831]	1430 [860]	1498 [888]	1569 [915]	1644 [945]	1732 [973]	1811 [1000]	1894 [1028]	1980 [1055]	2068 [1082]	2159 [1109]	2253			
3000 [1416]	586	997 [615]	1040 [643]	1086 [672]	1135 [700]	1187 [728]	1242 [756]	1300 [784]	1361 [812]	1425 [839]	1492 [867]	1563 [894]	1636 [923]	1720 [950]	1798 [977]	1879 [1004]	1963 [1031]	2050 [1058]	2140 [1084]	2233 [1111]	2328			
3200 [1510]	615	1101 [642]	1147 [669]	1197 [697]	1250 [724]	1305 [751]	1364 [777]	1426 [804]	1491 [831]	1558 [857]	1629 [884]	1703 [910]	1780 [936]	1857 [962]	1939 [988]	2022 [1013]	2109 [1039]	2199 [1064]	2291 [1090]	2387 [1115]	2485			
3300 [1557]	630	1158 [657]	1207 [683]	1258 [710]	1313 [736]	1370 [763]	1431 [789]	1495 [815]	1561 [841]	1631 [867]	1703 [893]	1779 [919]	1858 [943]	1930 [968]	2012 [993]	2098 [1018]	2186 [1043]	2277 [1068]	2371 [1093]	2468 [1117]	2567			
3400 [1604]	646	1220 [672]	1270 [698]	1324 [724]	1380 [750]	1439 [776]	1502 [801]	1567 [827]	1636 [852]	1707 [878]	1781 [903]	1859 [925]	1924 [950]	2005 [975]	2089 [999]	2175 [1024]	2265 [1048]	2357 [1072]	2453 [1096]	2551 [1120]	2652			
3500 [1652]	662	1285 [688]	1337 [713]	1393 [739]	1451 [764]	1512 [789]	1576 [814]	1644 [839]	1714 [864]	1787 [889]	1863 [914]	1943 [933]	2000 [958]	2082 [982]	2167 [1006]	2255 [1029]	2346 [1053]	2440 [1077]	2537 [1100]	2636 [1124]	2739			
3600 [1699]	679	1355 [704]	1409 [729]	1466 [754]	1526 [779]	1589 [804]	1655 [828]	1724 [853]	1796 [877]	1871 [901]	1949 [918]	1998 [942]	2078 [966]	2162 [989]	2249 [1012]	2338 [1035]	2430 [1058]	2525 [1081]	2623 [1104]	2724 [1127]	2828			

NOTE: L-Drive left of bold line, M-Drive right of bold line, N-Drive right of double line.

Drive Package	L						M						N					
Motor H.P. [W]	2 [1491.4]						2 [1491.4]						3 [2237.1]					
Blower Sheave	BK110H						BK90H						BK65H					
Motor Sheave	1VP-44						1VP-44						1VP-44					
Turns Open	1	2	3	4	5	6	1	2	3	4	5	6	1	2	3	4	5	6
RPM	708	676	646	612	580	548	868	830	794	752	713	673	1192	1134	1085	1031	979	919

NOTES: 1. Factory sheave settings are shown in bold type.

2. Do not set motor sheave below minimum or maximum turns open shown.

3. Re-adjustment of sheave required to achieve rated airflow at AHRI minimum External Static Pressure.

4. Drive data shown is for airflow with dry coil. Add component resistance (below) to duct resistance to determine total External Static Pressure.

## [ ] Designates Metric Conversions





# AIRFLOW PERFORMANCE—7.5 TON [26.4 kW]—60 Hz—SIDEFLOW (Cont.)

Airflow CFM [L/s]	Airflow Correction Factors*			Component Airflow Resistance					
	Total MBH	Sensible MBH	Power kW	Wet Coil	Downflow	Resistance — Inches of Water [kPa]			Concentric Grill RXRN-FA65 or RXRN-FA75 & Transition RXMC-CC04
						Downflow Economizer RA Damper Open	Horizontal Economizer RA Damper Open		
2400 [1133]	0.97	0.87	0.98	0.09 [.02]	0.08 [.02]	0.10 [.02]	0.10 [.02]	0.13 [.03]	
2500 [1180]	0.97	0.90	0.98	0.10 [.02]	0.08 [.02]	0.10 [.02]	0.10 [.02]	0.15 [.04]	
2600 [1227]	0.98	0.92	0.99	0.10 [.02]	0.09 [.02]	0.11 [.03]	0.11 [.03]	0.17 [.04]	
2700 [1274]	0.98	0.94	0.99	0.11 [.03]	0.09 [.02]	0.11 [.03]	0.11 [.03]	0.19 [.05]	
2800 [1321]	0.99	0.97	0.99	0.11 [.03]	0.10 [.02]	0.12 [.03]	0.12 [.03]	0.21 [.05]	
2900 [1368]	1.00	0.99	1.00	0.12 [.03]	0.10 [.02]	0.12 [.03]	0.12 [.03]	0.23 [.06]	
3000 [1416]	1.00	1.02	1.00	0.12 [.03]	0.11 [.03]	0.13 [.03]	0.13 [.03]	0.25 [.06]	
3100 [1463]	1.01	1.04	1.00	0.13 [.03]	0.11 [.03]	0.13 [.03]	0.13 [.03]	0.28 [.07]	
3200 [1510]	1.02	1.06	1.01	0.13 [.03]	0.11 [.03]	0.14 [.03]	0.14 [.03]	0.31 [.08]	
3300 [1557]	1.02	1.06	1.01	0.13 [.03]	0.11 [.03]	0.14 [.03]	0.14 [.03]	0.34 [.08]	
3400 [1604]	1.02	1.06	1.01	0.13 [.03]	0.11 [.03]	0.15 [.04]	0.15 [.04]	0.37 [.09]	
3500 [1652]	1.02	1.06	1.01	0.14 [.03]	0.11 [.03]	0.15 [.04]	0.15 [.04]	0.40 [.10]	
3600 [1699]	1.02	1.06	1.01	0.14 [.03]	0.11 [.03]	0.15 [.04]	0.15 [.04]	0.44 [.11]	

\*Multiply correction factor times gross performance data—resulting sensible capacity cannot exceed total capacity.

[ ] Designates Metric Conversions





# AIRFLOW PERFORMANCE—10 TON [35.1 kW]—60 Hz—SIDEFLOW

Air Flow CFM [L/s]	Model RLRL-C120 Voltage 208/230, 460, 575 — 3 Phase 60 Hz																							
	External Static Pressure—Inches of Water [kPa]																							
	0.1 [0.02]	0.2 [0.05]	0.3 [0.07]	0.4 [0.10]	0.5 [0.12]	0.6 [0.15]	0.7 [0.17]	0.8 [0.20]	0.9 [0.22]	1.0 [0.25]	1.1 [0.27]	1.2 [0.30]	1.3 [0.32]	1.4 [0.35]	1.5 [0.37]	1.6 [0.40]	1.7 [0.42]	1.8 [0.45]	1.9 [0.47]	2.0 [0.50]				
3200 [1510]	—	—	691 [1029]	721 [1101]	752 [1173]	781 [1246]	810 [1320]	838 [1394]	866 [1469]	893 [1544]	920 [1620]	946 [1697]	971 [1774]	995 [1852]	1019 [1930]	1043 [2009]	1065 [2089]	1087 [2169]	1109 [2250]	1130 [2332]				
3300 [1557]	—	672 [1014]	703 [1087]	734 [1161]	764 [1236]	793 [1312]	822 [1388]	850 [1465]	877 [1542]	904 [1620]	930 [1698]	955 [1777]	980 [1857]	1004 [1937]	1028 [2018]	1051 [2100]	1073 [2182]	1095 [2264]	1116 [2348]	1136 [2431]				
3400 [1604]	—	686 [1074]	717 [1150]	747 [1227]	776 [1304]	805 [1382]	833 [1461]	861 [1540]	888 [1620]	914 [1700]	940 [1781]	965 [1862]	990 [1945]	1013 [2027]	1037 [2111]	1059 [2195]	1081 [2279]	1103 [2364]	1123 [2450]	1143 [2536]				
3500 [1652]	668 [1061]	699 [1139]	730 [1218]	759 [1297]	789 [1377]	817 [1457]	845 [1538]	872 [1620]	899 [1702]	925 [1785]	950 [1869]	975 [1953]	999 [2037]	1023 [2122]	1045 [2208]	1068 [2295]	1089 [2382]	1110 [2469]	1131 [2557]	1150 [2646]				
3600 [1699]	682 [1129]	713 [1210]	743 [1291]	772 [1373]	801 [1455]	829 [1538]	857 [1621]	884 [1705]	910 [1790]	936 [1875]	961 [1961]	985 [2048]	1009 [2135]	1032 [2222]	1054 [2311]	1076 [2400]	1098 [2489]	1118 [2579]	1138 [2670]	1158 [2761]				
3700 [1746]	696 [1202]	727 [1285]	756 [1369]	785 [1453]	814 [1538]	842 [1623]	869 [1709]	895 [1796]	921 [1883]	946 [1971]	971 [2059]	995 [2148]	1019 [2237]	1041 [2328]	1063 [2418]	1085 [2510]	1106 [2602]	1126 [2694]	1146 [2787]	1165 [2881]				
3800 [1793]	711 [1281]	741 [1366]	770 [1452]	799 [1539]	827 [1626]	854 [1714]	881 [1802]	907 [1891]	933 [1981]	957 [2071]	982 [2162]	1005 [2253]	1028 [2345]	1051 [2438]	1073 [2531]	1094 [2625]	1114 [2719]	1134 [2814]	1154 [2910]	1172 [3006]				
3900 [1840]	725 [1364]	755 [1451]	784 [1540]	812 [1629]	840 [1719]	867 [1809]	893 [1900]	919 [1991]	944 [2083]	969 [2176]	993 [2269]	1016 [2363]	1038 [2458]	1061 [2553]	1082 [2648]	1103 [2745]	1123 [2842]	1142 [2939]	1161 [3037]	—				
4000 [1888]	740 [1452]	769 [1542]	797 [1633]	825 [1724]	853 [1817]	879 [1909]	905 [2003]	931 [2097]	956 [2191]	980 [2286]	1003 [2382]	1026 [2478]	1049 [2575]	1070 [2673]	1091 [2771]	1112 [2870]	1132 [2969]	1151 [3069]	1169 [3170]	—				
4100 [1935]	754 [1545]	783 [1637]	811 [1731]	839 [1825]	866 [1919]	892 [2015]	918 [2110]	943 [2207]	967 [2304]	991 [2402]	1014 [2500]	1037 [2599]	1059 [2698]	1080 [2798]	1101 [2899]	1121 [3000]	1140 [3102]	1159 [3204]	—	—				
4200 [1982]	769 [1643]	797 [1738]	825 [1834]	852 [1930]	879 [2027]	905 [2125]	930 [2223]	955 [2322]	979 [2422]	1003 [2522]	1025 [2622]	1048 [2724]	1069 [2826]	1090 [2928]	1111 [3031]	1130 [3135]	1149 [3239]	1168 [3344]	—	—				
4300 [2029]	784 [1746]	812 [1843]	839 [1942]	866 [2041]	892 [2140]	918 [2240]	943 [2341]	967 [2442]	991 [2544]	1014 [2647]	1037 [2750]	1059 [2854]	1080 [2958]	1100 [3063]	1120 [3169]	1140 [3275]	1158 [3382]	—	—	—				
4400 [2076]	799 [1854]	826 [1954]	854 [2055]	880 [2156]	906 [2258]	931 [2361]	956 [2464]	980 [2568]	1003 [2672]	1026 [2777]	1048 [2883]	1070 [2989]	1090 [3096]	1111 [3203]	1130 [3311]	1149 [3420]	1168 [3529]	—	—	—				
4500 [2123]	814 [1967]	841 [2069]	868 [2173]	894 [2277]	920 [2381]	944 [2486]	969 [2592]	992 [2698]	1015 [2805]	1038 [2912]	1059 [3021]	1081 [3129]	1101 [3239]	1121 [3348]	1140 [3459]	1159 [3570]	—	—	—	—				
4600 [2171]	829 [2085]	856 [2190]	882 [2296]	908 [2402]	933 [2509]	958 [2616]	982 [2725]	1005 [2833]	1028 [2943]	1050 [3053]	1071 [3163]	1092 [3274]	1112 [3386]	1131 [3499]	1150 [3612]	1169 [3725]	—	—	—	—				
4700 [2218]	844 [2208]	871 [2315]	897 [2424]	922 [2532]	947 [2642]	971 [2752]	995 [2862]	1018 [2974]	1040 [3086]	1062 [3198]	1083 [3311]	1103 [3425]	1123 [3539]	1142 [3654]	1161 [3769]	—	—	—	—	—				
4800 [2265]	860 [2336]	886 [2446]	912 [2557]	937 [2668]	961 [2780]	985 [2892]	1008 [3005]	1031 [3119]	1053 [3233]	1074 [3348]	1095 [3464]	1115 [3580]	1134 [3697]	1153 [3814]	1171 [3932]	—	—	—	—	—				

NOTE: L- Drive left of bold line, M- Drive right of bold line.

Drive Package	L					M						
Motor H.P. [W]	2 [1491.4]					3 [2237.1]						
Blower Sheave	BK90H					BK65H						
Motor Sheave	1VP-44					1VP-44						
Turns Open	1	2	3	4	5	6	1	2	3	4	5	6
RPM	857	822	785	747	706	667	1160	1117	1068	1014	960	902

NOTES: 1. Factory sheave settings are shown in bold type.

2. Do not set motor sheave below minimum or maximum turns open shown.

3. Re-adjustment of sheave required to achieve rated airflow at AHRI minimum External Static Pressure.

4. Drive data shown is for horizontal airflow with dry coil. Add component resistance (below) to duct resistance to determine total External Static Pressure.

## [ ] Designates Metric Conversions



Air

Airflow Performance  
RLRL-C/H Series



INTEGRATED AIR & WATER



# AIRFLOW PERFORMANCE—10 TON [35.1 kW]—60 Hz—SIDEFLOW (Cont.)

Airflow CFM [L/s]	Airflow Correction Factors*				Component Airflow Resistance					
	Total MBH	Sensible MBH	Power kW	Wet Coil	Downflow	Downflow Economizer RA Damper Open	Horizontal Economizer RA Damper Open	Concentric Grill RXRN-FA665 or RXRN-FA75 & Transition RXMC-CD04	Concentric Grill RXRN-AA61 or RXRN-AA71 & Transition RXMC-CE05	Concentric Grill RXRN-AA66 or RXRN-AA76 & Transition RXMC-CF06
3200 [1510]	0.96	0.87	0.98	0.06 [.01]	0.05 [.01]	0.09 [.02]	0.05 [.01]	0.31 [.08]	—	—
3300 [1557]	0.97	0.88	0.99	0.07 [.02]	0.05 [.01]	0.10 [.02]	0.05 [.01]	0.34 [.08]	—	—
3400 [1604]	0.97	0.90	0.99	0.07 [.02]	0.05 [.01]	0.10 [.02]	0.06 [.01]	0.37 [.09]	—	—
3500 [1652]	0.98	0.92	0.99	0.07 [.02]	0.06 [.01]	0.11 [.03]	0.06 [.01]	—	—	—
3600 [1699]	0.98	0.93	0.99	0.08 [.02]	0.06 [.01]	0.11 [.03]	0.06 [.01]	—	0.16 [.04]	—
3700 [1746]	0.99	0.95	1.00	0.08 [.02]	0.06 [.01]	0.12 [.03]	0.06 [.01]	—	0.18 [.04]	—
3800 [1793]	0.99	0.97	1.00	0.08 [.02]	0.07 [.02]	0.12 [.03]	0.07 [.02]	—	0.19 [.05]	—
3900 [1840]	1.00	0.99	1.00	0.08 [.02]	0.07 [.02]	0.13 [.03]	0.07 [.02]	—	0.20 [.05]	—
4000 [1888]	1.00	1.00	1.01	0.09 [.02]	0.07 [.02]	0.13 [.03]	0.07 [.02]	—	0.21 [.05]	—
4100 [1935]	1.00	1.02	1.01	0.09 [.02]	0.08 [.02]	0.14 [.03]	0.07 [.02]	—	0.23 [.06]	—
4200 [1982]	1.01	1.04	1.01	0.09 [.02]	0.08 [.02]	0.14 [.03]	0.08 [.02]	—	0.24 [.06]	—
4300 [2029]	1.01	1.06	1.01	0.10 [.02]	0.08 [.02]	0.15 [.04]	0.08 [.02]	—	0.25 [.06]	—
4400 [2076]	1.02	1.07	1.02	0.10 [.02]	0.08 [.02]	0.15 [.04]	0.08 [.02]	—	0.27 [.07]	—
4500 [2123]	1.02	1.09	1.02	0.10 [.02]	0.09 [.02]	0.16 [.04]	0.09 [.02]	—	—	—
4600 [2171]	1.03	1.11	1.02	0.10 [.02]	0.09 [.02]	0.16 [.04]	0.09 [.02]	—	—	0.30 [.07]
4700 [2218]	1.03	1.12	1.03	0.11 [.03]	0.09 [.02]	0.17 [.04]	0.09 [.02]	—	—	0.31 [.08]
4800 [2265]	1.04	1.14	1.03	0.11 [.03]	0.10 [.02]	0.17 [.04]	0.10 [.02]	—	—	0.32 [.08]

\*Multiply correction factor times gross performance data—resulting sensible capacity cannot exceed total capacity.

[ ] Designates Metric Conversions



ELECTRICAL DATA – RLRL- SERIES										
		C090CL H090CR	C090CM H090CS	C090CN H090CT	C090DL H090DR	C090DM H090DS	C090DN H090DT	C090YL	C090YM	C090YN
Unit Information	Unit Operating Voltage Range	187-253	187-253	187-253	414-506	414-506	414-506	518-632	518-632	518-632
	Volts	208/230	208/230	208/230	460	460	460	575	575	575
	Minimum Circuit Ampacity	44/44	44/44	49/49	21	21	24	16	16	21
	Minimum Overcurrent Protection Device Size	50/50	50/50	60/60	25	25	30	20	20	25
	Maximum Overcurrent Protection Device Size	50/50	50/50	60/60	25	25	30	20	20	25
Compressor Motor	No.	2	2	2	2	2	2	2	2	2
	Volts	200/240	200/240	200/240	480	480	480	600	600	600
	Phase	3	3	3	3	3	3	3	3	3
	RPM	3450	3450	3450	3450	3450	3450	3450	3450	3450
	HP, Compressor 1	3 1/4	3 1/4	3 1/4	3 1/4	3 1/4	3 1/4	3 1/4	3 1/4	3 1/4
	Amps (RLA), Comp. 1	13.6/13.6	13.6/13.6	13.6/13.6	6.1	6.1	6.1	4.2	4.2	4.2
	Amps (LRA), Comp. 1	83.1/83.1	83.1/83.1	83.1/83.1	41	41	41	33	33	33
	HP, Compressor 2	3 1/4	3 1/4	3 1/4	3 1/4	3 1/4	3 1/4	3 1/4	3 1/4	3 1/4
	Amps (RLA), Comp. 2	13.6/13.6	13.6/13.6	13.6/13.6	6.1	6.1	6.1	4.2	4.2	4.2
Amps (LRA), Comp. 2	83.1/83.1	83.1/83.1	83.1/83.1	41	41	41	33	33	33	
Compressor Motor	No.	2	2	2	2	2	2	2	2	2
	Volts	208/230	208/230	208/230	460	460	460	575	575	575
	Phase	1	1	1	1	1	1	1	1	1
	HP	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3	1/3
	Amps (FLA, each)	2.4/2.4	2.4/2.4	2.4/2.4	1.4	1.4	1.4	1	1	1
	Amps (LRA, each)	4.7/4.7	4.7/4.7	4.7/4.7	2.4	2.4	2.4	1.5	1.5	1.5
Evaporator Fan	No.	1	1	1	1	1	1	1	1	1
	Volts	208/230	208/230	208/230	460	460	460	575	575	575
	Phase	3	3	3	3	3	3	3	3	3
	HP	2	2	3	2	2	3	2	2	3
	Amps (FLA, each)	8/8	8/8	13/13	4	4	7	4	4	8
	Amps (LRA, each)	56/56	56/56	74.5/74.5	28	28	38.1	19	19	20

**ELECTRICAL DATA – RLRL- SERIES**

		<b>C120CL H120CR</b>	<b>C120CM H120CS</b>	<b>C120DL H120DR</b>	<b>C120DM H120DS</b>	<b>C120YL</b>	<b>C120YM</b>
<b>Unit Information</b>	Unit Operating Voltage Range	187-253	187-253	414-506	414-506	518-632	518-632
	Volts	208/230	208/230	460	460	575	575
	Minimum Circuit Ampacity	49/49	54/54	23	26	18	23
	Minimum Overcurrent Protection Device Size	60/60	60/60	25	30	20	30
	Maximum Overcurrent Protection Device Size	60/60	60/60	25	30	20	30
<b>Compressor Motor</b>	No.	2	2	2	2	2	2
	Volts	200/240	200/240	480	480	575	575
	Phase	3	3	3	3	3	3
	RPM	3450	3450	3450	3450	3450	3450
	HP, Compressor 1	4 1/4	4 1/4	4 1/4	4 1/4	4 1/4	4 1/4
	Amps (RLA), Comp. 1	15.9/15.9	15.9/15.9	7.1	7.1	5.1	5.1
	Amps (LRA), Comp. 1	110/110	110/110	52	52	39.5	39.5
	HP, Compressor 2	4 1/4	4 1/4	4 1/4	4 1/4	4 1/4	4 1/4
	Amps (RLA), Comp. 2	15.9/15.9	15.9/15.9	7.1	7.1	5.1	5.1
	Amps (LRA), Comp. 2	110/110	110/110	52	52	39.5	39.5
<b>Compressor Motor</b>	No.	2	2	2	2	2	2
	Volts	208/230	208/230	460	460	575	575
	Phase	1	1	1	1	1	1
	HP	1/3	1/3	1/3	1/3	1/3	1/3
	Amps (FLA, each)	2.4/2.4	2.4/2.4	1.4	1.4	1	1
	Amps (LRA, each)	4.7/4.7	4.7/4.7	2.4	2.4	1.5	1.5
<b>Evaporator Fan</b>	No.	1	1	1	1	1	1
	Volts	208/230	208/230	460	460	575	575
	Phase	3	3	3	3	3	3
	HP	2	3	2	3	2	3
	Amps (FLA, each)	8/8	13/13	4	7	4	8
	Amps (LRA, each)	56/56	74.5/74.5	28	38.1	19	20

ELECTRICAL DATA – RLRL- SERIES							
		C180CL H180CR	C180CM H180CS	C180DL H180DR	C180DM H180DS	C180YL	C180YM
Unit Information	Unit Operating Voltage Range	187-253	187-253	414-506	414-506	518-632	518-632
	Volts	208/230	208/230	460	460	575	575
	Minimum Circuit Ampacity	75/75	79/79	38	40	29	30
	Minimum Overcurrent Protection Device Size	90/90	90/90	45	45	35	35
	Maximum Overcurrent Protection Device Size	100/100	100/100	50	50	35	35
Compressor Motor	No.	2	2	2	2	2	2
	Volts	200/230	200/230	460	460	575	575
	Phase	3	3	3	3	3	3
	RPM	3450	3450	3450	3450	3450	3450
	HP, Compressor 1	7 1/2	7 1/2	7 1/2	7 1/2	7 1/2	7 1/2
	Amps (RLA), Comp. 1	25/25	25/25	12.8	12.8	9.6	9.6
	Amps (LRA), Comp. 1	164/164	164/164	100	100	78	78
	HP, Compressor 2	7 1/2	7 1/2	7 1/2	7 1/2	7 1/2	7 1/2
	Amps (RLA), Comp. 2	25/25	25/25	12.8	12.8	9.6	9.6
	Amps (LRA), Comp. 2	164/164	164/164	100	100	78	78
Compressor Motor	No.	3	3	3	3	3	3
	Volts	208/230	208/230	460	460	575	575
	Phase	1	1	1	1	1	1
	HP	1/3	1/3	1/3	1/3	1/3	1/3
	Amps (FLA, each)	2.4/2.4	2.4/2.4	1.4	1.4	1	1
	Amps (LRA, each)	4.7/4.7	4.7/4.7	2.1	2.4	1.8	1.8
Evaporator Fan	No.	1	1	1	1	1	1
	Volts	208/230	208/230	460	460	575	575
	Phase	3	3	3	3	3	3
	HP	3	5	3	5	3	5
	Amps (FLA, each)	11.5/11.5	14.9/14.9	4.6	6.6	3.5	5.3
	Amps (LRA, each)	74.5/74.5	82.6/82.6	38.1	46.3	20	39.4



**ELECTRICAL DATA – RLRL- SERIES**

		<b>C240CL H240CR</b>	<b>C240CM H240CS</b>	<b>C240DL H240DR</b>	<b>C240DM H240DS</b>	<b>C240YL</b>	<b>C240YM</b>
<b>Unit Information</b>	Unit Operating Voltage Range	187-253	187-253	414-506	414-506	518-632	518-632
	Volts	208/230	208/230	460	460	575	575
	Minimum Circuit Ampacity	95/95	103/103	49	52	37	39
	Minimum Overcurrent Protection Device Size	110/110	125/125	60	60	40	45
	Maximum Overcurrent Protection Device Size	110/110	125/125	60	60	45	50
<b>Compressor Motor</b>	No.	2	2	2	2	2	2
	Volts	200/230	200/230	460	460	575	575
	Phase	3	3	3	3	3	3
	RPM	3450	3450	3450	3450	3450	3450
	HP, Compressor 1	10	10	10	10	10	10
	Amps (RLA), Comp. 1	30.1/30.1	30.1/30.1	16.7	16.7	12.2	12.2
	Amps (LRA), Comp. 1	225/225	225/225	114	114	80	80
	HP, Compressor 2	7 1/2	7 1/2	7 1/2	7 1/2	7 1/2	7 1/2
	Amps (RLA), Comp. 2	27.6/27.6	27.6/27.6	12.8	12.8	9.6	9.6
	Amps (LRA), Comp. 2	191/191	191/191	100	100	78	78
<b>Compressor Motor</b>	No.	6	6	6	6	6	6
	Volts	208/230	208/230	460	460	575	575
	Phase	1	1	1	1	1	1
	HP	1/3	1/3	1/3	1/3	1/3	1/3
	Amps (FLA, each)	2.4/2.4	2.4/2.4	1.4	1.4	1	1
	Amps (LRA, each)	4.7/4.7	4.7/4.7	2.4	2.4	1.8	1.8
<b>Evaporator Fan</b>	No.	1	1	1	1	1	1
	Volts	208/230	208/230	460	460	575	575
	Phase	3	3	3	3	3	3
	HP	5	7 1/2	5	7 1/2	5	7 1/2
	Amps (FLA, each)	14.7/14.7	23.1/23.1	6.6	9.6	5.3	7.8
	Amps (LRA, each)	82.6/82.6	136/136	46.3	67	39.4	53.8

208/240 VOLT, THREE PHASE, 60 HZ, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION													
Separate Power Supply for Both Unit and Heater Kit													
Model No. RLRL-	Single Power Supply for Both Unit and Heater Kit					Air Conditioner				Heater Kit			
	RXJJ-Heater Kit Nominal kW	No. of Sequence Steps	Rated Heater kW @ 208/240V	Heater kBTU/Hr @ 208/240V	Heater Amps @ 208/240V	Unit Min. Ckt. Ampacity @ 208/240V	Over Current Protective Device Size		Min. Ckt. Ampacity 208/240V	Max. Fuse Size 208/240V	Min. Circuit Ampacity 208/240V	Over Current Protective Device Size	
							Min./Max 208V	Min./Max. 240V				Min./Max. 208V	Min./Max. 240V
C090CL	No Heat	—	—	—	—	44/44	50/50	50/50	—	44/44	50/50	50/50	50/50
	CC10C	1	7.2/9.6	24.56/32.75	20/23.1	44/44	50/50	50/50	25/29	44/44	50/50	50/50	50/50
	CC15C	1	10.8/14.4	36.84/49.13	30/34.6	48/54	60/60	60/60	38/44	44/44	50/50	50/50	50/50
	CC20C	1	14.4/19.2	49.13/65.5	40/46.2	60/68	70/70	60/60	50/58	44/44	50/50	50/50	50/50
	CC30C	1	21.6/28.8	73.69/98.25	60/69.3	85/97	100/100	90/90	75/87	44/44	50/50	50/50	50/50
CC40C	1	28.8/38.4	98.25/131	80.1/92.4	111/126	125/125	150/150	101/116	44/44	50/50	50/50	50/50	
C120CL	No Heat	—	—	—	—	49/49	60/60	60/60	—	49/49	60/60	60/60	60/60
	CC10C	1	7.2/9.6	24.56/32.75	20/23.1	49/49	60/60	60/60	25/29	49/49	60/60	60/60	60/60
	CC15C	1	10.8/14.4	36.84/49.13	30/34.6	49/54	60/60	60/60	38/44	49/49	60/60	60/60	60/60
	CC20C	1	14.4/19.2	49.13/65.5	40/46.2	60/68	70/70	60/60	50/58	49/49	60/60	60/60	60/60
	CC30C	1	21.6/28.8	73.69/98.25	60/69.3	85/97	100/100	90/90	75/87	49/49	60/60	60/60	60/60
CC40C	1	28.8/38.4	98.25/131	80.1/92.4	111/126	125/125	150/150	101/116	49/49	60/60	60/60	60/60	
CC50C	1	36.1/48	123.16/163.75	100.1/115.5	136/155	150/150	175/175	126/145	49/49	60/60	60/60	60/60	
C090CM	No Heat	—	—	—	—	44/44	50/50	50/50	—	44/44	50/50	50/50	50/50
	CC10C	1	7.2/9.6	24.56/32.75	20/23.1	44/44	50/50	50/50	25/29	44/44	50/50	50/50	50/50
	CC15C	1	10.8/14.4	36.84/49.13	30/34.6	48/54	60/60	60/60	38/44	44/44	50/50	50/50	50/50
	CC20C	1	14.4/19.2	49.13/65.5	40/46.2	60/68	70/70	60/60	50/58	44/44	50/50	50/50	50/50
	CC30C	1	21.6/28.8	73.69/98.25	60/69.3	85/97	100/100	90/90	75/87	44/44	50/50	50/50	50/50
CC40C	1	28.8/38.4	98.25/131	80.1/92.4	111/126	125/125	150/150	101/116	44/44	50/50	50/50	50/50	
C120CM	No Heat	—	—	—	—	54/54	60/60	60/60	—	54/54	60/60	60/60	60/60
	CC10C	1	7.2/9.6	24.56/32.75	20/23.1	54/54	60/60	60/60	25/29	54/54	60/60	60/60	60/60
	CC15C	1	10.8/14.4	36.84/49.13	30/34.6	54/60	60/60	60/60	38/44	54/54	60/60	60/60	60/60
	CC20C	1	14.4/19.2	49.13/65.5	40/46.2	67/75	80/80	80/80	50/58	54/54	60/60	60/60	60/60
	CC30C	1	21.6/28.8	73.69/98.25	60/69.3	92/103	100/100	100/100	75/87	54/54	60/60	60/60	60/60
CC40C	1	28.8/38.4	98.25/131	80.1/92.4	117/132	125/125	150/150	101/116	54/54	60/60	60/60	60/60	
CC50C	1	36.1/48	123.16/163.75	100.1/115.5	142/161	150/150	175/175	126/145	54/54	60/60	60/60	60/60	
C090CN	No Heat	—	—	—	—	49/49	60/60	60/60	—	49/49	60/60	60/60	60/60
	CC10C	1	7.2/9.6	24.56/32.75	20/23.1	49/49	60/60	60/60	25/29	49/49	60/60	60/60	60/60
	CC15C	1	10.8/14.4	36.84/49.13	30/34.6	54/60	60/60	60/60	38/44	49/49	60/60	60/60	60/60
	CC20C	1	14.4/19.2	49.13/65.5	40/46.2	67/75	80/80	80/80	50/58	49/49	60/60	60/60	60/60
	CC30C	1	21.6/28.8	73.69/98.25	60/69.3	92/103	100/100	100/100	75/87	49/49	60/60	60/60	60/60
CC40C	1	28.8/38.4	98.25/131	80.1/92.4	117/132	125/125	150/150	101/116	49/49	60/60	60/60	60/60	
CC50C	1	36.1/48	123.16/163.75	100.1/115.5	142/161	150/150	175/175	126/145	49/49	60/60	60/60	60/60	

208/240 VOLT, THREE PHASE, 60 HZ., AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION													
Single Power Supply for Both Unit and Heater Kit						Separate Power Supply for Both Unit and Heater Kit							
Model No. RLRL-	RXJJ-Heater Kit Nominal kW	No. of Sequence Steps	Rated Heater kW @ 208/240V	Heater kWh/HR @ 208/240V	Heater Amps @ 208/240V	Unit Min. Ckt. Ampacity @ 208/240V	Air Conditioner		Heater Kit			Air Conditioner	
							Min. /Max. 208V	Over Current Protective Device Size 240V	Min. Ckt. Ampacity 208/240V	Max. Fuse Size 208/240V	Min. Circuit Ampacity 208/240V	Min./Max. 208V	Over Current Protective Device Size 240V
H090CR	No Heat	—	—	—	—	44/44	50/50	—	—	—	44/44	50/50	50/50
	CC10C	1	7.2/9.6	24.56/32.75	20/23.1	44/44	50/50	25/29	25/30	44/44	44/44	50/50	50/50
	CC15C	1	10.8/14.4	36.84/49.13	30/34.6	48/54	60/60	38/44	40/45	44/44	44/44	50/50	50/50
	CC20C	1	14.4/19.2	49.13/65.5	40/46.2	60/68	70/70	50/58	50/60	44/44	44/44	50/50	50/50
	CC30C	1	21.6/28.8	73.69/98.25	60/69.3	85/97	100/100	75/87	80/90	44/44	44/44	50/50	50/50
CC40C	1	28.8/38.4	98.25/131	80.1/92.4	111/126	125/125	150/150	101/116	110/125	44/44	50/50	50/50	
H120CR	No Heat	—	—	—	—	49/49	60/60	—	—	—	49/49	60/60	60/60
	CC10C	1	7.2/9.6	24.56/32.75	20/23.1	49/49	60/60	25/29	25/30	49/49	49/49	60/60	60/60
	CC15C	1	10.8/14.4	36.84/49.13	30/34.6	49/54	60/60	38/44	40/45	49/49	49/49	60/60	60/60
	CC20C	1	14.4/19.2	49.13/65.5	40/46.2	60/68	70/70	50/58	50/60	49/49	49/49	60/60	60/60
	CC30C	1	21.6/28.8	73.69/98.25	60/69.3	85/97	100/100	75/87	80/90	49/49	49/49	60/60	60/60
CC40C	1	28.8/38.4	98.25/131	80.1/92.4	111/126	125/125	150/150	101/116	110/125	49/49	60/60	60/60	
CC50C	1	36.1/48	123.16/163.75	100.1/115.5	136/155	150/150	175/175	126/145	150/150	49/49	60/60	60/60	
H090CS	No Heat	—	—	—	—	44/44	50/50	—	—	—	44/44	50/50	50/50
	CC10C	1	7.2/9.6	24.56/32.75	20/23.1	44/44	50/50	25/29	25/30	44/44	44/44	50/50	50/50
	CC15C	1	10.8/14.4	36.84/49.13	30/34.6	48/54	60/60	38/44	40/45	44/44	44/44	50/50	50/50
	CC20C	1	14.4/19.2	49.13/65.5	40/46.2	60/68	70/70	50/58	50/60	44/44	44/44	50/50	50/50
	CC30C	1	21.6/28.8	73.69/98.25	60/69.3	85/97	100/100	75/87	80/90	44/44	44/44	50/50	50/50
CC40C	1	28.8/38.4	98.25/131	80.1/92.4	111/126	125/125	150/150	101/116	110/125	44/44	50/50	50/50	
H120CS	No Heat	—	—	—	—	54/54	60/60	—	—	—	54/54	60/60	60/60
	CC10C	1	7.2/9.6	24.56/32.75	20/23.1	54/54	60/60	25/29	25/30	54/54	54/54	60/60	60/60
	CC15C	1	10.8/14.4	36.84/49.13	30/34.6	54/60	60/60	38/44	40/45	54/54	54/54	60/60	60/60
	CC20C	1	14.4/19.2	49.13/65.5	40/46.2	67/75	80/80	50/58	50/60	54/54	54/54	60/60	60/60
	CC30C	1	21.6/28.8	73.69/98.25	60/69.3	92/103	110/110	75/87	80/90	54/54	54/54	60/60	60/60
CC40C	1	28.8/38.4	98.25/131	80.1/92.4	117/132	125/125	150/150	101/116	110/125	54/54	60/60	60/60	
CC50C	1	36.1/48	123.16/163.75	100.1/115.5	142/161	150/150	175/175	126/145	150/150	54/54	60/60	60/60	
H090CT	No Heat	—	—	—	—	49/49	60/60	—	—	—	49/49	60/60	60/60
	CC10C	1	7.2/9.6	24.56/32.75	20/23.1	49/49	60/60	25/29	25/30	49/49	49/49	60/60	60/60
	CC15C	1	10.8/14.4	36.84/49.13	30/34.6	54/60	60/60	38/44	40/45	49/49	49/49	60/60	60/60
	CC20C	1	14.4/19.2	49.13/65.5	40/46.2	67/75	80/80	50/58	50/60	49/49	49/49	60/60	60/60
	CC30C	1	21.6/28.8	73.69/98.25	60/69.3	92/103	100/100	75/87	80/90	49/49	49/49	60/60	60/60
CC40C	1	28.8/38.4	98.25/131	80.1/92.4	117/132	125/125	150/150	101/116	110/125	49/49	60/60	60/60	



Air

Electric Heater Kits  
RLRL-C/H Series

480 VOLT, THREE PHASE, 60 HZ. AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION															
Separate Power Supply for Both Unit and Heater Kit															
Single Power Supply for Both Unit and Heater Kit															
Model No. RLRL-	Heater Kit					Air Conditioner				Heater Kit				Air Conditioner	
	RXJ-Heater Kit Nominal kW	No. of Sequence Steps	Rated Heater kW @ 480V	Heater kBTU/Hr @ 480V	Heater Amps @ 480V	Unit Min. Ckt. Ampacity @ 480V	Over Current Protective Device Size Min./Max. 480V	Min. Ckt. Ampacity 480V	Max. Fuse Size 480V	Min. Circuit Ampacity 480V	Over Current Protective Device Size Min./Max. 480V	Min./Max. 480V	Min./Max. 480V	Min./Max. 480V	
C090DL	No Heat	—	—	—	—	21	25/25	—	—	21	25/25	—	—	—	
	CC10D	1	9.6	32.75	11.5	21	25/25	15	15	21/0	25/25	25/25	0/0	0/0	
	CC15D	1	14.4	49.13	17.3	27	30/30	22	25	21/0	25/25	25/25	0/0	0/0	
	CC20D	1	19.2	65.5	23.1	34	35/35	29	30	21/0	25/25	25/25	0/0	0/0	
	CC30D	1	28.8	98.25	34.6	49	50/50	44	45	21/0	25/25	25/25	0/0	0/0	
CC40D	1	38.4	131	46.2	63	70/70	58	60	21/0	25/25	25/25	0/0	0/0		
C120DL	No Heat	—	—	—	—	23	25/25	—	—	23	25/25	—	—	—	
	CC10D	1	9.6	32.75	11.5	23	25/25	15	15	23/0	25/25	25/25	0/0	0/0	
	CC15D	1	14.4	49.13	17.3	27	30/30	22	25	23/0	25/25	25/25	0/0	0/0	
	CC20D	1	19.2	65.5	23.1	34	35/35	29	30	23/0	25/25	25/25	0/0	0/0	
	CC30D	1	28.8	98.25	34.6	49	50/50	44	45	23/0	25/25	25/25	0/0	0/0	
CC40D	1	38.4	131	46.2	63	70/70	58	60	23/0	25/25	25/25	0/0	0/0		
CC50D	1	48	163.75	57.7	78	80/80	73	80	23/0	25/25	25/25	0/0	0/0		
C090DM	No Heat	—	—	—	—	21	25/25	—	—	21	25/25	—	—	—	
	CC10D	1	9.6	32.75	11.5	21	25/25	15	15	21/0	25/25	25/25	0/0	0/0	
	CC15D	1	14.4	49.13	17.3	27	30/30	22	25	21/0	25/25	25/25	0/0	0/0	
	CC20D	1	19.2	65.5	23.1	34	35/35	29	30	21/0	25/25	25/25	0/0	0/0	
	CC30D	1	28.8	98.25	34.6	49	50/50	44	45	21/0	25/25	25/25	0/0	0/0	
CC40D	1	38.4	131	46.2	63	70/70	58	60	21/0	25/25	25/25	0/0	0/0		
C120DM	No Heat	—	—	—	—	26	30/30	—	—	26	30/30	—	—	—	
	CC10D	1	9.6	32.75	11.5	26	30/30	15	15	26/0	30/30	30/30	0/0	0/0	
	CC15D	1	14.4	49.13	17.3	31	35/35	22	25	26/0	30/30	30/30	0/0	0/0	
	CC20D	1	19.2	65.5	23.1	38	40/40	29	30	26/0	30/30	30/30	0/0	0/0	
	CC30D	1	28.8	98.25	34.6	52	60/60	44	45	26/0	30/30	30/30	0/0	0/0	
CC40D	1	38.4	131	46.2	67	70/70	58	60	26/0	30/30	30/30	0/0	0/0		
CC50D	1	48	163.75	57.7	81	90/90	73	80	26/0	30/30	30/30	0/0	0/0		
C090DN	No Heat	—	—	—	—	24	30/30	—	—	24	30/30	—	—	—	
	CC10D	1	9.6	32.75	11.5	24	30/30	15	15	24/0	30/30	30/30	0/0	0/0	
	CC15D	1	14.4	49.13	17.3	31	35/35	22	25	24/0	30/30	30/30	0/0	0/0	
	CC20D	1	19.2	65.5	23.1	38	40/40	29	30	24/0	30/30	30/30	0/0	0/0	
	CC30D	1	28.8	98.25	34.6	52	60/60	44	45	24/0	30/30	30/30	0/0	0/0	
CC40D	1	38.4	131	46.2	67	70/70	58	60	24/0	30/30	30/30	0/0	0/0		



INTEGRATED AIR &amp; WATER

480 VOLT, THREE PHASE, 60 HZ, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION													
Separate Power Supply for Both Unit and Heater Kit													
Model No. RLRL-	Single Power Supply for Both Unit and Heater Kit					Heater Kit				Air Conditioner			
	RXJJ-Heater Kit Nominal kW	No. of Sequence Steps	Rated Heater kW @ 480V	Heater kBTU/Hr @ 480V	Heater Amps @ 480V	Unit Min. Ckt. Ampacity @ 480V	Over Current Protective Device Size Min./Max. 480V	Min. Ckt. Ampacity 480V	Max. Fuse Size 480V	Min. Circuit Ampacity 480V	Over Current Protective Device Size Min./Max. 480V	Min./Max. 480V	Min./Max. 480V
H090DR	No Heat	—	—	—	—	21	25/25	—	—	21	25/25	—	—
	CC10D	1	9.6	32.75	11.5	21	25/25	15	15	21/0	25/25	25/25	0/0
	CC15D	1	14.4	49.13	17.3	27	30/30	22	25	21/0	25/25	25/25	0/0
	CC20D	1	19.2	65.5	23.1	34	35/35	29	30	21/0	25/25	25/25	0/0
	CC30D	1	28.8	98.25	34.6	49	50/50	44	45	21/0	25/25	25/25	0/0
CC40D	1	38.4	131	46.2	63	70/70	58	60	21/0	25/25	25/25	0/0	
H120DR	No Heat	—	—	—	—	23	25/25	—	—	23	25/25	—	—
	CC10D	1	9.6	32.75	11.5	23	25/25	15	15	23/0	25/25	25/25	0/0
	CC15D	1	14.4	49.13	17.3	27	30/30	22	25	23/0	25/25	25/25	0/0
	CC20D	1	19.2	65.5	23.1	34	35/35	29	30	23/0	25/25	25/25	0/0
	CC30D	1	28.8	98.25	34.6	49	50/50	44	45	23/0	25/25	25/25	0/0
CC40D	1	38.4	131	46.2	63	70/70	58	60	23/0	25/25	25/25	0/0	
CC50D	1	48	163.75	57.7	78	80/80	73	80	23/0	25/25	25/25	0/0	
H090DS	No Heat	—	—	—	—	21	25/25	—	—	21	25/25	—	—
	CC10D	1	9.6	32.75	11.5	21	25/25	15	15	21/0	25/25	25/25	0/0
	CC15D	1	14.4	49.13	17.3	27	30/30	22	25	21/0	25/25	25/25	0/0
	CC20D	1	19.2	65.5	23.1	34	35/35	29	30	21/0	25/25	25/25	0/0
	CC30D	1	28.8	98.25	34.6	49	50/50	44	45	21/0	25/25	25/25	0/0
CC40D	1	38.4	131	46.2	63	70/70	58	60	21/0	25/25	25/25	0/0	
H120DS	No Heat	—	—	—	—	26	30/30	—	—	26	30/30	—	—
	CC10D	1	9.6	32.75	11.5	26	30/30	15	15	26/0	30/30	30/30	0/0
	CC15D	1	14.4	49.13	17.3	31	35/35	22	25	26/0	30/30	30/30	0/0
	CC20D	1	19.2	65.5	23.1	38	40/40	29	30	26/0	30/30	30/30	0/0
	CC30D	1	28.8	98.25	34.6	52	60/60	44	45	26/0	30/30	30/30	0/0
CC40D	1	38.4	131	46.2	67	70/70	58	60	26/0	30/30	30/30	0/0	
CC50D	1	48	163.75	57.7	81	90/90	73	80	26/0	30/30	30/30	0/0	
H090DT	No Heat	—	—	—	—	24	30/30	—	—	24	30/30	—	—
	CC10D	1	9.6	32.75	11.5	24	30/30	15	15	24/0	30/30	30/30	0/0
	CC15D	1	14.4	49.13	17.3	31	35/35	22	25	24/0	30/30	30/30	0/0
	CC20D	1	19.2	65.5	23.1	38	40/40	29	30	24/0	30/30	30/30	0/0
	CC30D	1	28.8	98.25	34.6	52	60/60	44	45	24/0	30/30	30/30	0/0
CC40D	1	38.4	131	46.2	67	70/70	58	60	24/0	30/30	30/30	0/0	



Air

Electric Heater Kits  
RLRL-C/H Series

## 600 VOLT, THREE PHASE, 60 HZ, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION

600 VOLT, THREE PHASE, 60 HZ, AUXILIARY ELECTRIC HEATER KITS CHARACTERISTICS AND APPLICATION												
Single Power Supply for Both Unit and Heater Kit					Separate Power Supply for Both Unit and Heater Kit							
Model No. RLRL-	Heater Kit				Air Conditioner				Heater Kit		Air Conditioner	
	RXJJ-Heater Kit Nominal kW	No. of Sequence Steps	Rated Heater kW @ 600V	Heater kBTU/Hr @ 600V	Heater Amps @ 600V	Unit Min. Ckt. Ampacity @ 600V	Over Current Protective Device Size Min./Max. 600V	Min. Ckt. Ampacity 600V	Max. Fuse Size 600V	Min. Circuit Ampacity 600V	Over Current Protective Device Size Min./Max. 600V	
C090YL	No Heat	—	—	—	—	16	20/20	—	—	16	20/20	—
	CC10Y	1	9.6	32.75	9.2	17	20/20	12	15	16/0	20/20	0/0
	CC15Y	1	14.4	49.13	13.9	23	25/25	18	20	16/0	20/20	0/0
	CC20Y	1	19.2	65.5	18.5	29	30/30	24	25	16/0	20/20	0/0
	CC30Y	1	28.8	98.25	27.7	40	40/40	35	35	16/0	20/20	0/0
CC40Y	1	38.4	131	37	52	60/60	47	50	16/0	20/20	0/0	
C120YL	No Heat	—	—	—	—	18	20/20	—	—	18	20/20	—
	CC10Y	1	9.6	32.75	9.2	18	20/20	12	15	18/0	20/20	0/0
	CC15Y	1	14.4	49.13	13.9	23	25/25	18	20	18/0	20/20	0/0
	CC20Y	1	19.2	65.5	18.5	29	30/30	24	25	18/0	20/20	0/0
	CC30Y	1	28.8	98.25	27.7	40	40/40	35	35	18/0	20/20	0/0
CC40Y	1	38.4	131	37	52	60/60	47	50	18/0	20/20	0/0	
CC50Y	1	48	163.75	46.2	63	70/70	58	60	18/0	20/20	0/0	
C090YM	No Heat	—	—	—	—	16	20/20	—	—	16	20/20	—
	CC10Y	1	9.6	32.75	9.2	17	20/20	12	15	16/0	20/20	0/0
	CC15Y	1	14.4	49.13	13.9	23	25/25	18	20	16/0	20/20	0/0
	CC20Y	1	19.2	65.5	18.5	29	30/30	24	25	16/0	20/20	0/0
	CC30Y	1	28.8	98.25	27.7	40	40/40	35	35	16/0	20/20	0/0
CC40Y	1	38.4	131	37	52	60/60	47	50	16/0	20/20	0/0	
C120YM	No Heat	—	—	—	—	23	30/30	—	—	23	30/30	—
	CC10Y	1	9.6	32.75	9.2	23	30/30	12	15	23/0	30/30	0/0
	CC15Y	1	14.4	49.13	13.9	28	30/30	18	20	23/0	30/30	0/0
	CC20Y	1	19.2	65.5	18.5	34	35/35	24	25	23/0	30/30	0/0
	CC30Y	1	28.8	98.25	27.7	45	45/45	35	35	23/0	30/30	0/0
CC40Y	1	38.4	131	37	57	60/60	47	50	23/0	30/30	0/0	
CC50Y	1	48	163.75	46.2	68	70/70	58	60	23/0	30/30	0/0	
C090YN	No Heat	—	—	—	—	21	25/25	—	—	21	25/25	—
	CC10Y	1	9.6	32.75	9.2	22	25/25	12	15	21/0	25/25	0/0
	CC15Y	1	14.4	49.13	13.9	28	30/30	18	20	21/0	25/25	0/0
	CC20Y	1	19.2	65.5	18.5	34	35/35	24	25	21/0	25/25	0/0
	CC30Y	1	28.8	98.25	27.7	45	45/45	35	35	21/0	25/25	0/0
CC40Y	1	38.4	131	37	57	60/60	47	50	21/0	25/25	0/0	





# PACKAGE AIR CONDITIONER


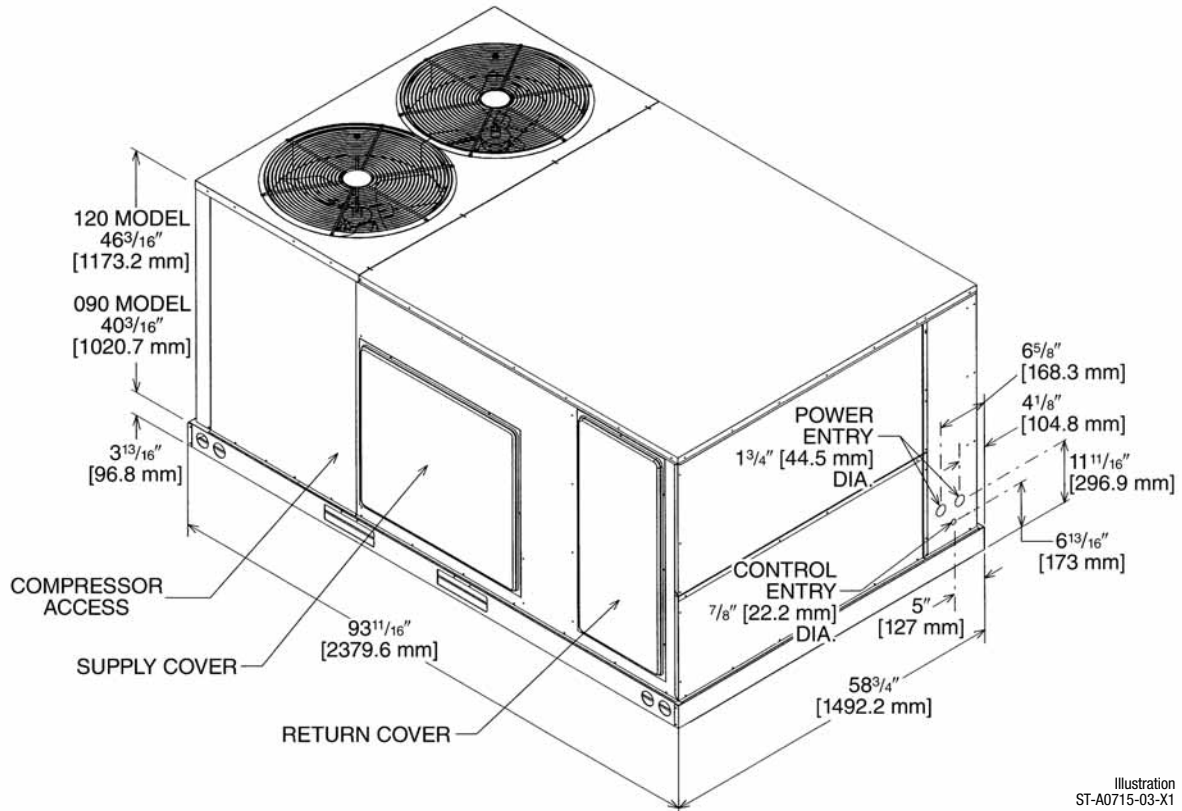


Illustration  
ST-A0715-03-X1

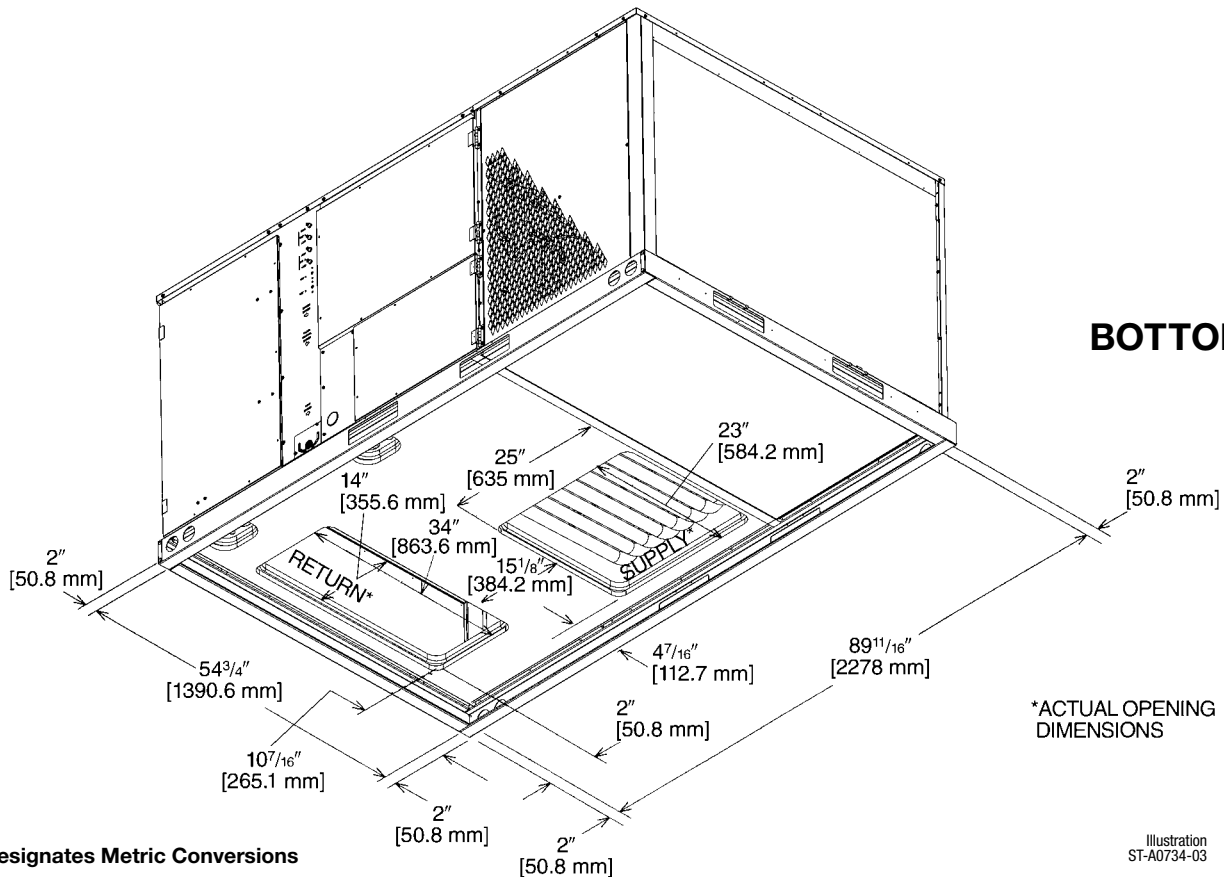


[ ] Designates Metric Conversions

Illustration  
ST-A0734-03


# PACKAGE AIR CONDITIONER

## SUPPLY AND RETURN DIMENSIONS FOR HORIZONTAL APPLICATIONS

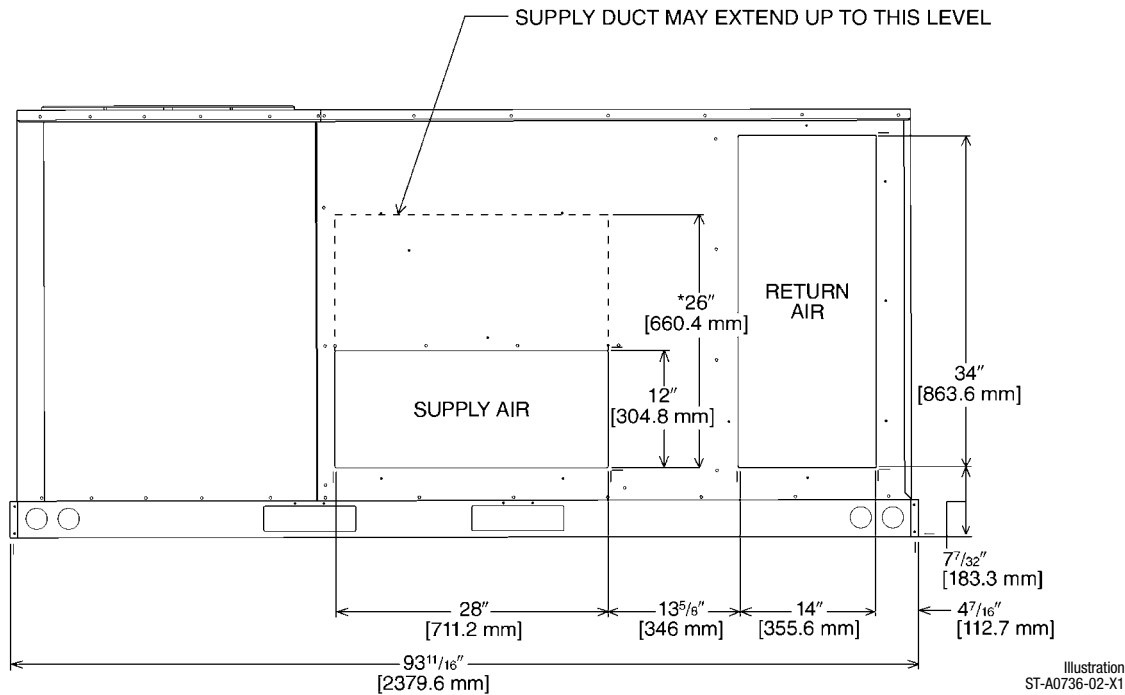


\*RECOMMENDED DUCT DIMENSIONS ARE 26"

## SUPPLY AND RETURN DIMENSIONS FOR DOWNFLOW APPLICATIONS

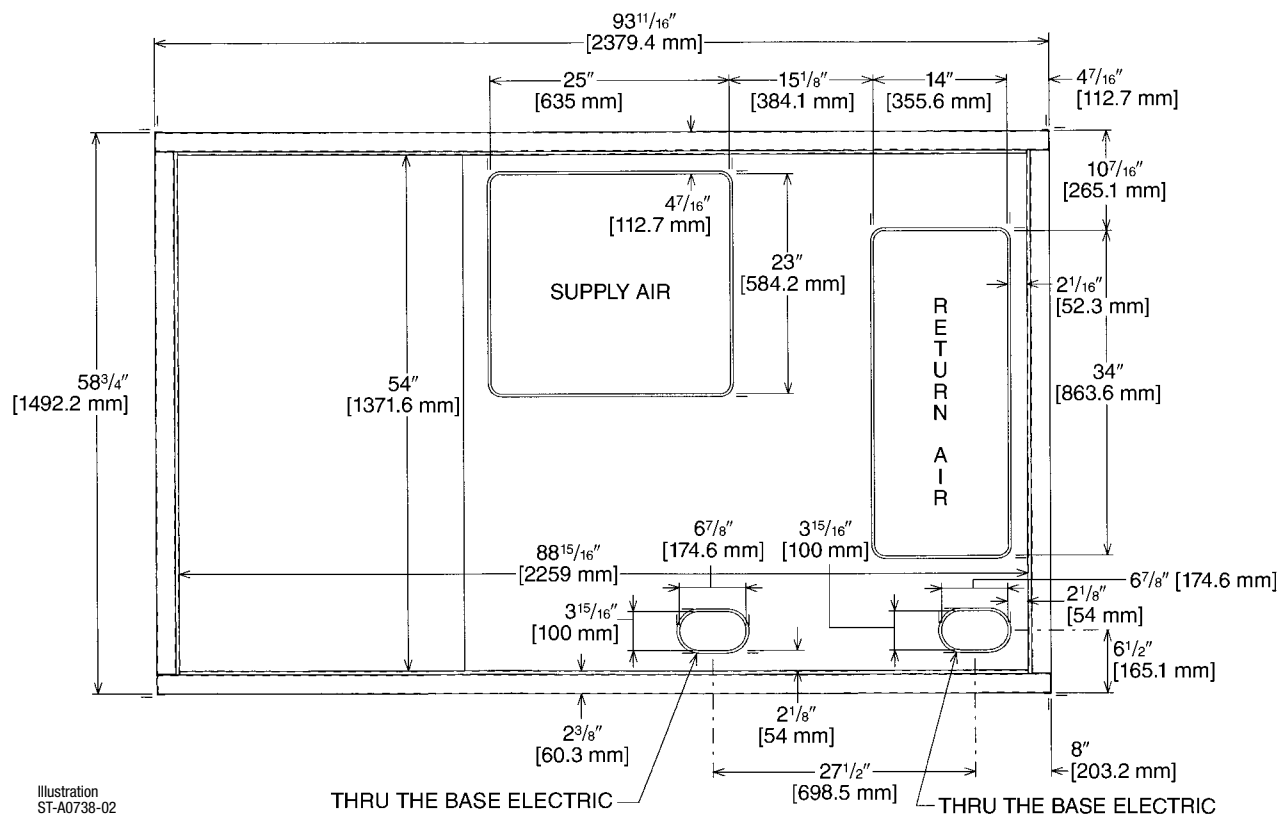

[ ] Designates Metric Conversions

# PACKAGE AIR CONDITIONER

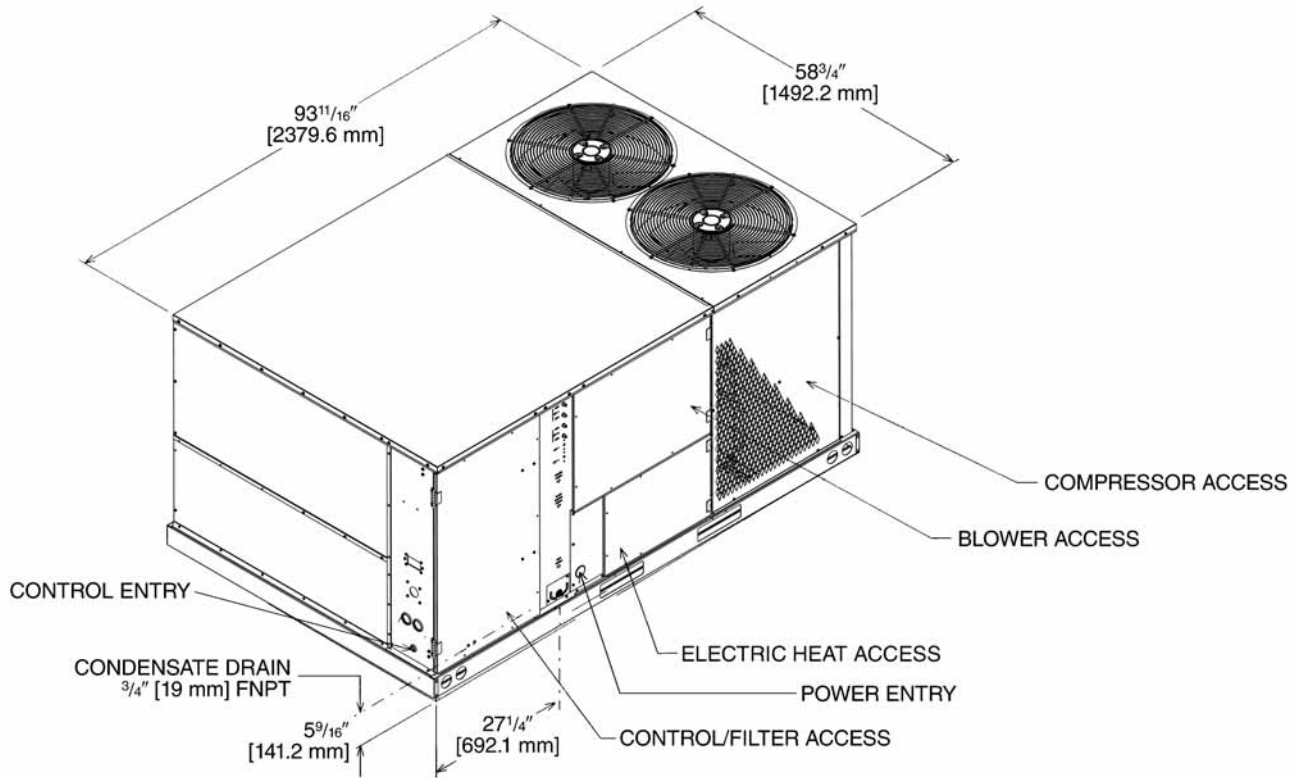

[ ] Designates Metric Conversions

## WEIGHTS

Accessory	Shipping—lbs [kg]	Operating—lbs [kg]
Economizer	90 [40.82]	81 [36.70]
Power Exhaust	44 [19.96]	42 [19.05]
Fresh Air Damper (Manual)	26 [11.79]	21 [9.53]
Fresh Air Damper (Motorized)	43 [19.50]	38 [17.24]
Roof Curb 14"	90 [40.82]	85 [38.60]
Roof Curb 24"	140 [63.50]	135 [61.23]

Capacity Tons [kW]	Corner Weights by Percentage			
	A	B	C	D
6-12.5 [21.1-44.0]	33%	27%	17%	23%


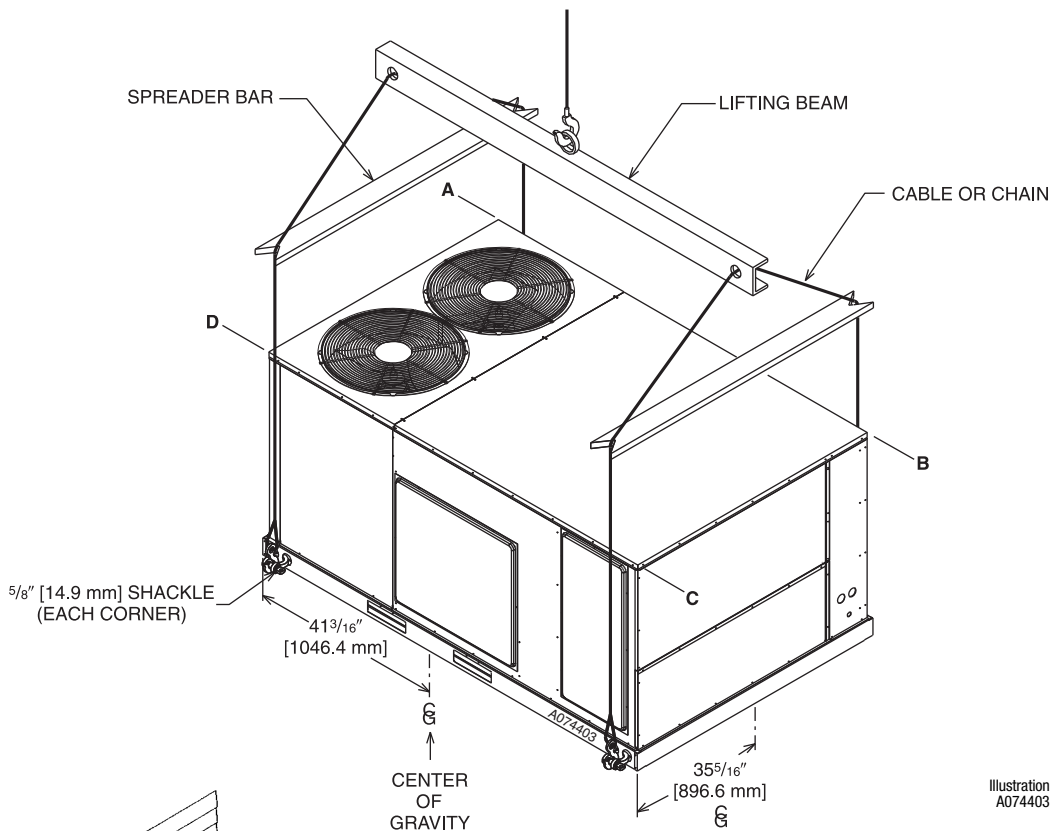


Illustration A074403

### CLEARANCES

The following minimum clearances must be observed for proper unit performance and serviceability.

Recommended Clearance In. [mm]	Location
48 [1219]	A - Front
18 [457]	B - Condenser Coil
18 [457]	C - Duct Side
18 [457]	*D - Evaporator End
60 [1524]	E - Above
*Without Economizer. 48" [1219 mm] With Economizer	

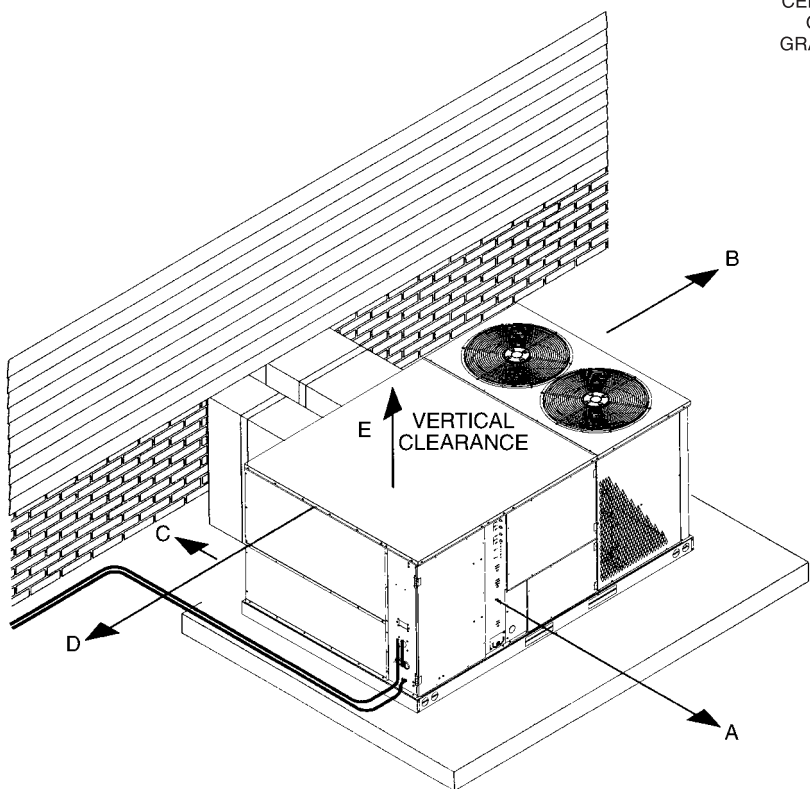

[ ] Designates Metric Conversions

## FIELD INSTALLED ACCESSORY EQUIPMENT

Accessory	Model Number	Shipping Weight Lbs. [kg]	Installed Weight Lbs. [kg]	Factory Installation Available?
Thermostats	See Thermostat Specification Sheet for Details (T11-001)			No
Electric Heaters	RXJJ-CC10 (C,D,Y)	46 [20.9]	36 [16.3]	Yes
	RXJJ-CC15 (C,D,Y)	46 [20.9]	36 [16.3]	Yes
	RXJJ-CC20 (C,D,Y)	46 [20.9]	36 [16.3]	Yes
	RXJJ-CC30 (C,D,Y)	47 [21.3]	37 [16.8]	Yes
	RXJJ-CC40 (C,D,Y)	49 [22.2]	39 [17.7]	Yes
	RXJJ-CC50 (C,D,Y)	51 [23.1]	41 [18.6]	Yes
Economizer w/Single Enthalpy	AXRD-PJCM3	90 [40.8]	81 [36.7]	Yes
Economizer w/Single Enthalpy and Smoke Dectector	AXRD-SJCM3	91 [41.3]	82 [37.2]	Yes
Dual Enthalpy Kit	RXR-AR03	1 [0.5]	1 [0.5]	No
Horizontal Economizer w/Single Enthalpy	AXRD-RJCM3	94 [42.6]	89 [40.4]	No
Carbon Dioxide Sensor	RXR-AR02	3 [1.4]	2 [1.0]	No
Power Exhaust	RXR-BFF02 (C,D,Y)	43 [19.5]	38 [17.2]	No
Manual Fresh Air (Left Panel Mounted)	AXRF-KDA1	38 [17.2]	31 [14.0]	No
Manual Fresh Air (Return Panel)	AXRF-JDA1	26 [11.8]	21 [9.5]	No
Motorized Fresh Air (Return Panel)	AXRF-JDB1	43 [19.5]	21 [9.5]	No
Motor Kit for RXRF-KDA1 (Left Panel Mounted)	RXR-AW02	35 [15.19]	27 [17.7]	No
Modulating Motor Kit w/position feedback for RXRF-KDA1	RXR-AW04	38 [17.2]	30 [13.6]	No
Roofcurb, 14"	RXKG-CAE14	90 [40.8]	85 [38.5]	No
Roofcurb, 24"	RXKG-CAE24	140 [63.5]	135 [61.2]	No
Roofcurb Adapters	RXR-CDCE50	300 [136.1]	290 [131.5]	No
	RXR-CFCE54	325 [147.4]	315 [142.9]	No
	RXR-CFCE56	350 [158.8]	340 [154.2]	No
	RXR-CGCC12	450 [204.1]	410 [186.0]	No
Concentric Diffuser (Step-Down, 18 x 28)	RXR-AA61	200 [90.7]	185 [83.9]	No
Concentric Diffuser (Step-Down, 18 x 32)	RXR-AA66	247 [112.0]	227 [103.0]	No
Concentric Diffuser (Flush, 18 x 28)	RXR-AA71	170 [77.1]	155 [70.3]	No
Concentric Diffuser (Flush, 18 x 32)	RXR-AA76	176 [79.8]	161 [73.0]	No
Downflow Adapters (Rect. to Round)	RXMC-CD04	15 [6.8]	13 [5.9]	No
Downflow Adapters (Rect. to Rect., 18 x 28)	RXMC-CE05 ①	18 [8.2]	16 [7.3]	No
Downflow Adapters (Rect. to Rect., 18 x 32)	RXMC-CF06 ②	20 [9.1]	18 [8.2]	No
Low-Ambient Control Kit (1 Per Compressor)	RXRZ-C02	3 [1.4]	2 [1.0]	Yes
Outdoor Louver Kit	AXRX-AAD02A (7.5 Ton)	29 [13.1]	26 [11.8]	Yes
Outdoor Louver Kit	AXRX-AAD03A (10 Ton)	32 [14.5]	28 [12.7]	Yes
Unwired Convenience Outlet	RXR-AN01	2 [1.0]	1.5 [0.7]	Yes
Comfort Alert (1 per compressor)	RXR-AZ01	3 [1.4]	2 [0.9]	Yes
BACnet Communication Card	RXR-AY01	1 [0.5]	1 [0.5]	No
LonWorks Communication Card	RXR-AY02	1 [0.5]	1 [0.5]	No

NOTES: ① Used with RXRN-AA61 and RXRN-AA71 concentric diffusers.

② Used with RXRN-AA66 and RXRN-AA76 concentric diffusers.

[ ] Designates Metric Conversions

# THERMOSTAT



**200-Series \***  
Programmable



**300-Series \***  
Deluxe  
Programmable

**400-Series \***  
Special Applications/  
Programmable



**500-Series \***  
Communicating/  
Programmable

Brand	Descriptor (3 Characters)	Series (3 Characters)	System (2 Characters)	Type (2 Characters)
<b>RHC</b>	<b>-</b>	<b>213</b>	<b>UN</b>	<b>MS</b>
RHC=Rheem	TST=Thermostat	200=Programmable 300=Deluxe Programmable 400=Special Applications/ Programmable 500=Communicating/ Programmable	GE=Gas/Electric UN=Universal (AC/HP/GE) MD=Modulating Furnace DF=Dual Fuel CM=Communicating	SS=Single-Stage MS=Multi-Stage

\* Photos are representative. Actual models may vary.

For detailed thermostat match-up information,  
see specification sheet form number T11-001.



## FLUSH MOUNT ROOM TEMPERATURE SENSORS FOR NETWORKED DDC APPLICATIONS



**ROOM TEMPERATURE SENSOR ZNS-101**  
with **TIMED OVERRIDE BUTTON**

10kΩ room temperature sensor transmits room temperature to DDC system. Timed override button allows tenant to change from unoccupied temperature setpoint to occupied temperature setpoint for a preset time.



**ROOM TEMPERATURE SENSOR ZNS-102**  
with **TIMED OVERRIDE BUTTON and STATUS INDICATOR**

10kΩ room temperature sensor transmits room temperature to DDC system. Timed override button allows tenant to change from unoccupied temperature setpoint to occupied temperature setpoint for a preset time. Status Indicator Light transmits ALARM flash code to occupied space.



**ROOM TEMPERATURE SENSOR ZNS-103**  
with **SETPOINT ADJUSTMENT and TIMED OVERRIDE BUTTON**

10kΩ room temperature sensor with setpoint adjustment transmits room temperature to DDC system along with desired occupied room temperature setpoint. Timed override button allows tenant to change from unoccupied temperature setpoint to occupied temperature setpoint for a preset time.


## COMMUNICATION CARDS

### Field Installed



**BACnet® COMMUNICATION CARD RXRX-AY01**

The field installed BACnet® Communication Card allows the RTU-C unit controller to communicate with a third party building management system that supports the BACnet Application Specific Controller device profile. The BACnet® Communication Module plugs onto the unit RTU-C controller and allows communication between the RTU-C and the BACnet MSTP network.



**LonWorks® COMMUNICATION CARD RXRX-AY02**

The field installed LonWorks® Communication Card allows the RTU-C unit controller to communicate with a third party building management system that supports the LonMark Space Comfort Controller (SCC) functional profile or LonMark Discharge Air Controller (DAC) functional profile. The LonMark Communication Module plugs onto the RTU-C controller and allows communication between the RTU-C and a LonWorks Network.

## ECONOMIZER FOR DOWNFLOW DUCT INSTALLATION



### Use to Select Factory Installed Options Only

**AXRD-PJCM3—Single Enthalpy (Outdoor) and AXRD-SJCM3 Single Enthalpy with Smoke Detector**

**RXXR-AV03—Dual Enthalpy Upgrade Kit**

**RXXR-AR02—Optional Wall-Mounted CO<sub>2</sub> Sensor**

- Features **Honeywell** Controls
- Available Factory Installed or Field Accessory
- Gear Driven Direct Drive Actuator
- Fully Modulating (0-100%)
- Low Leakage Dampers
- Slip-In Design for Easy Installation
- Plug-In Polarized 12-pin and 4-pin Electrical Connections
- Pre-Configured—No Field Adjustments Necessary
- Standard Barometric Relief Damper
- Single Enthalpy with Dual Enthalpy Upgrade Kit Available
- CO<sub>2</sub> Input Sensor Available
- Field Assembled Hood Ships with Economizer
- Economizer Ships Complete for Downflow Duct Application.
- Optional Remote Minimum Position Potentiometer (270 ohm) (Honeywell #S963B1136) is Available from Prostock.
- Field Installed Power Exhaust Available
- Prewired for Smoke Detector
- If connected to a Building Automation System (BAS), all economizer functions can be viewed on the (BAS) or 16 x 2 LCD screen
- If connected to thermostat, all economizer functions can be viewed on 16 x 2 LCD screen

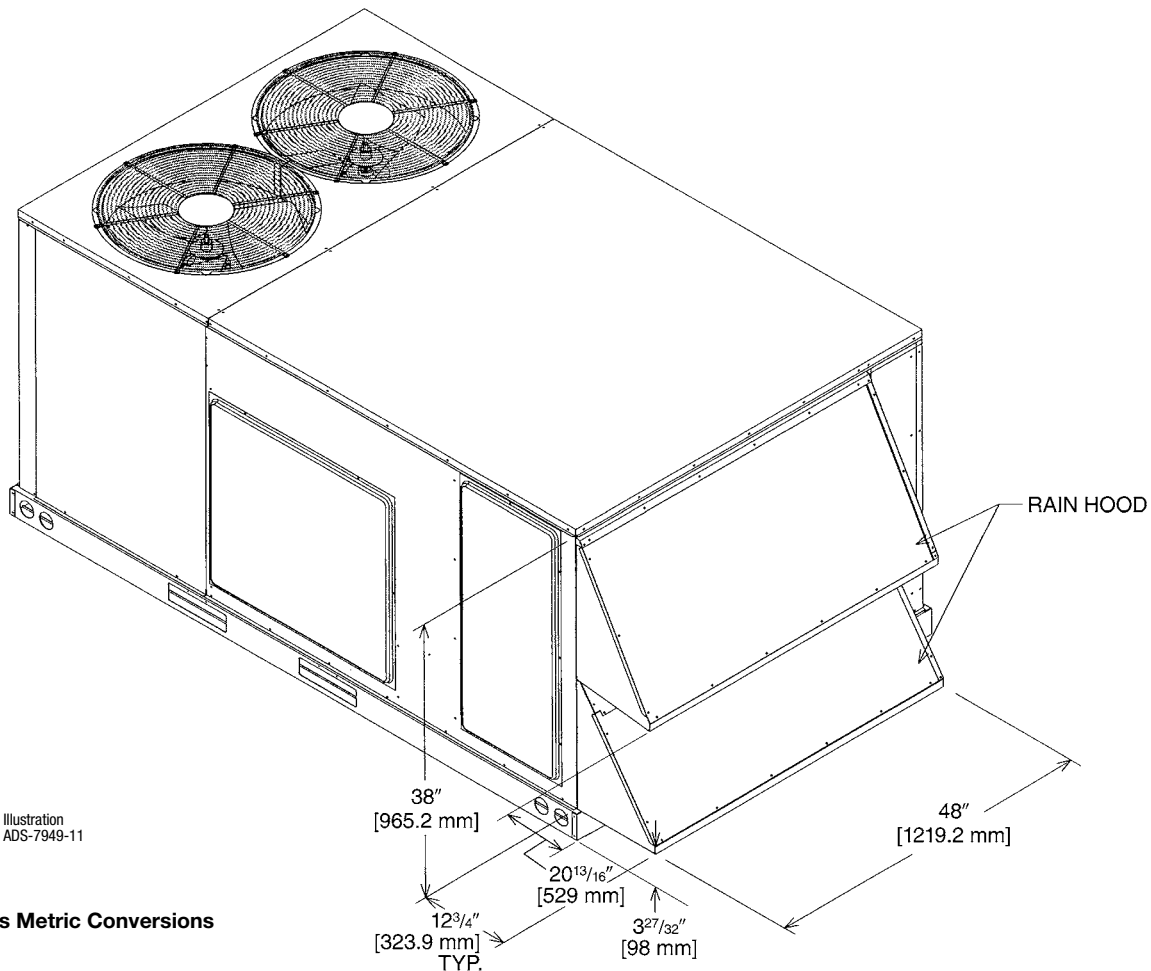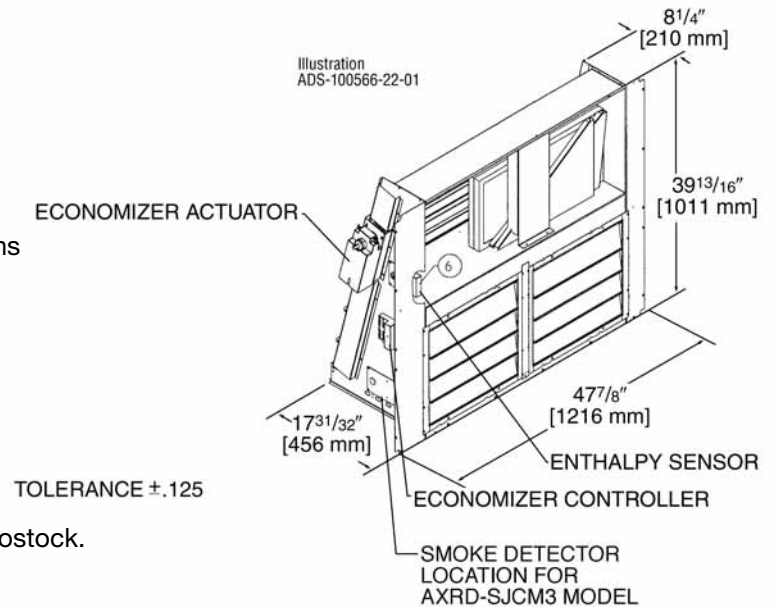


[ ] Designates Metric Conversions

# ECONOMIZER FOR HORIZONTAL DUCT INSTALLATION


## Field Installed Only

- AXRD-RJCM3—Single Enthalpy (Outdoor)**
- RXXR-AV03—Dual Enthalpy Upgrade Kit**
- RXXR-AR02—Wall-mounted CO<sub>2</sub> Sensor**

- Features **Honeywell Controls**
- Available as a Field Installed Accessory Only
- Gear Driven Direct Drive Actuator
- Fully Modulating (0-100%)
- Low Leakage Dampers
- Slip-In Design for Easy Installation
- Plug-In Polarized 12-pin and 4-pin Electrical Connections
- Pre-Configured—No Field Adjustments Necessary
- Standard Barometric Relief Damper
- Single Enthalpy with Dual Enthalpy Upgrade Kit Available
- CO<sub>2</sub> Input Sensor Available
- Field Assembled Hood Ships with Economizer
- Economizer Ships Complete for Horizontal Duct Application
- Optional Remote Minimum Position Potentiometer (270 ohm) (Honeywell #S963B1136) is Available from Prostock
- Field Installed Power Exhaust Available
- If connected to a Building Automation System (BAS), all economizer functions can be viewed on the (BAS) or 16 x 2 LCD screen
- If connected to thermostat, all economizer functions can be viewed on 16 x 2 LCD screen

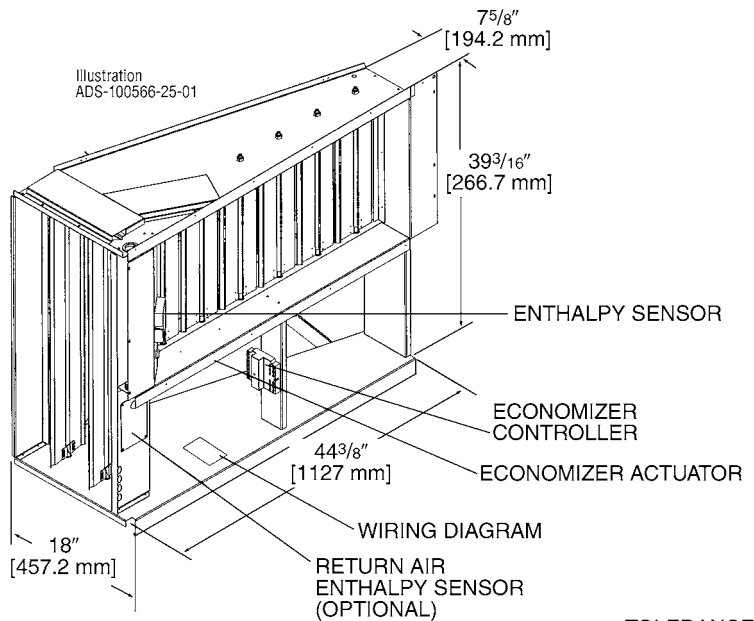

TOLERANCE ± .125

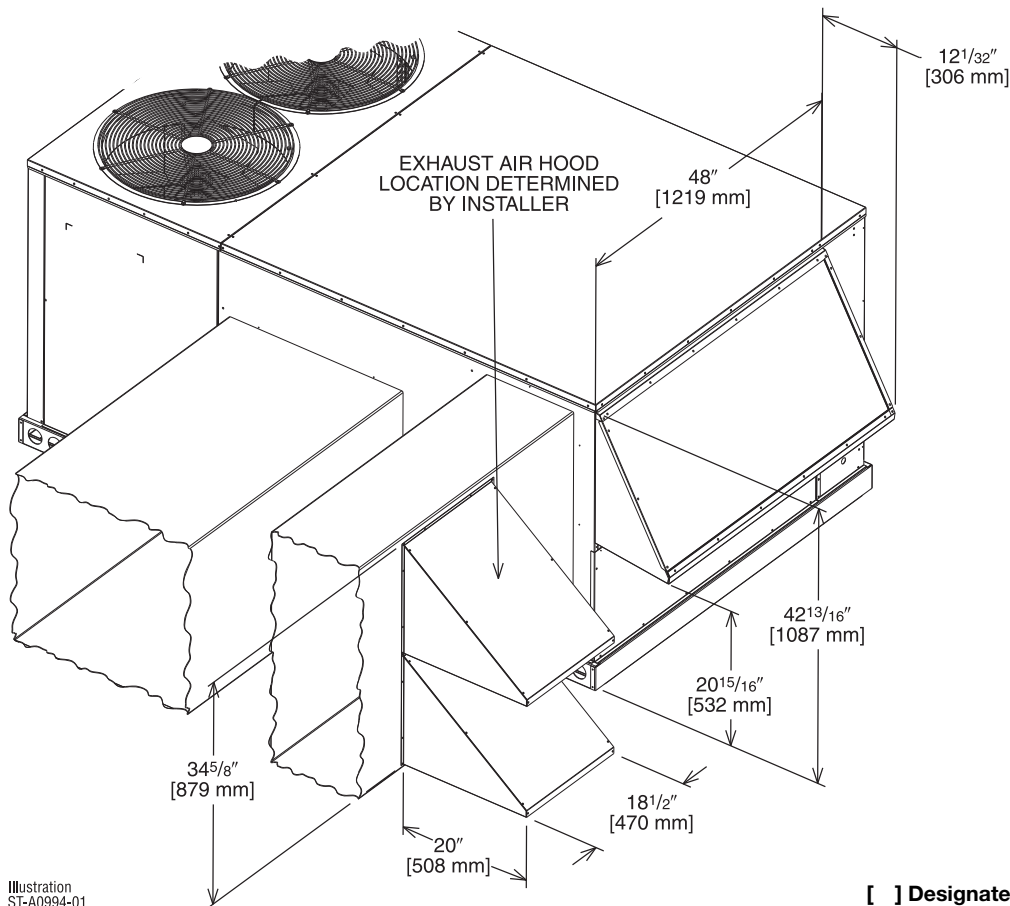


[ ] Designates Metric Conversions

# POWER EXHAUST KIT FOR AXRD-PJCM3(-), AXRD-RJCM3(-), AXRD-SJCM3 ECONOMIZERS


RXRX-BFF02 (C, D, or Y\*)

\*Voltage Code

## VERTICAL AIRFLOW

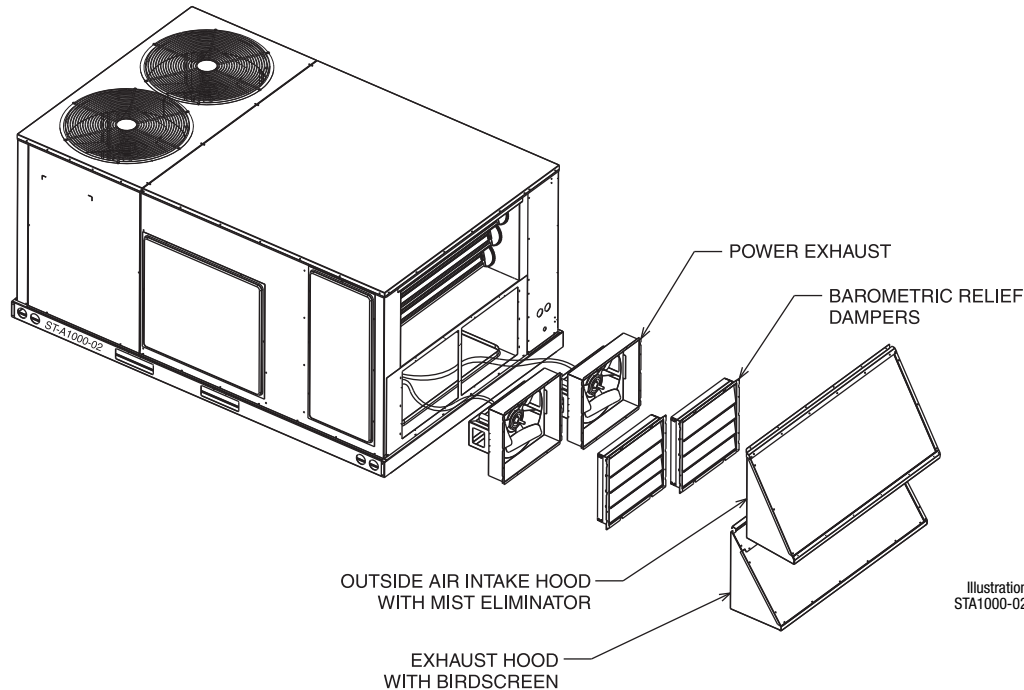

## HORIZONTAL AIRFLOW

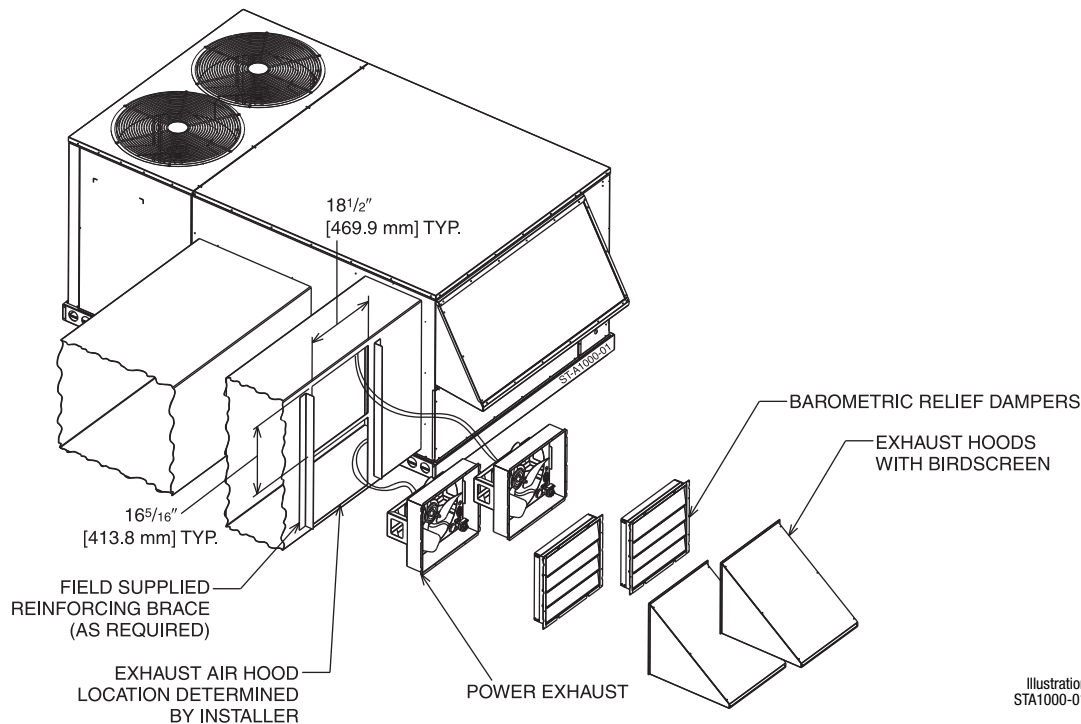

Model No.	No. of Fans	Volts	Phase	HP (ea.)	Low Speed		High Speed ①		FLA (ea.)	LRA (ea.)
					CFM [L/s] ②	RPM	CFM [L/s] ②	RPM		
RXRX-BFF02C	2	208-230	1	0.33	2200 [1038]	1518	2500 [1179]	1670	1.48	3.6
RXRX-BFF02D	2	460	1	0.33	2200 [1038]	1518	2500 [1179]	1670	0.75	1.8
RXRX-BFF02Y	2	575	1	0.33	2200 [1038]	1518	2500 [1179]	1670	0.81	1.5

NOTES: ① Power exhaust is factory set on high speed motor tap.  
② CFM is per fan at 0" w.c. external static pressure.

[ ] Designates Metric Conversions

## FRESH AIR DAMPER

**MOTORIZED DAMPER KIT  
RXRX-AW02  
(Motor Kit for AXRF-KDA1)**

**RXRX-AW04  
(Modulating Motor Kit with position feedback for AXRF-KDA1)**

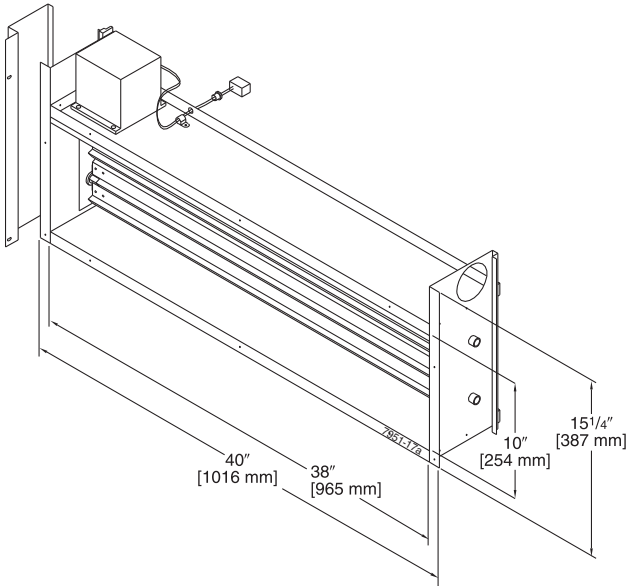


Illustration  
ST-7951-17

**AXRF-KDA1 (Manual)  
DOWNFLOW OR  
HORIZONTAL APPLICATION**

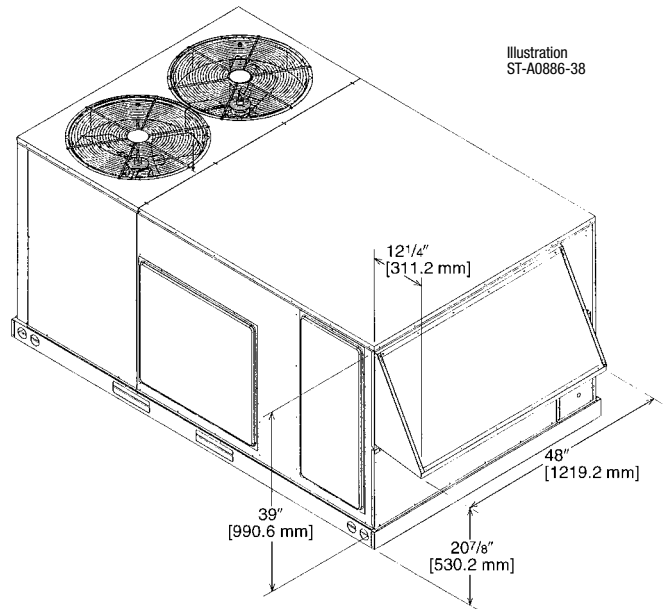


Illustration  
ST-A0886-38

**MOTORIZED DAMPER KIT  
RXRX-AW02  
(Motor Kit for AXRF-KDA1)**

**RXRX-AW04  
(Modulating Motor Kit w/position feedback for AXRF-KDA1)**


- Features **Honeywell** Controls
- Gear Driven Direct Drive Actuator
- Fully Modulating (0-100%)
- Low Leakage Dampers
- Slip-In Design for Easy Installation
- Plug-In Polarized 12-pin and 4-pin Electrical Connections
- Pre-Configured—No Field Adjustments Necessary
- Addition of Dual Enthalpy Upgrade Kit allows limited economizer function
- CO<sub>2</sub> Sensor Input Available for Demand Control Ventilation (DCV)
- Optional Remote Minimum Position Potentiometer (270 ohm) (Honeywell #S963B1136) is available from Prostock
- All fresh air damper functions can be viewed at the RTU-C unit controller display
- If connected to a Building Automation System (BAS), all fresh air damper functions can be viewed on the (BAS)

[ ] Designates Metric Conversions

## FRESH AIR DAMPER (Cont.)


AXRF-JDA1 (Manual)  
AXRF-JDB1 (Motorized)

### DOWNFLOW APPLICATION

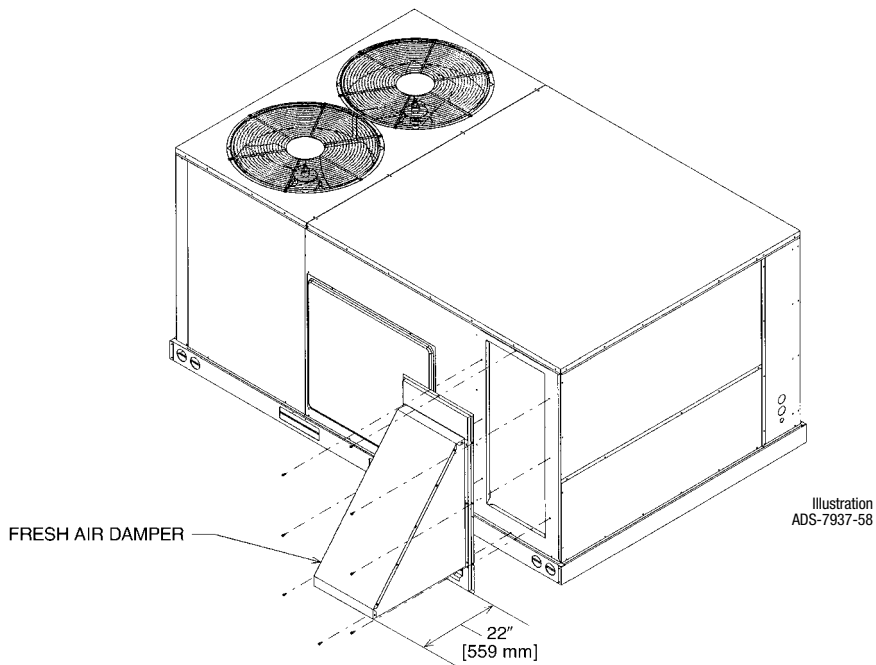

### HORIZONTAL APPLICATION

Illustration  
ST-A0901-01

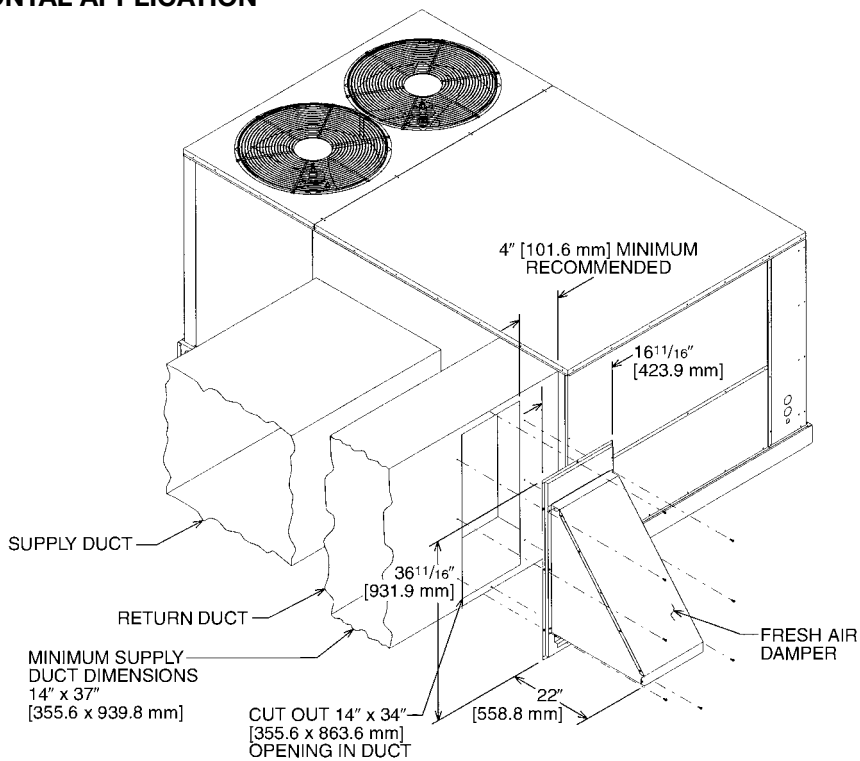

[ ] Designates Metric Conversions



## ROOFCURBS (Full Perimeter)

- Rheem's roofcurb design can be utilized on all 7.5-10 ton [26.4-35.2 kW] RLRL-C/H models.
- Two available heights (14" [356 mm] and 24" [610 mm]) for ALL models.
- Quick assembly corners for simple and fast assembly.
- Opening provided in bottom pan to match the "Thru the Curb" electrical connection opening provided on the unit base pan.
- 1" [25 mm] x 4" [102 mm] Nailer provided.
- Insulating panels not required because of insulated outdoor base pan.
- Sealing gasket (40' [12.2 m]) provided with Roofcurb.
- Packaged for easy field assembly.

Roofcurb Model	Height of Curb
RXKG-CAE14	14" [356 mm]
RXKG-CAE24	24" [610 mm]

## ROOFCURB INSTALLATION



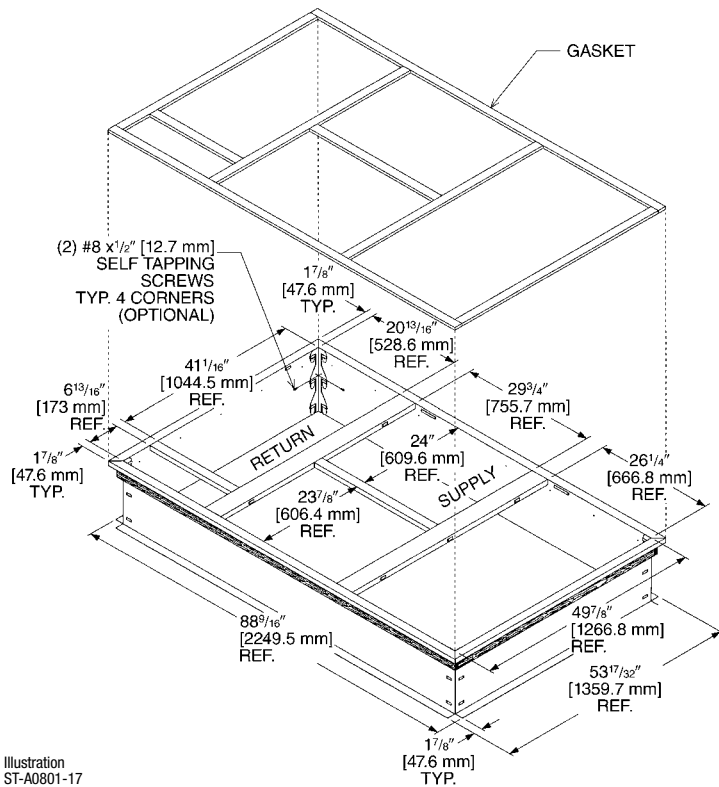


Illustration ST-A0801-17

## TYPICAL INSTALLATION

Illustration ST-A0743-02

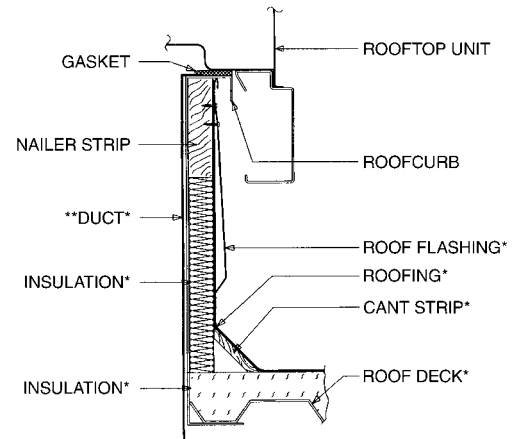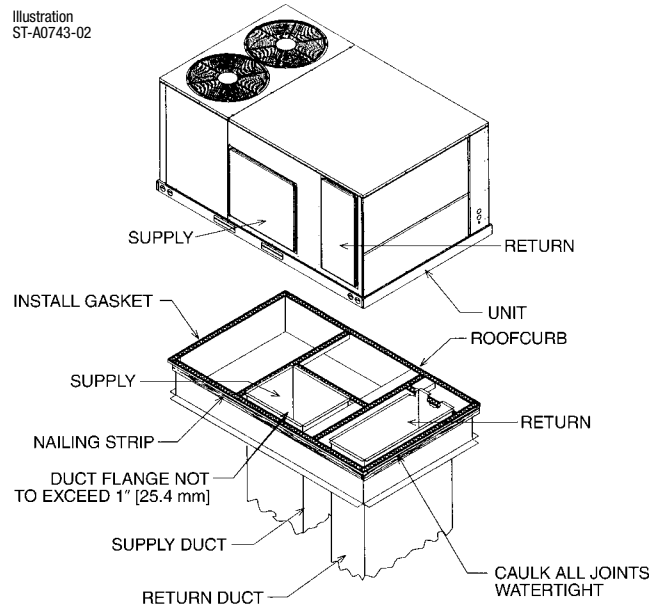

\*BY CONTRACTOR

\*\*FOR INSTALLATION OF DUCT AS SHOWN, USE RECOMMENDED DUCT SIZES FROM ROOFCURB INSTALLATION INSTRUCTIONS. FOR DUCT FLANGE ATTACHMENT TO UNIT, SEE UNIT INSTALLATION INSTRUCTIONS FOR RECOMMENDED DUCT SIZES.

Illustration ST-A0743-02

[ ] Designates Metric Conversions

## ROOFCURB ADAPTERS


OLD MODELS	OLD ROOFCURB	ROOFCURB ADAPTER	NEW MODELS (All Share Common Cabinet)
(-)RCF, (-)REF-075/076 (-)RGF-150075, (-)RGF-131076 (-)RGF-201076	RXRK-E50	RXRX-CDCE50	RLRL-C/H090 RLRL-C/H120
(-)RGF-200075 (-)RGG, (-)REG, (-)RCG-075 (-)RGF, (-)REF, (-)RCF-085 (-)RGF, (-)REF, (-)RCF-100 (-)RGG, (-)REG, (-)RCG-100	RXRK-E54	RXRX-CFCE54	
(-)RGF, (-)REF, (-)RCF-125	RXRK-E56	RXRX-CFCE56	
(-)PDC-075 (-)PDC-100/101	RXPK-C12	RXRX-CGCC12	

NOTE: Ductwork modifications may be necessary if the capacity and/or indoor airflow rate of replacement unit is not equivalent to that of the unit being replaced.  
 RLRL-C072, C090, C102, C120, C151 fit on same roofcurb as the RLKB-A090, A102, A120, A150, A181, RLMB- A090, A102, A120, A150, RLNB- A090, A102, A120

# ROOFCURB ADAPTERS (Cont.)

RXRX-CDCE50

Illustration  
ADS-7952-02  
Sheet 2

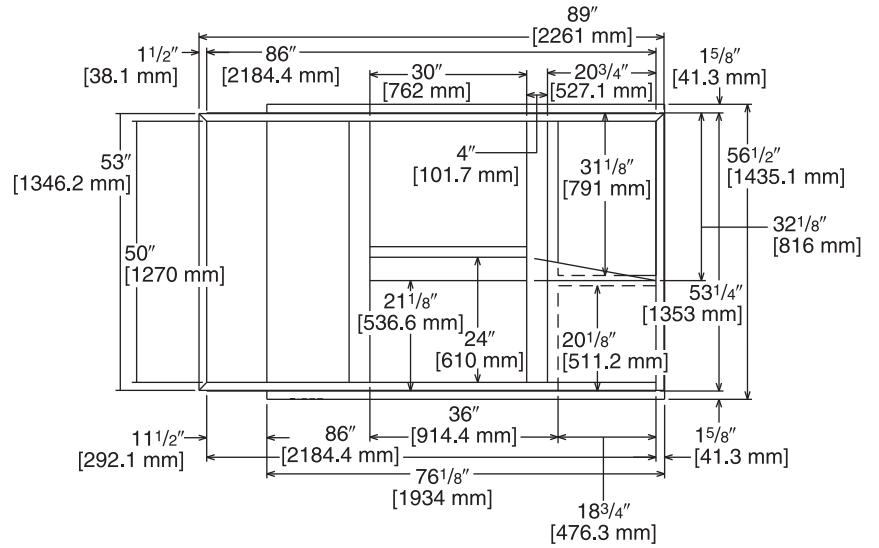

TOP VIEW

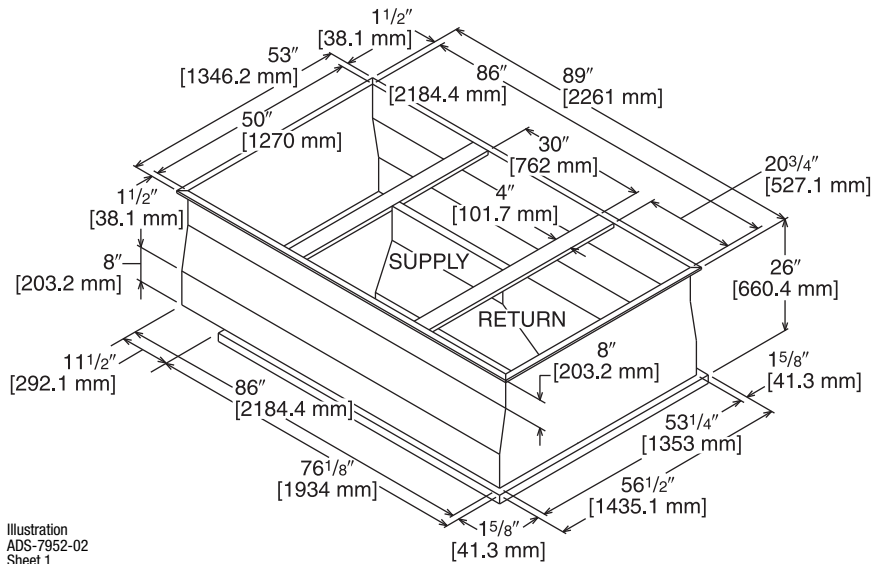



Illustration  
ADS-7952-02  
Sheet 1

[ ] Designates Metric Conversions

# ROOFCURB ADAPTERS (Cont.)


RXRX-CFCE54

Illustration  
ADS-7952-01  
Sheet 2

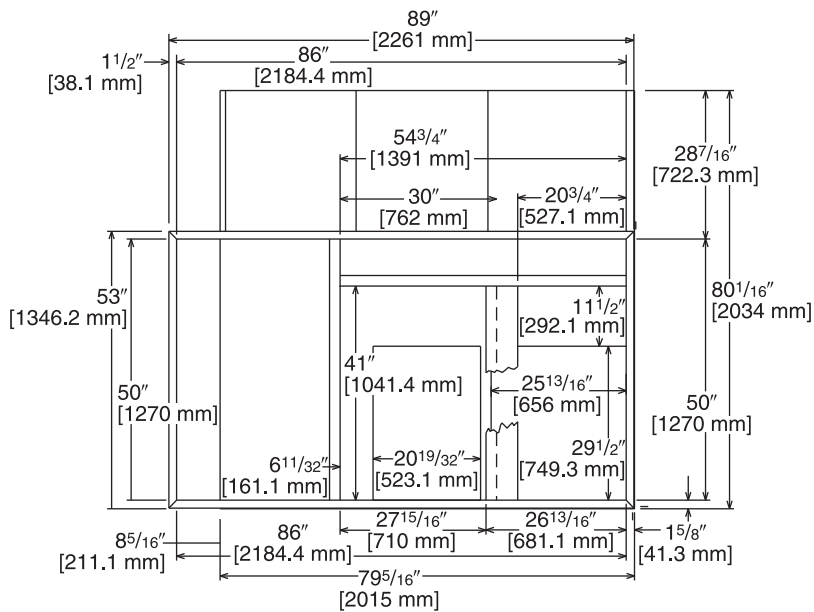

**TOP VIEW**

Illustration  
ADS-7952-01  
Sheet 1

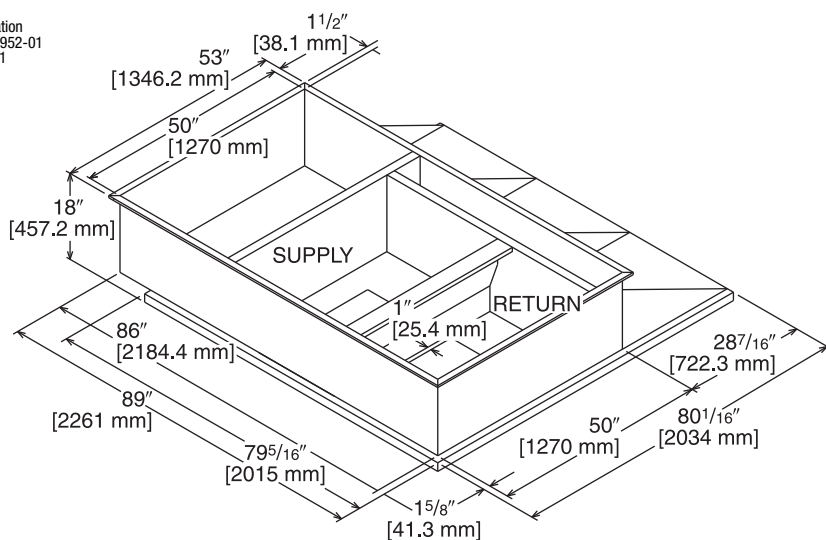


[ ] Designates Metric Conversions

# ROOFCURB ADAPTERS (Cont.)

RXRX-CFCE56

Illustration  
 ADS-7952-03  
 Sheet 2

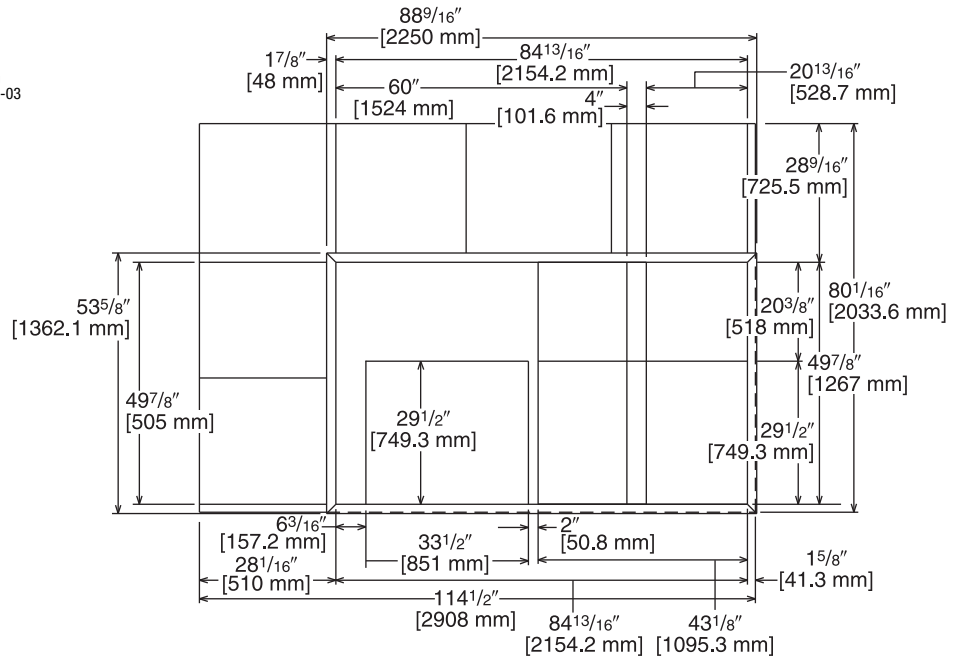

**TOP VIEW**

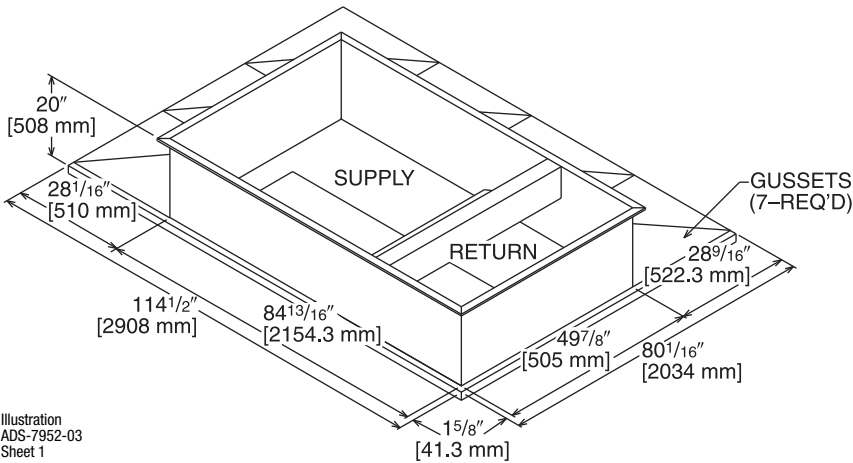



Illustration  
 ADS-7952-03  
 Sheet 1

[ ] Designates Metric Conversions

# ROOFCURB ADAPTERS (Cont.)


RXRX-CGCC12

Illustration  
ADS-7952-04  
Sheet 2

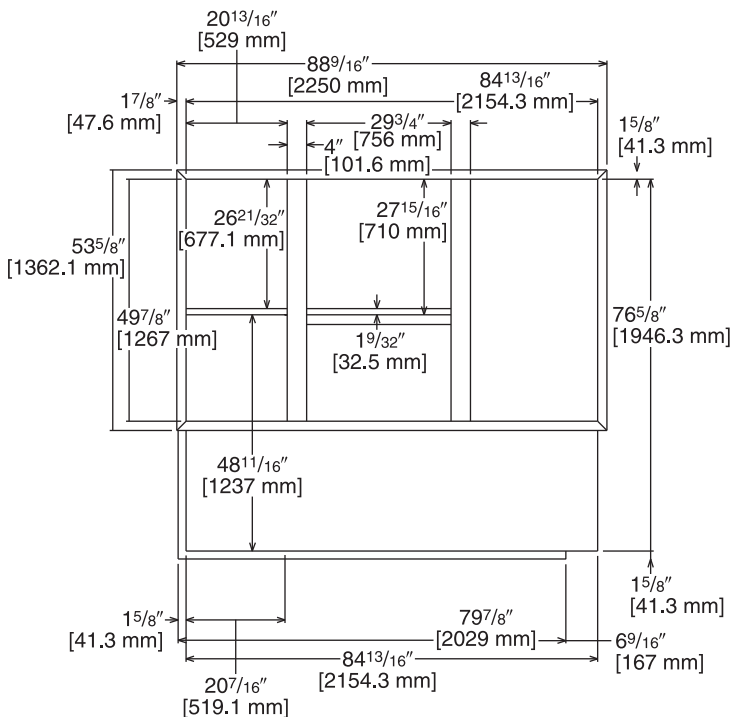

TOP VIEW

Illustration  
ADS-7952-04  
Sheet 1

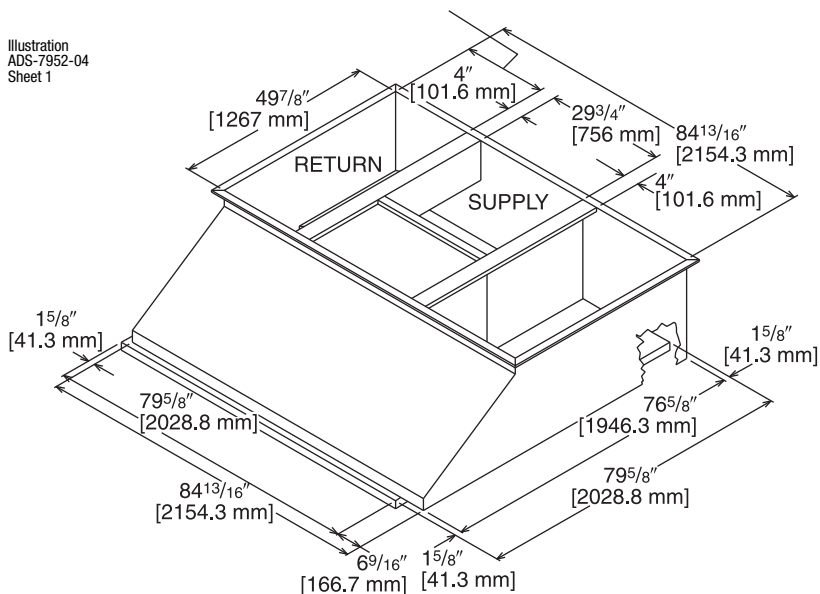

[ ] Designates Metric Conversions



# CONCENTRIC DIFFUSER APPLICATION

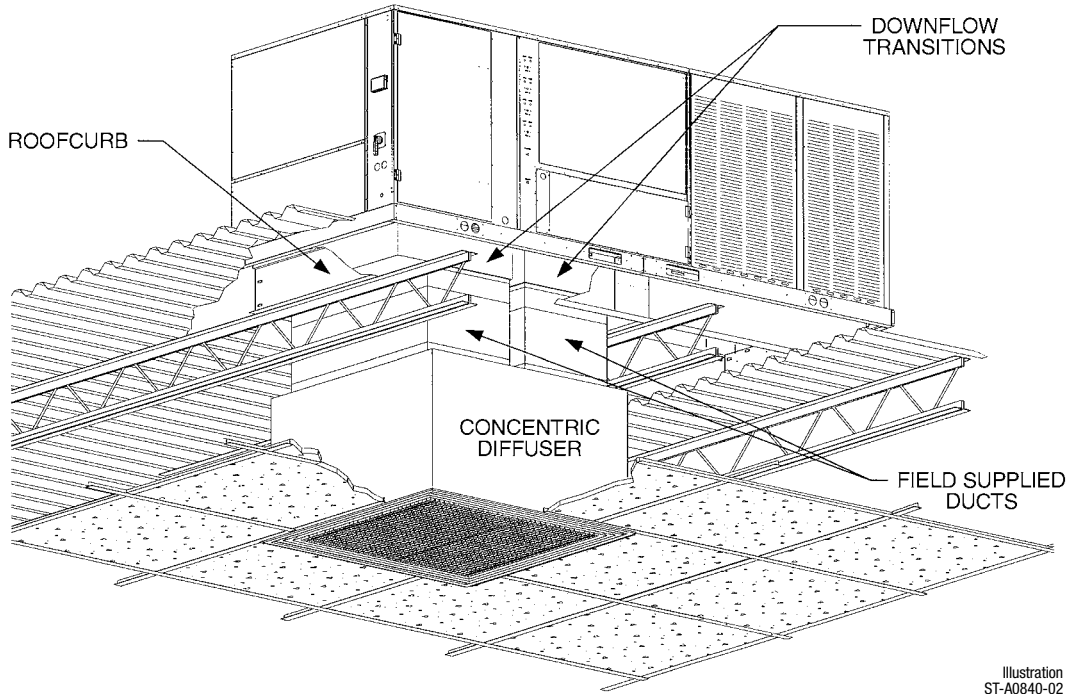


Illustration  
ST-A0840-02

## DOWNFLOW TRANSITION DRAWINGS

### RXMC-CE05

- Used with RXRN-AA61 or RXRN-AA71 Concentric Diffusers.

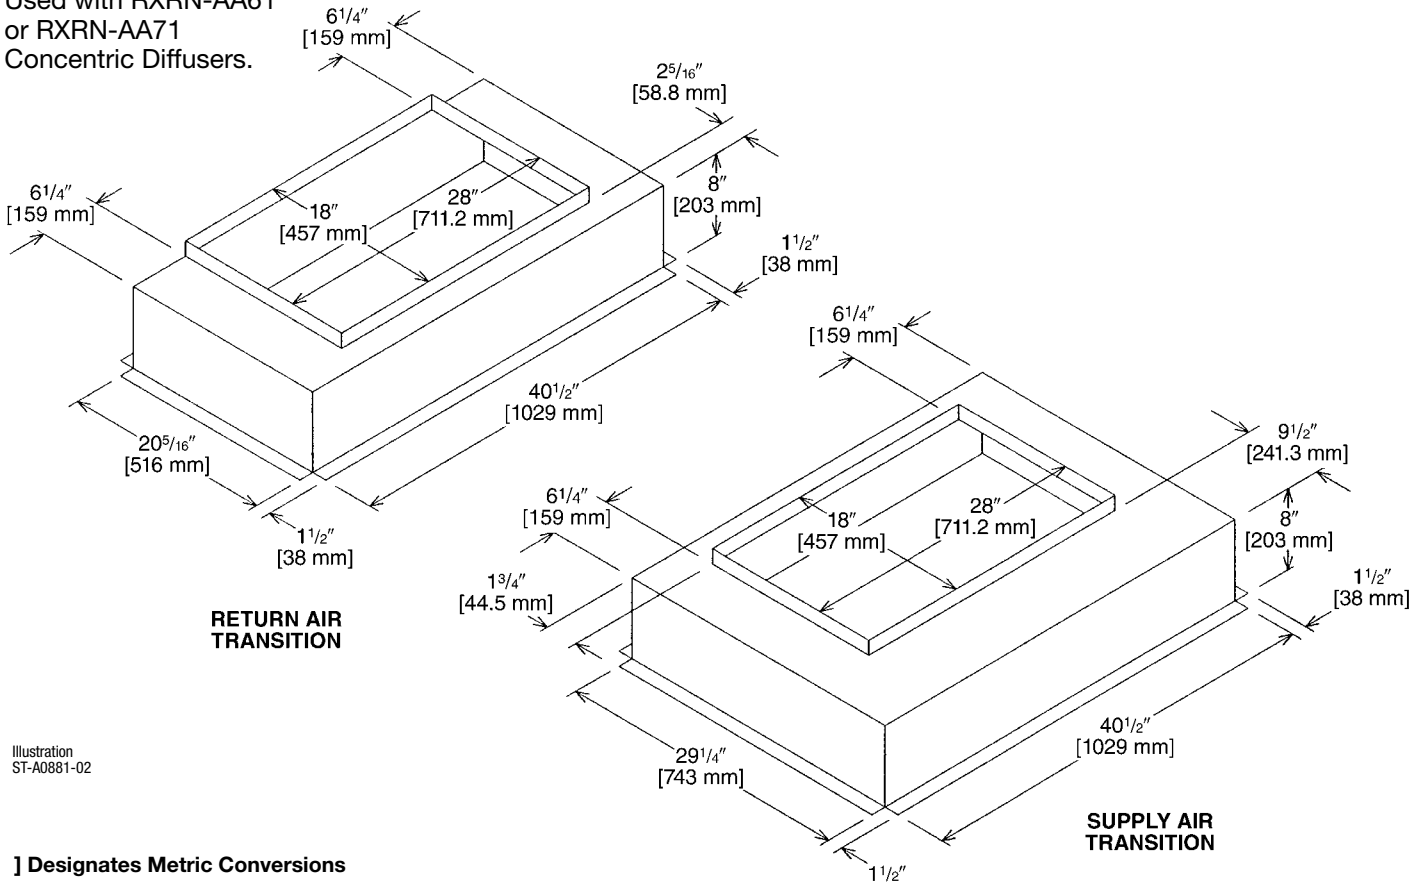


Illustration  
ST-A0881-02

[ ] Designates Metric Conversions

## DOWNFLOW TRANSITION DRAWINGS (Cont.)

### RXMC-CF06

- Used with RXRN-AA66 or RXRN-AA76 Concentric Diffusers.

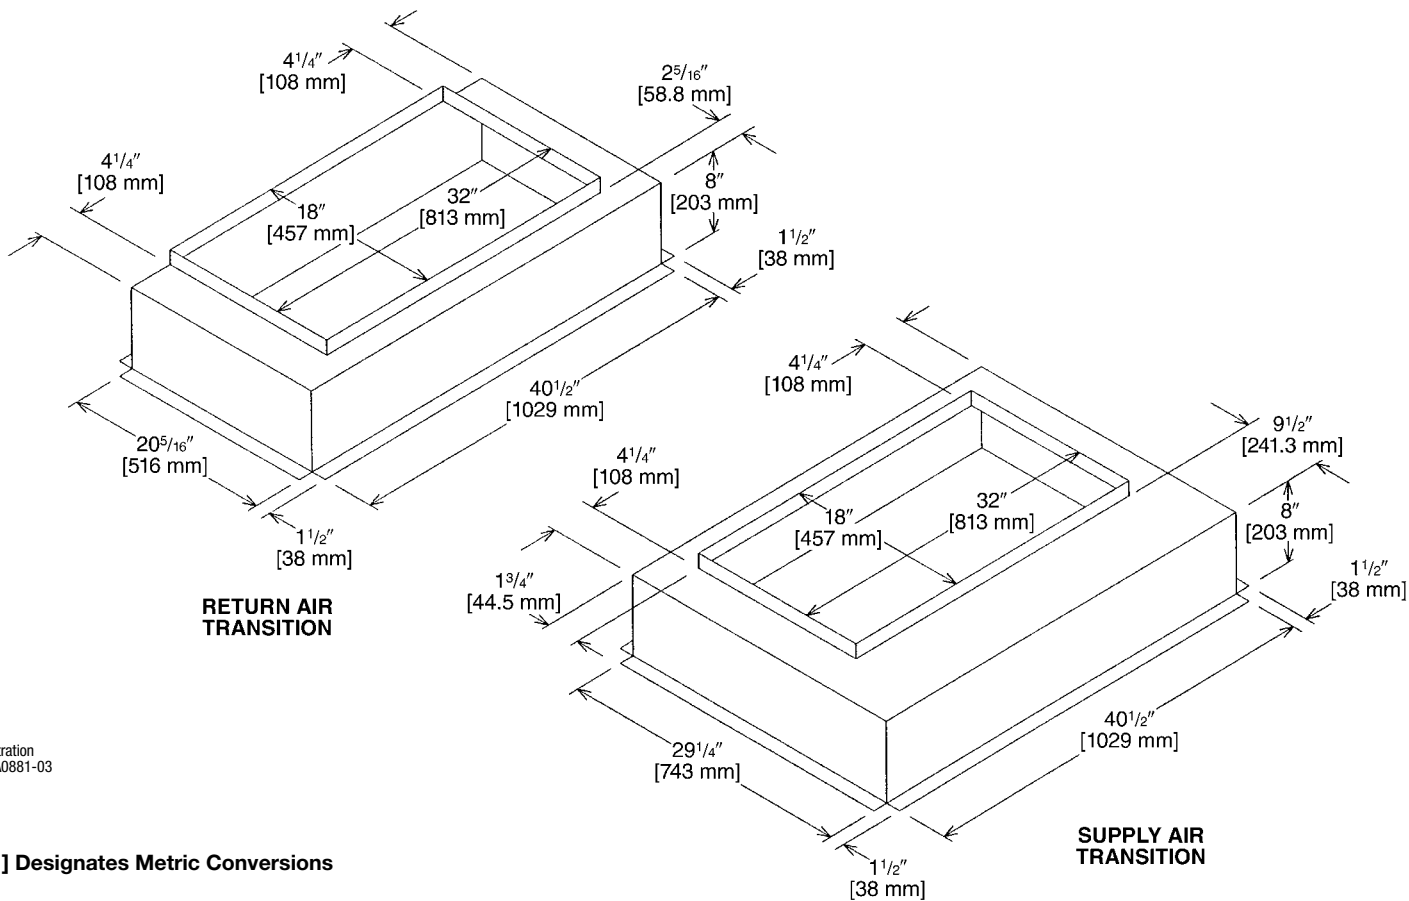


Illustration  
ST-A0881-03

[ ] Designates Metric Conversions

# DOWNFLOW TRANSITION DRAWINGS (Cont.)

## RXMC-CD04

- Used with RXRN-FA65 or RXRN-FA75 Concentric Diffusers.

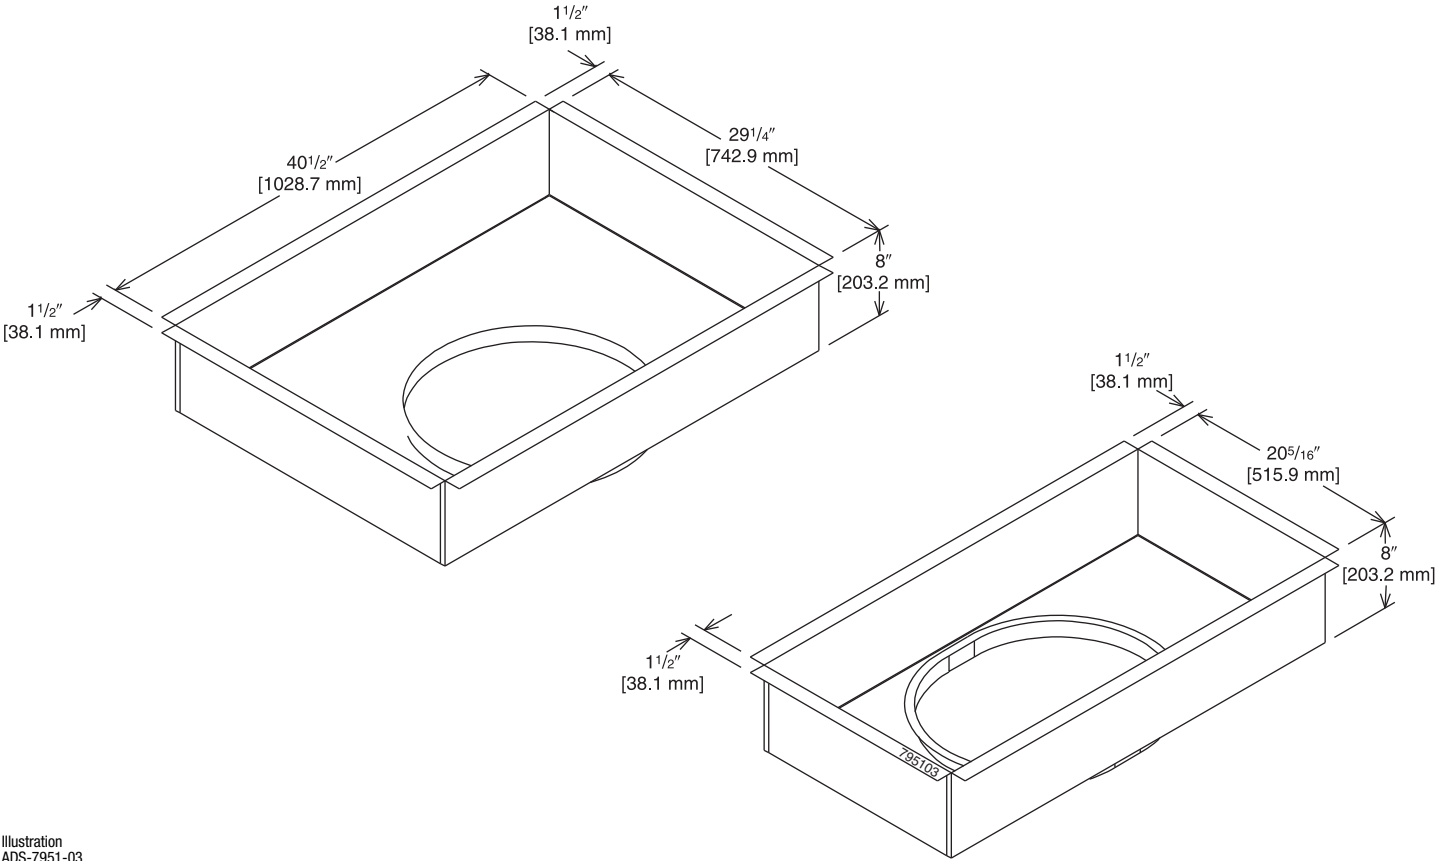


Illustration  
ADS-7951-03

[ ] Designates Metric Conversions

## CONCENTRIC DIFFUSER—STEP DOWN

RXRN-FA65 (7.5 & 8.5 Ton [26.4 & 29.9 kW] Models)

For Use With Downflow Transition (RXMC-CD04)  
and 20" [508 mm] Round Supply and Return Ducts

- All aluminum diffuser with aluminum return air eggcrate.
- Built-in anti-sweat gasket.
- Molded fiberglass supports.
- Built-in hanging supports.
- Diffuser box constructed of sheetmetal insulated with 1" [25.4 mm] 1.5 lbs. [.7 kg] duct liner.

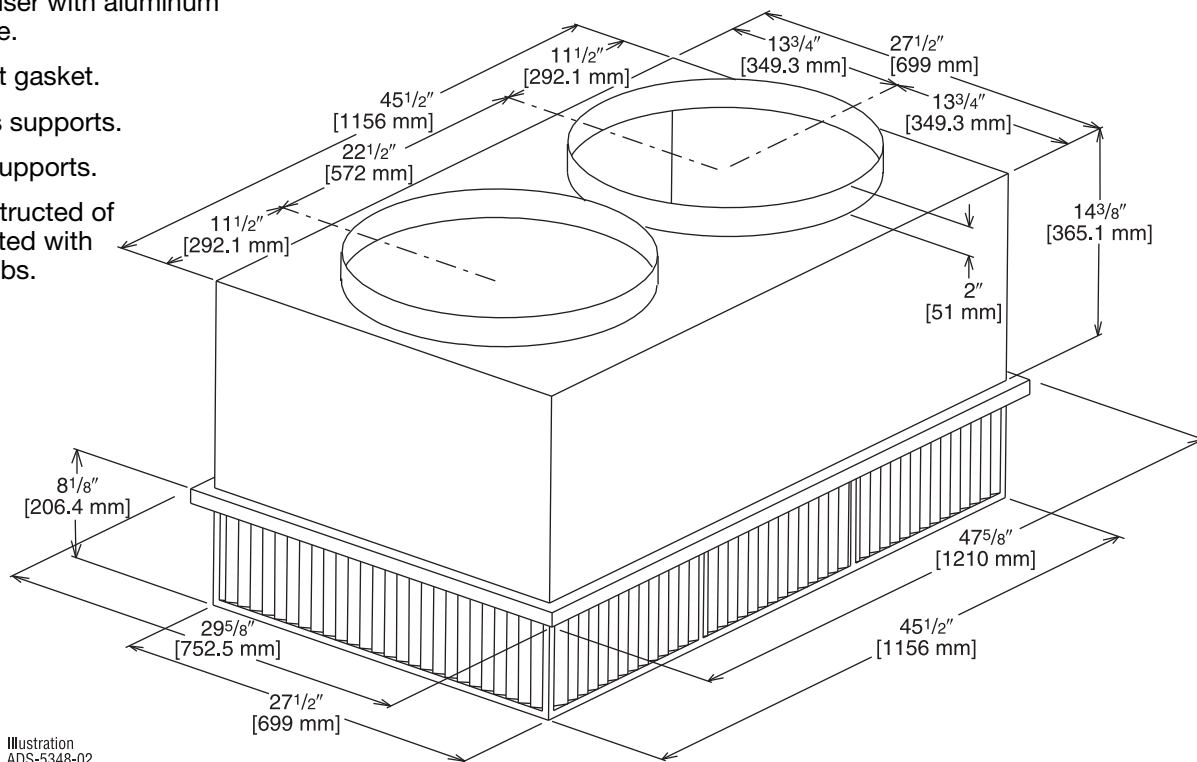


Illustration  
ADS-5348-02

## ENGINEERING DATA<sup>①</sup>

Model No.	Flow Rate CFM [L/s]	Static Pressure in. w.c. [kPa]	Throw <sup>② ③</sup> Feet [m]	Neck Velocity fpm [m/s]	Noise Level <sup>④</sup> (dB)
RXRN-FA65	2600 [1227]	0.17 [0.042]	24-29 [7.3-8.8]	669 [3.4]	20
	2800 [1321]	0.20 [0.050]	25-30 [7.6-9.1]	720 [3.7]	25
	3000 [1416]	0.25 [0.062]	27-33 [8.2-10.1]	772 [3.9]	25
	3200 [1510]	0.31 [0.077]	28-35 [8.5-10.7]	823 [4.2]	25
	3400 [1604]	0.37 [0.092]	30-37 [9.1-11.3]	874 [4.4]	30

NOTES: ① All data is based on the air diffusion council guidelines.

② Throw data is based on 75 FPM Terminal Velocities using isothermal air.

③ Throw is based on diffuser blades being directed in a straight pattern.

④ Actual noise levels may vary due to duct design and do not include transmitted unit noise.

Adequate duct attenuation must be provided to reduce sound output from the unit.

[ ] Designates Metric Conversions

# CONCENTRIC DIFFUSER—STEP DOWN

## 18" x 28" [457.2 x 711.2 mm]

RXRN-AA61 (8.5 & 10 Ton [29.9 kW & 35.2] Models)

For Use With Downflow Transition (RXMC-CE05)  
and 18" x 28" [457.2 x 711.2 mm]  
Supply and Return Ducts

- All aluminum diffuser with aluminum return air eggcrate.
- Built-in anti-sweat gasket.
- Molded fiberglass supports.
- Built-in hanging supports.
- Diffuser box constructed of sheetmetal insulated with 1" [25.4 mm] 1.5 lbs. [.7 kg] duct liner.
- Double deflection diffuser with the blades secured by spring steel.

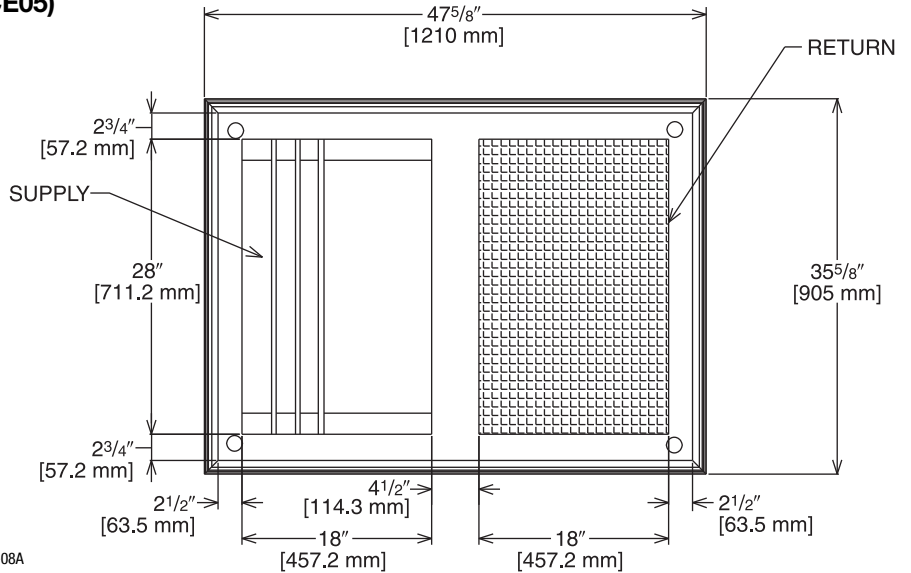


Illustration  
ADS-7951-08A

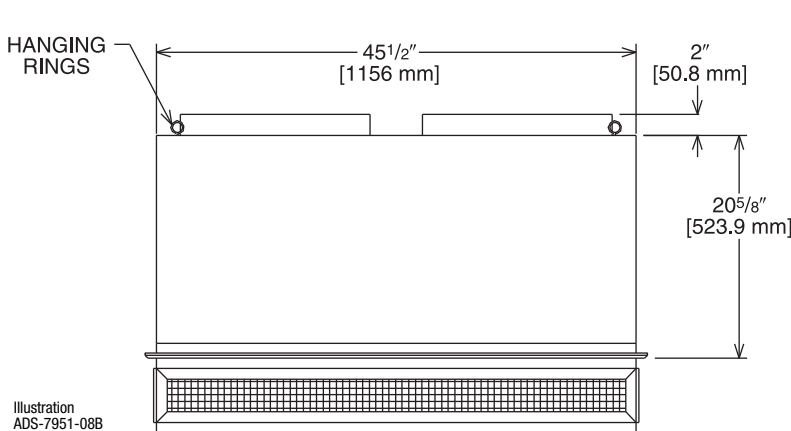


Illustration  
ADS-7951-08B

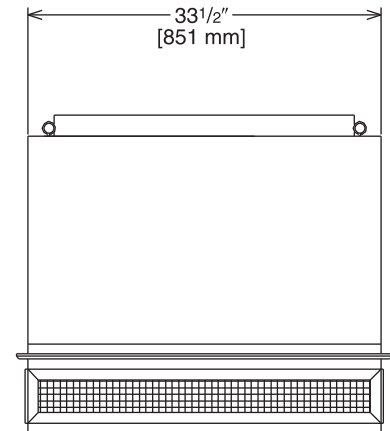


Illustration  
ADS-7951-08C

## ENGINEERING DATA<sup>①</sup>

Model No.	Flow Rate CFM [L/s]	Static Pressure in w.c. [kPa]	Throw <sup>② ③</sup> Feet [m]	Neck Velocity fpm [m/s]	Noise Level <sup>④</sup> (dbA)
RXRN-AA61	3600 [1699]	0.17 [0.042]	25-33 [7.6-10.1]	851 [4.3]	30
	3800 [1793]	0.18 [0.045]	27-35 [8.2-10.7]	898 [4.6]	30
	4000 [1888]	0.21 [0.052]	29-37 [8.8-11.3]	946 [4.8]	30
	4200 [1982]	0.24 [0.060]	32-40 [9.8-12.2]	993 [5.0]	30
	4400 [2076]	0.27 [0.067]	34-42 [10.4-12.8]	1040 [5.3]	30

- NOTES: ① All data is based on the air diffusion council guidelines.  
 ② Throw data is based on 75 FPM Terminal Velocities using isothermal air.  
 ③ Throw is based on diffuser blades being directed in a straight pattern.  
 ④ Actual noise levels may vary due to duct design and do not include transmitted unit noise. Adequate duct attenuation must be provided to reduce sound output from the unit.

[ ] Designates Metric Conversions

# CONCENTRIC DIFFUSER—STEP DOWN 18" x 32" [457.2 x 813 mm]

RXRN-AA66 (12.5 Ton [44.0 kW] Models)

For Use With Downflow Transition (RXMC-CF06)  
and 18" x 32" [457.2 x 813 mm]  
Supply and Return Ducts

- All aluminum diffuser with aluminum return air eggcrate.
- Built-in anti-sweat gasket.
- Molded fiberglass supports.
- Built-in hanging supports.
- Diffuser box constructed of sheetmetal insulated with 1" [25.4 mm] 1.5 lbs. [.7 kg] duct liner.
- Double deflection diffuser with the blades secured by spring steel.

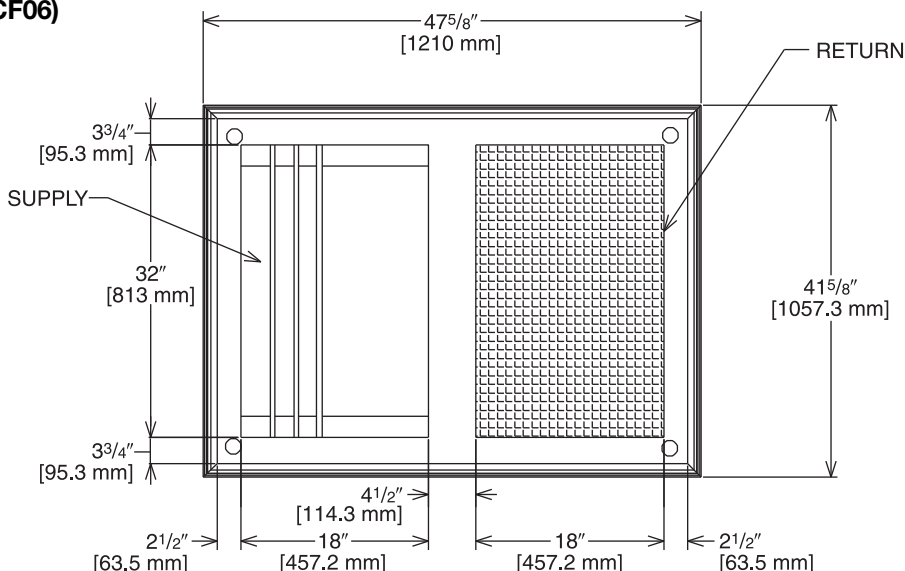


Illustration  
ADS-7951-09A

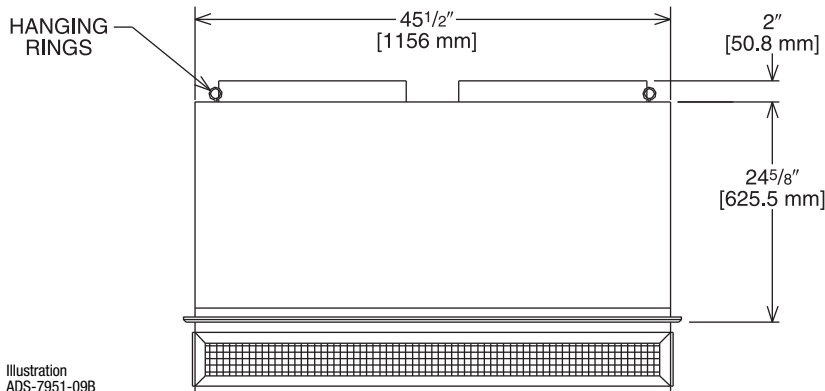


Illustration  
ADS-7951-09B

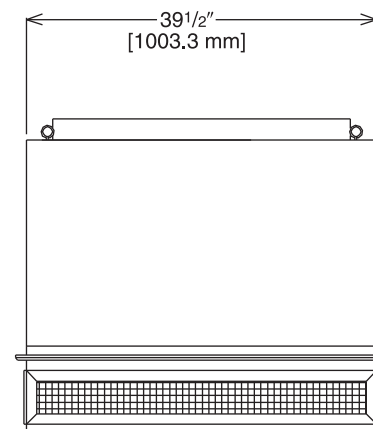


Illustration  
ADS-7951-09C

## ENGINEERING DATA<sup>①</sup>

Model No.	Flow Rate CFM [L/s]	Static Pressure in w.c. [kPa]	Throw <sup>② ③</sup> Feet [m]	Neck Velocity fpm [m/s]	Noise Level <sup>④</sup> (dbA)
RXRN-AA66	4600 [2171]	0.31 [0.077]	26-31 [7.9-9.4]	841 [4.3]	30
	4800 [2265]	0.32 [0.080]	27-32 [8.2-9.8]	878 [4.5]	30
	5000 [2359]	0.34 [0.085]	28-33 [8.5-10.1]	915 [4.6]	30
	5200 [2454]	0.36 [0.090]	28-34 [8.5-10.4]	951 [4.8]	30
	5400 [2548]	0.39 [0.097]	29-35 [8.8-10.7]	988 [6.0]	30

- NOTES: ① All data is based on the air diffusion council guidelines.  
② Throw data is based on 75 FPM Terminal Velocities using isothermal air.  
③ Throw is based on diffuser blades being directed in a straight pattern.  
④ Actual noise levels may vary due to duct design and do not include transmitted unit noise. Adequate duct attenuation must be provided to reduce sound output from the unit.

[ ] Designates Metric Conversions

# FLUSH MOUNT CONCENTRIC DIFFUSER—FLUSH

RXRN-FA75 (7.5 & 8.5 Ton [26.4 & 29.9 kW] Models)

For Use With Downflow Transition (RXMC-CD04)  
and 20" [508 mm] Round Supply and Return Ducts

- All aluminum diffuser with aluminum return air eggcrate.
- Built-in anti-sweat gasket.
- Molded fiberglass supports.
- Built-in hanging supports.
- Diffuser box constructed of sheetmetal insulated with 1" [25.4 mm] 1.5 lbs. [.7 kg] duct liner.

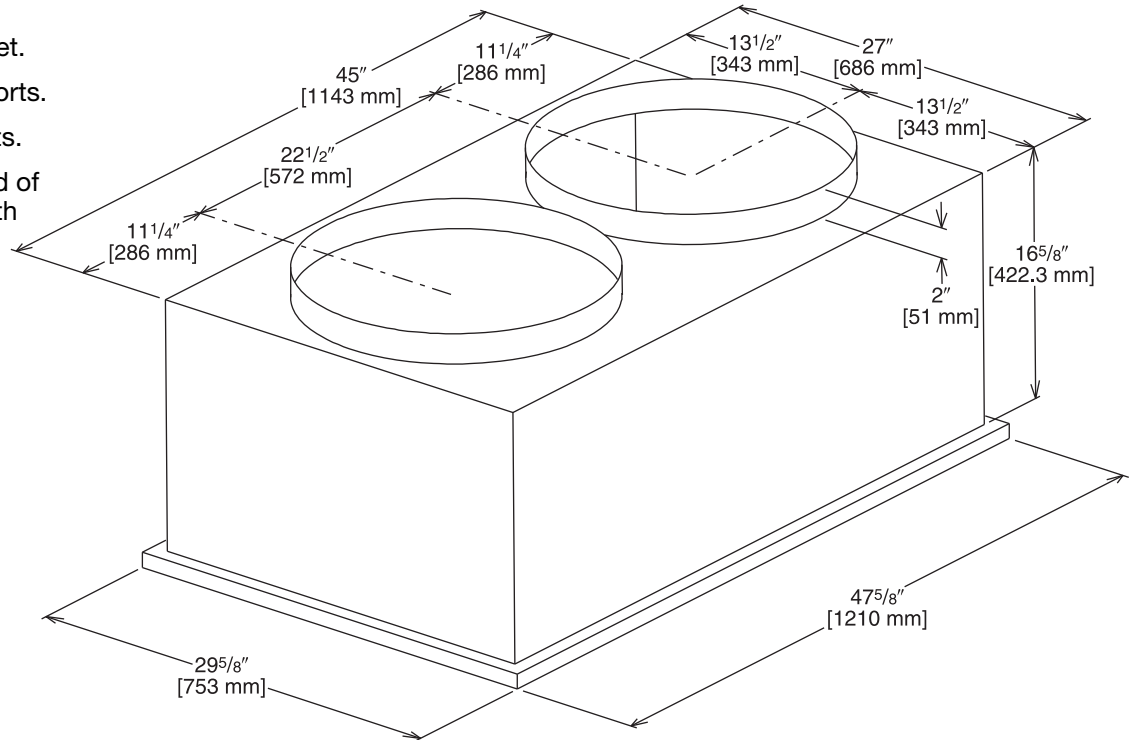


Illustration  
ADS-5348-04

## ENGINEERING DATA<sup>①</sup>

Model No.	Flow Rate CFM [L/s]	Static Pressure in. w.c. [kPa]	Throw <sup>② ③</sup> Feet [m]	Neck Velocity fpm [m/s]	Noise Level <sup>④</sup> (dbA)
RXRN-FA75	2600 [1227]	.17 [0.042]	19-24 [5.8-7.3]	663 [3.4]	30
	2800 [1321]	.20 [0.050]	20-28 [6.1-8.5]	714 [3.6]	35
	3000 [1416]	.25 [0.062]	21-29 [6.4-8.8]	765 [3.9]	35
	3200 [1510]	.31 [0.077]	22-29 [6.7-8.8]	816 [4.1]	40
	3400 [1604]	.37 [0.092]	22-30 [6.7-9.1]	867 [4.4]	40

NOTES: ① All data is based on the air diffusion council guidelines.

② Throw data is based on 75 FPM Terminal Velocities using isothermal air.

③ Throw is based on diffuser blades being directed in a straight pattern.

④ Actual noise levels may vary due to duct design and do not include transmitted unit noise.  
Adequate duct attenuation must be provided to reduce sound output from the unit.

[ ] Designates Metric Conversions



# CONCENTRIC DIFFUSER—FLUSH and 18" x 28" [457.2 x 711.2 mm]

RXRN-AA71 (8.5 & 10 Ton [29.9 & 35.2] Models)

For Use With Downflow Transition (RXMC-CE05)  
and 18" x 28" [457.2 x 711.2 mm]  
Supply and Return Ducts

- All aluminum diffuser with aluminum return air eggcrate.
- Built-in anti-sweat gasket.
- Molded fiberglass supports.
- Built-in hanging supports.
- Diffuser box constructed of sheetmetal insulated with 1" [25.4 mm] 1.5 lbs. [.7 kg] duct liner.

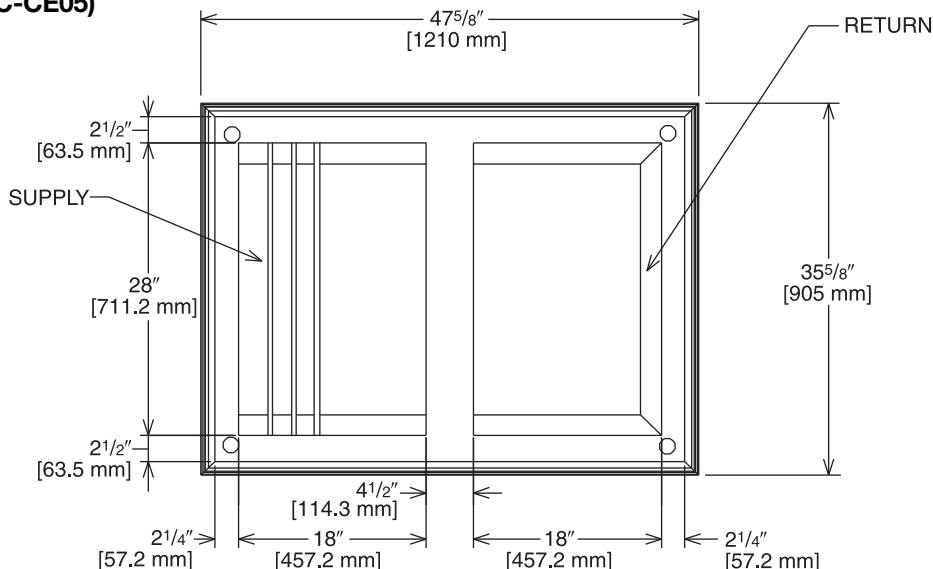


Illustration  
ADS-7951-06A

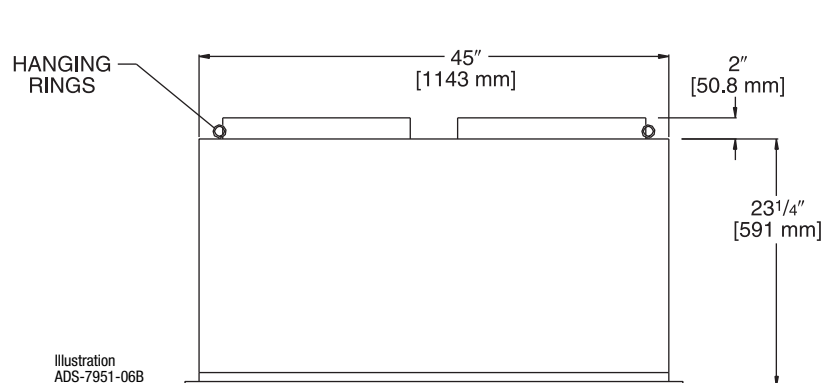


Illustration  
ADS-7951-06B

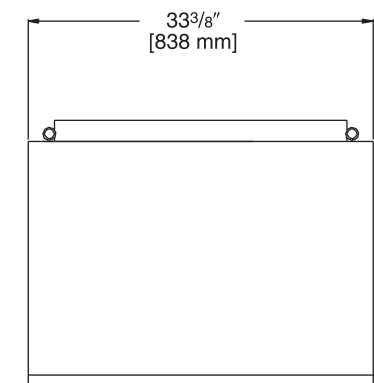


Illustration  
ADS-7951-06C

## ENGINEERING DATA<sup>①</sup>

Model No.	Flow Rate CFM [L/s]	Static Pressure in w.c. [kPa]	Throw <sup>② ③</sup> Feet [m]	Neck Velocity fpm [m/s]	Noise Level <sup>④</sup> (dba)
RXRN-AA71	3600 [1699]	0.17 [0.042]	22-29 [6.7-8.8]	844 [4.3]	35
	3800 [1793]	0.18 [0.045]	22-30 [6.7-9.1]	891 [4.5]	40
	4000 [1888]	0.21 [0.052]	24-33 [7.3-10.1]	938 [4.8]	40
	4200 [1982]	0.24 [0.060]	26-35 [7.9-10.7]	985 [5.0]	40
	4400 [2076]	0.27 [0.067]	28-37 [8.5-11.3]	1032 [5.2]	40

- NOTES: ① All data is based on the air diffusion council guidelines.  
 ② Throw data is based on 75 FPM Terminal Velocities using isothermal air.  
 ③ Throw is based on diffuser blades being directed in a straight pattern.  
 ④ Actual noise levels may vary due to duct design and do not include transmitted unit noise. Adequate duct attenuation must be provided to reduce sound output from the unit.

[ ] Designates Metric Conversions




# CONCENTRIC DIFFUSER—FLUSH

## 18" x 32" [457.2 x 813 mm]

RXRN-AA76 (12.5 Ton [44.0 kW] Models)

For Use With Downflow Transition (RXMC-CF06) and 18" x 32" [457.2 x 813 mm] Supply and Return Ducts

- All aluminum diffuser with aluminum return air eggcrate.
- Built-in anti-sweat gasket.
- Molded fiberglass supports.
- Built-in hanging supports.
- Diffuser box constructed of sheetmetal insulated with 1" [25.4 mm] 1.5 lbs. [.7 kg] duct liner.

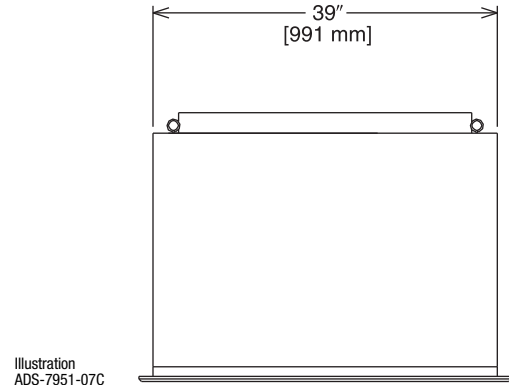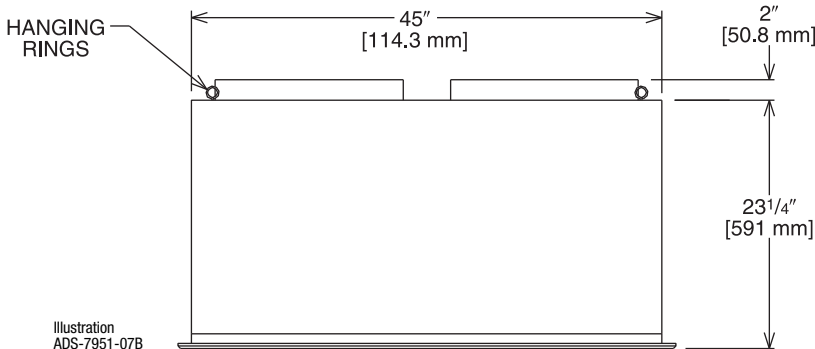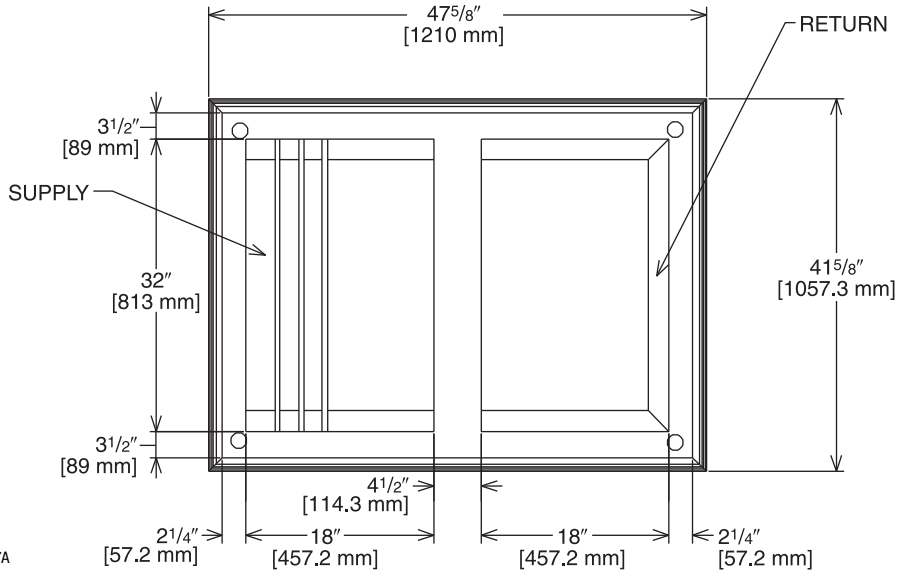

## ENGINEERING DATA<sup>①</sup>

Model No.	Flow Rate CFM [L/s]	Static Pressure in w.c. [kPa]	Throw <sup>②</sup> <sup>③</sup> Feet [m]	Neck Velocity fpm [m/s]	Noise Level <sup>④</sup> (dba)
RXRN-AA76	4600 [2171]	0.31 [0.077]	25-34 [7.6-10.4]	922 [4.7]	40
	4800 [2265]	0.32 [0.080]	26-35 [7.9-10.7]	962 [4.9]	40
	5000 [2359]	0.34 [0.085]	27-36 [8.2-11.0]	1002 [5.1]	40
	5200 [2454]	0.36 [0.090]	30-39 [9.1-11.9]	1043 [5.3]	45
	5400 [2548]	0.39 [0.097]	32-41 [9.8-12.5]	1083 [5.5]	45

NOTES: <sup>①</sup> All data is based on the air diffusion council guidelines.  
<sup>②</sup> Throw data is based on 75 FPM Terminal Velocities using isothermal air.  
<sup>③</sup> Throw is based on diffuser blades being directed in a straight pattern.  
<sup>④</sup> Actual noise levels may vary due to duct design and do not include transmitted unit noise.  
 Adequate duct attenuation must be provided to reduce sound output from the unit.

[ ] Designates Metric Conversions

## GUIDE SPECIFICATIONS – RLRL-C/H090 and 120

You may copy this document directly into your building specification. This specification is written to comply with the 2004 version of the “master format” as published by the Construction Specification Institute. [www.csinet.org](http://www.csinet.org).

### ELECTRIC HEAT PACKAGED ROOFTOP

#### HVAC Guide Specifications

Size Range: 6 to 12.5 Nominal Tons

Section	Description
---------	-------------

<b>23 06 80</b>	<b>Schedules for Decentralized HVAC Equipment</b>
-----------------	---

23 06 80.13	Decentralized Unitary HVAC Equipment Schedule
-------------	---

23 06 80.13.A.	Rooftop unit schedule
----------------	-----------------------

1. Schedule is per the project specification requirements.

<b>23 07 16</b>	<b>HVAC Equipment Insulation</b>
-----------------	----------------------------------

23 07 16.13	Decentralized, Rooftop Units:
-------------	-------------------------------

1. Interior cabinet surfaces shall be insulated with a minimum 3/4-in. thick, minimum 1-1/2 lb density, flexible fiberglass insulation bonded with a phenolic binder, with aluminum foil facing on the air side.

2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.

<b>23 09 13</b>	<b>Instrumentation and Control Devices for HVAC</b>
-----------------	---

23 09 13.23	Sensors and Transmitters
-------------	--------------------------

23 09 13.23.A.	Thermostats
----------------	-------------

1. Thermostat must

- a. have capability to energize 2 different stages of cooling, and 2 different stages of heating.

- b. must include capability for occupancy scheduling.

<b>23 09 23</b>	<b>Direct-digital Control system for HVAC</b>
-----------------	---

23 09 23.13	Decentralized, Rooftop Units:
-------------	-------------------------------

23 09 23.13.A.	RTU-C controller
----------------	------------------

1. Shall be ASHRAE 62-2001 compliant.

2. Shall accept 18-32VAC input power.

3. Shall have an operating temperature range from -40°F (-40°C) to 158°F (70°C), 10% - 95% RH (non-condensing).

4. Controller shall accept the following inputs: space temperature, setpoint adjustment, outdoor air temperature, indoor air quality, outdoor air enthalpy, fire shutdown, return air enthalpy, fan status, remote time clock/door switch.

5. Shall accept a CO<sub>2</sub> sensor in the conditioned space, and be Demand Control Ventilation (DCV) ready.

6. Shall provide the following outputs: Economizer, fan, cooling stage 1, cooling stage 2, heat stage 1, heat stage 2, exhaust, occupied.

7. Unit shall provide surge protection for the controller through a circuit breaker.

8. Shall have a field installed communication card allowing the unit to be Internet capable, and communicate at a Baud rate of 19.2K or faster

9. Shall have an LED display independently showing the status of activity on the communication bus, and processor operation.

10. Shall have either a field installed BACnet® plug-in communication card which includes an EIA-485 protocol communication port, or a field installed LonWorks™ plug-in communications card.

11. Software upgrades will be accomplished by local download. Software upgrades through chip replacements are not allowed.

12. Shall be shock resistant in all planes to 5G peak, 11ms during operation, and 100G peak, 11ms during storage.

13. Shall be vibration resistant in all planes to 1.5G @ 20-300 Hz.

14. Shall support a bus length of 4000 ft max, 60 devices per 1000 ft section, and 1 RS-485 repeater per 1000 ft sections.

<b>23 09 23.13.B.</b>	<b>Open protocol, direct digital controller:</b>
-----------------------	--

1. Shall be ASHRAE 62-2001 compliant.

2. Shall accept 18-30VAC, 50-60Hz, and consumer 15VA or less power.

3. Shall have an operating temperature range from -40°F (-40°C) to 130°F (54°C), 10% - 90% RH (non-condensing).

4. Shall have either a field installed BACnet® plug-in communication card which includes an EIA-485 protocol communication port, or a field installed LonWorks™ plug-in communications card.

5. The BACnet® plug in communication card shall include built-in protocol for BACNET (MS/TP and PTP modes)

6. The LonWorks™ plug in communication card shall include the Echelon processor required for all Lon applications.

7. Shall allow access of up to 62 network variables (SNVT). Shall be compatible with all open controllers

8. Baud rate Controller shall be selectable through the EIA-485 protocol communication port.

9. Shall have an LED display independently showing the status of serial communication, running, errors, power, all digital outputs, and all analog inputs.

10. Shall accept the following inputs: space temperature, setpoint adjustment, outdoor air temperature, indoor air quality, outdoor air enthalpy, compressor lock-out, fire shutdown, enthalpy switch, and fan status/filter status/ humidity/ remote occupancy.

11. Shall provide the following outputs: economizer, fan, cooling stage 1, cooling stage 2, heat stage 1, heat stage 2, exhaust.

12. Software upgrades will be accomplished by either local or remote download. No software upgrades through chip replacements are allowed.

**23 09 33 Electric and Electronic Control System for HVAC**

23 09 33.13 Decentralized, Rooftop Units:

23 09 33.13.A. General:

1. Shall be complete with self-contained low-voltage control circuit protected by a resettable circuit breaker on the 24-v transformer side. Transformer shall have 100VA capabilities.
2. Shall utilize color-coded wiring.
3. Shall include a central control terminal board to conveniently and safely provide connection points for vital control functions such as: smoke detectors, phase monitor, economizer, thermostat, DDC control options, loss of charge, freeze sensor, high pressure switches.
4. Unit shall include a minimum of one 10-pin screw terminal connection board for connection of control wiring.

23 09 33.23.B. Safeties:

1. Compressor over-temperature, over current.
2. Loss of charge switch.
  - a. Units with 2 compressors shall have different colored wires for the circuit 1 and circuit 2 low and high pressure switches.
  - b. Loss of charge switch shall use different color wire than the high pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.
  - c. Loss of charge switch shall have a different sized connector than the high pressure switch. They shall physically prevent the cross-wiring of the safety switches between the high and low pressure side of the system.
3. High-pressure switch.
  - a. Units with 2 compressors shall have different colored wires for the circuit 1 and circuit 2 low and high pressure switches.
  - b. High pressure switch shall use different color wire than the low pressure switch. The purpose is to assist the installer and service person to correctly wire and or troubleshoot the rooftop unit.
  - c. High pressure switch shall have a different sized connector than the loss of charge switch. They shall physically prevent the cross-wiring of the safety switches between the high and low pressure side of the system.
4. Freeze protection sensor, evaporator coil.
5. Automatic reset, motor thermal overload protector.

**23 09 93 Sequence of Operations for HVAC Controls**

23 09 93.13 Decentralized, Rooftop Units:

23 09 93.13 INSERT SEQUENCE OF OPERATION

**23 40 13 Panel Air Filters**

23 40 13.13 Decentralized, Rooftop Units:

23 40 13.13.A. Standard filter section shall

1. Shall consist of factory-installed, low velocity, throwaway 2-in. thick fiberglass filters of commercially available sizes.
2. Filters shall be accessible through an access panel as described in the unit cabinet section of this specification (23 81 19.13.H).

23 81 19 Self-Contained Air Conditioners

23 81 19.13 Small-Capacity Self-Contained Air Conditioners

23 81 19.13.A. General

1. Outdoor, rooftop mounted, electrically controlled, heating and cooling unit utilizing a(n) hermetic scroll compressor(s) for cooling duty and heat pump for heating duty.
2. Factory assembled, single-piece heating and cooling rooftop unit. Contained within the unit enclosure shall be all factory wiring, piping, controls, and special features required prior to field start-up.
3. Unit shall use environmentally sound R-410a refrigerant.
4. Unit shall be installed in accordance with the manufacturer's instructions.
5. Unit must be selected and installed in compliance with local, state, and federal codes.

23 81 19.13.B. Quality Assurance

1. Unit meets ASHRAE 90.1-2004 minimum efficiency requirements.
2. 3 phase units are Energy Star qualified.
3. Unit shall be rated in accordance with AHRI Standards 210/240 and 340/360.
4. Unit shall be designed to conform to ASHRAE 15, 2001.
5. Unit shall be UL-tested and certified in accordance with ANSI Z21.47 Standards and UL-listed and certified under Canadian standards as a total package for safety requirements.
6. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
7. Unit casing shall be capable of withstanding 500-hour salt spray exposure per ASTM B117 (scribed specimen).
8. Unit casing shall be capable of withstanding Federal Test Method Standard No. 141 (Method 6061) 5000-hour salt spray.
9. Unit shall be designed in accordance with ISO 9001:2000, and shall be manufactured in a facility registered by ISO 9001:2000.
10. Roof curb shall be designed to conform to NRCA Standards.
11. Unit shall be subjected to a completely automated run test on the assembly line. The data for each unit will be stored at the factory, and must be available upon request.
12. Unit shall be designed in accordance with UL Standard 1995, including tested to withstand rain.
13. Unit shall be constructed to prevent intrusion of snow and tested to prevent snow intrusion into the control box up to 40 mph.

## 23 81 19.13.C. Delivery, Storage, and Handling

1. Unit shall be stored and handled per manufacturer's recommendations.
2. Lifted by crane requires either shipping top panel or spreader bars.
3. Unit shall only be stored or positioned in the upright position.

## 23 81 19.13.E. Project Conditions

1. As specified in the contract.

## 23 81 19.13.F. Operating Characteristics

1. Unit shall be capable of starting and running at 115°F (46°C) ambient outdoor temperature, meeting maximum load criteria of AHRI Standard 210/240 or 340/360 at ± 10% voltage.
2. Compressor with standard controls shall be capable of operation from 40°F (4°C) , ambient outdoor temperatures. Accessory low ambient kit is necessary if mechanically cooling at ambient temperatures below 40°F (4°C).
3. Unit shall discharge supply air vertically or horizontally as shown on contract drawings.
4. Unit shall be factory configured for vertical supply & return configurations.
5. Unit shall be field convertible from vertical to horizontal configuration.

## 23 81 19.13.G. Electrical Requirements

1. Main power supply voltage, phase, and frequency must match those required by the manufacturer.

## 23 81 19.13.H. Unit Cabinet

1. Unit cabinet shall be constructed of galvanized steel, and shall be bonderized and coated with a baked enamel finish on all externally exposed surfaces.
2. Unit cabinet exterior paint shall be: film thickness, (dry) 0.003 inches minimum, gloss (per ASTM D523, 60°F): 60, Hardness: H-2H Pencil hardness.
3. Evaporator fan compartment interior cabinet insulation shall conform to AHRI Standards 210/240 or 340/360 minimum exterior sweat criteria. Interior surfaces shall be insulated with a minimum 3/4-in. thick, 1 lb density, flexible fiberglass insulation, aluminum foil-faced on the air side.
4. Base of unit shall have locations for thru-the-base electrical connections (factory installed or field installed), standard.
5. Base Rail
  - a. Unit shall have base rails on all sides.
  - b. Holes shall be provided in the base rails for rigging shackles to facilitate maneuvering and overhead rigging.
  - c. Holes shall be provided in the base rail for moving the rooftop by fork truck.
  - d. Base rail shall be a minimum of 14 gauge thickness.
6. Condensate pan and connections:
  - a. Shall be a sloped condensate drain pan made of a non-corrosive material.
  - b. Shall comply with ASHRAE Standard 62.
  - c. Shall use a 1" -11 1/2 NPT drain connection, through the side of the drain pan. Connection shall be made per manufacturer's recommendations.
7. Top panel:
  - a. Indoor section shall be a single piece top panel.
8. Electrical Connections
  - a. All unit power wiring shall enter unit cabinet at a single, factory-prepared, knockout location.
  - b. Thru-the-base capability
    - (1.) Standard unit shall have a thru-the-base electrical location(s) using a raised, embossed portion of the unit basepan.
    - (2.) No basepan penetration, other than those authorized by the manufacturer, is permitted.
9. Component access panels (standard)
  - a. Cabinet panels shall be easily removable for servicing.
  - b. Stainless steel metal hinges are standard on all doors.
  - c. Panels covering control box, indoor fan, indoor fan motor, and electric or gas heater components (where applicable), shall have 1/4 turn latches.

## 23 81 19.13.J. Coils

1. Standard Aluminum/Copper Coils: on all models.
  - a. Standard evaporator and condenser coils shall have aluminum lanced plate fins mechanically bonded to seamless internally grooved copper tubes with all joints brazed.
  - b. Evaporator and Condenser coils shall be leak tested to 150 psig, pressure tested to 550 psig, and qualified to UL 1995 burst test at 2,200 psig.

## 23 81 19.13.K. Refrigerant Components

1. Refrigerant circuit shall include the following control, safety, and maintenance features:
  - a. Thermal Expansion Valve (TXV) with venturi type distributor except the 072 model which shall use small orifice refrigerant control expansion device.
  - b. Refrigerant filter drier.
  - c. External service gauge connections to unit suction and discharge lines.

**2. Compressors**

- a. Unit shall use one fully hermetic, scroll compressor for each independent refrigeration circuit.
- b. Compressor motors shall be cooled by refrigerant gas passing through motor windings.
- d. Compressors shall be internally protected from high discharge temperature conditions.
- e. Compressors shall be protected from an over-temperature and over-ampereage conditions by an internal, motor overload device.
- f. Compressor shall be factory mounted on rubber grommets.
- g. Compressor motors shall have internal line break thermal, current overload and high pressure differential protection.
- h. Crankcase heaters shall not be required for normal operating range.

**23 81 19.13.L. Filter Section**

1. Filters access is specified in the unit cabinet section of this specification.
2. Filters shall be held in place by a sliding filter tray, facilitating easy removal and installation.
3. Shall consist of factory-installed, low velocity, throw-away 2-in. thick fiberglass filters.
4. Filters shall be standard, commercially available sizes.
5. Filter face velocity shall not exceed 365 fpm at nominal airflows.

**23 81 19.13.M. Evaporator Fan and Motor**

1. Evaporator fan motor:
  - a. Shall have permanently lubricated bearings.
  - b. Shall have inherent automatic-reset thermal overload protection or circuit breaker.
  - c. Shall have a maximum continuous bhp rating for continuous duty operation; no safety factors above that rating shall be required.
2. Belt-driven Evaporator Fan:
  - a. Belt drive shall include an adjustable-pitch motor pulley.
  - b. Shall use sealed, permanently lubricated ball-bearing type.
  - c. Blower fan shall be double-inlet type with forward-curved blades.
  - d. Shall be constructed from steel with a corrosion resistant finish and dynamically balanced.

**23 81 19.13.N. Condenser Fans and Motors**

1. Condenser fan motors:
  - a. Shall be a totally enclosed motor.
  - b. Shall use permanently lubricated bearings.
  - c. Shall have inherent thermal overload protection with an automatic reset feature.
  - d. Shall use a shaft-down design. Shaft-up designs including those with "rain-slinger devices" shall not be allowed.
2. Condenser Fans:
  - a. Shall be a direct-driven propeller type fan.
  - b. Shall have aluminum blades riveted to corrosion-resistant steel spiders and shall be dynamically balanced.

**23 81 19.13.O. Special Features, Options and Accessories**

1. Integrated Economizers:
  - a. Integrated, gear-driven parallel modulating blade design type capable of simultaneous economizer and compressor operation.
  - b. Independent modules for vertical or horizontal return configurations shall be available. Vertical return modules shall be available as a factory installed option.
  - c. Damper blades shall be galvanized steel with metal gears. Plastic or composite blades on intake or return shall not be acceptable.
  - d. Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below setpoints.
  - e. Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control.
  - f. Shall be capable of introducing up to 100% outdoor air.
  - g. Shall be equipped with a barometric relief damper capable of relieving up to 100% return air.
  - h. Shall be designed to close damper(s) during loss-of-power situations with spring return built into motor.
  - i. An outdoor single enthalpy sensor shall be provided as standard. Outdoor air sensor setpoint shall be adjustable and shall range from the enthalpy equivalent of 63°F @ 50% rh to 73°F @ 50% rh. Additional sensor options shall be available as accessories.
  - j. The economizer controller shall also provide control of an accessory power exhaust unit function. Factory set at 70%, with a range of 0% to 100%.
  - k. The economizer shall maintain minimum airflow into the building during occupied period and provide design ventilation rate for full occupancy. A remote potentiometer may be used to override the damper setpoint.
  - l. Dampers shall be completely closed when the unit is in the unoccupied mode.
  - m. Economizer controller shall accept a 2-10Vdc CO<sub>2</sub> sensor input for IAQ/DCV control. In this mode, dampers shall modulate the outdoor-air damper to provide ventilation based on the sensor input.



- n. Compressor lockout sensor on the unit controller is factory set at 35°F and is adjustable from 30°F (-1°C) to 50°F (10°C) and resets the cooling lockout at 5°F (+2.7°C) above the set point..
  - o. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
  - p. Economizer controller shall provide indications when in free cooling mode, in the DCV mode, or the exhaust fan contact is closed.
  - q. Economizer wire harness will have provision for smoke detector.
2. Two-Position Motorized Damper
- a. Damper shall be a Two-Position Motorized Damper. Damper travel shall be from the full closed position to the field adjustable %-open setpoint.
  - b. Damper shall include adjustable damper travel from 25% to 100% (full open).
  - c. Damper shall include single or dual blade, gear driven dampers and actuator motor.
  - d. Actuator shall be direct coupled to damper gear. No linkage arms or control rods shall be acceptable.
  - e. Damper will admit up to 100% outdoor air for applicable rooftop units.
  - f. Damper shall close upon indoor (evaporator) fan shutoff and/or loss of power.
  - g. The damper actuator shall plug into the rooftop unit's wiring harness plug. No hard wiring shall be required.
  - h. Outside air hood shall include aluminum water entrainment filter
3. Manual damper
- a. Manual damper package shall consist of damper, air inlet screen, and rain hood which can be preset to admit up to 50% outdoor air for year round ventilation.
4. Head Pressure Control Package
- a. Controller shall control coil head pressure by condenser-fan cycling.
5. Condenser Coil Hail Guard Assembly
- a. Shall protect against damage from hail.
  - b. Shall be louvered design.
6. Convenience Outlet:
- a. Non-Powered convenience outlet.
    - (1.) Outlet shall be powered from a separate 115-120v power source.
    - (2.) A transformer shall not be included.
    - (3.) Outlet shall be factory-installed and internally mounted with easily accessible 115-v female receptacle.
    - (4.) Outlet shall include 15 amp GFI receptacles.
    - (5.) Outlet shall be accessible from outside the unit.
7. Fan/Filter Status Switch:
- a. Switch shall provide status of indoor evaporator fan (ON/OFF) or filter (CLEAN/DIRTY).
  - b. Status shall be displayed either over communication bus (when used with direct digital controls) or through the controller LCD display inside the unit control box.
8. Propeller Power Exhaust:
- a. Power exhaust shall be used in conjunction with an integrated economizer.
  - b. Independent modules for vertical or horizontal return configurations shall be available.
  - c. Horizontal power exhaust is shall be mounted in return ductwork.
  - d. Power exhaust shall be controlled by economizer controller operation. Exhaust fans shall be energized when dampers open past the 0-100% adjustable setpoint on the economizer control.
9. Roof Curbs (Vertical):
- a. Full perimeter roof curb with exhaust capability providing separate air streams for energy recovery from the exhaust air without supply air contamination.
  - b. Formed galvanized steel with wood nailer strip and shall be capable of supporting entire unit weight.
  - c. Permits installation and securing of ductwork to curb prior to mounting unit on the curb.
10. High-Static Indoor Fan Motor(s) and Drive(s):
- a. High-static motor(s) and drive(s) shall be factory-installed to provide additional performance range.
11. Outdoor Air Enthalpy Sensor:
- a. The outdoor air enthalpy sensor shall be used to provide single enthalpy control. When used in conjunction with a return air enthalpy sensor, the unit will provide differential enthalpy control. The sensor allows the unit to determine if outside air is suitable for free cooling.
13. Return Air Enthalpy Sensor:
- a. The return air enthalpy sensor shall be used in conjunction with an outdoor air enthalpy sensor to provide differential enthalpy control.
14. Indoor Air Quality (CO<sub>2</sub>) Sensor:
- a. Shall be able to provide demand ventilation indoor air quality (IAQ) control.
  - b. The IAQ sensor shall be available in wall mount with LED display. The setpoint shall have adjustment capability.




## 15. Smoke detectors:

- a. Shall be a Four-Wire Controller and Detector.
- b. Shall be environmental compensated with differential sensing for reliable, stable, and drift-free sensitivity.
- c. Shall use magnet-activated test/reset sensor switches.
- d. Shall have a recessed momentary switch for testing and resetting the detector.
- e. Controller shall include:
  - (1.) One set of normally open alarm initiation contacts for connection to an initiating device circuit on a fire alarm control panel.
  - (2.) Two Form-C auxiliary alarm relays for interface with rooftop unit or other equipment.
  - (3.) One Form-C supervision (trouble) relay to control the operation of the Trouble LED on a remote test/reset station.
  - (4.) Capable of direct connection to two individual detector modules.
  - (5.) Can be wired to up to 14 other duct smoke detectors for multiple fan shutdown applications.

## 16. Electric Heat:

- a. Heating Section
  - (1.) Heater element open coil resistance wire, nickel-chrome alloy, strung through ceramic insulators mounted on metal frame. Coil ends are staked and welded to terminal screw slots.
  - (2.) Heater assemblies are provided with integral fusing for protection of internal heater circuits not exceeding 48 amps each. Auto reset thermo limit controls, magnetic heater contactors (24 v coil) and terminal block all mounted in electric heater control box (minimum 18 ga galvanized steel) attached to end of heater assembly.

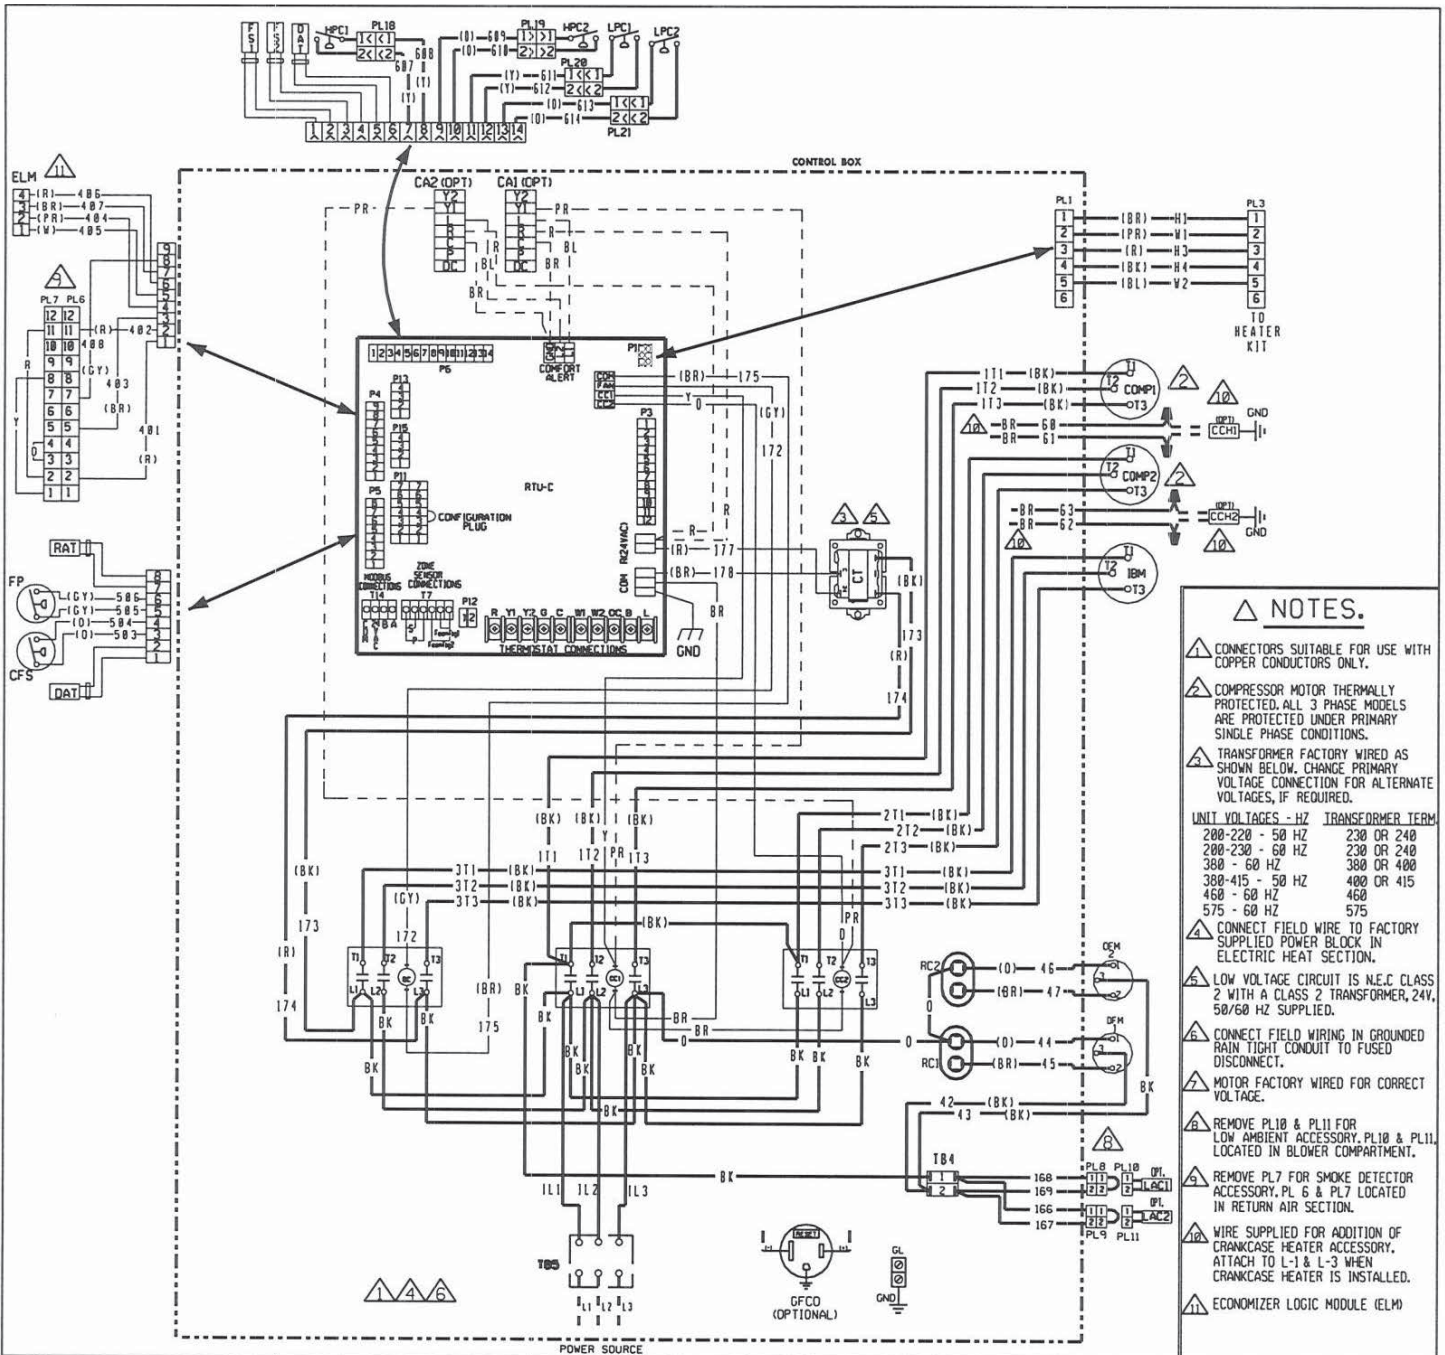


- NOTES.**
- △ CONNECTORS SUITABLE FOR USE WITH COPPER CONDUCTORS ONLY.
  - △ COMPRESSOR MOTOR THERMALLY PROTECTED. ALL 3 PHASE MODELS ARE PROTECTED UNDER PRIMARY SINGLE PHASE CONDITIONS.
  - △ TRANSFORMER FACTORY WIRING AS SHOWN BELOW. CHANGE PRIMARY VOLTAGE CONNECTION FOR ALTERNATE VOLTAGES, IF REQUIRED.
- | UNIT VOLTAGES - HZ | TRANSFORMER TERM |
|--------------------|------------------|
| 200-220 - 50 HZ    | 230 OR 240       |
| 200-230 - 60 HZ    | 230 OR 240       |
| 380 - 60 HZ        | 380 OR 400       |
| 380-415 - 50 HZ    | 400 OR 415       |
| 460 - 60 HZ        | 460              |
| 575 - 60 HZ        | 575              |
- △ CONNECT FIELD WIRE TO FACTORY SUPPLIED POWER BLOCK IN ELECTRIC HEAT SECTION.
  - △ LOW VOLTAGE CIRCUIT IS N.E.C. CLASS 2 WITH A CLASS 2 TRANSFORMER, 24V, 50/60 HZ SUPPLIED.
  - △ CONNECT FIELD WIRING IN GROUNDED RAIN TIGHT CONDUIT TO FUSED DISCONNECT.
  - △ MOTOR FACTORY WIRING FOR CORRECT VOLTAGE.
  - △ REMOVE PL10 & PL11 FOR LOW AMBIENT ACCESSORY. PL10 & PL11 LOCATED IN BLOWER COMPARTMENT.
  - △ REMOVE PL7 FOR SMOKE DETECTOR ACCESSORY. PL 6 & PL7 LOCATED IN RETURN AIR SECTION.
  - △ WIRE SUPPLIED FOR ADDITION OF CRANKCASE HEATER ACCESSORY. ATTACH TO L-1 & L-3 WHEN CRANKCASE HEATER IS INSTALLED.
  - △ ECONOMIZER LOGIC MODULE (ELM)

COMPONENT CODE		WIRING INFORMATION		WIRE COLOR CODE	
BC	BLOWER CONTACTOR	LINE VOLTAGE	_____	BK	BLACK
CA	COMFORT ALERT MODULE	-FACTORY STANDARD	_____	BR	BROWN
CC	COMPRESSOR CONTACTOR	-FACTORY OPTION	-----	BL	BLUE
CCH	CRANKCASE HEATER	-FIELD INSTALLED	-----	G	GREEN
CFS	CLOGGED FILTER SWITCH	LOW VOLTAGE	_____	GY	GRAY
COMP	COMPRESSOR	-FACTORY STANDARD	_____	O	ORANGE
CT	CONTROL TRANSFORMER	-FACTORY OPTION	-----	PR	PURPLE
DAT	DISCHARGE AIR SENSOR	-FIELD INSTALLED	-----	R	RED
DISC	DISCONNECT SWITCH	REPLACEMENT WIRE	_____	W	WHITE
FP	FAN PROVING	-MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (105° C MIN.)	_____	Y	YELLOW
FS	FREEZE SENSOR	WARNING	_____		
GFCO	GROUND FAULT CONVENIENCE OUTLET	-CABINET MUST BE PERMANENTLY GROUNDED AND CONFORM TO I.E.C., N.E.C., C.E.C., AND LOCAL CODES AS APPLICABLE.	_____		
GL	GROUND LUG		_____		
GND	GROUND		_____		
HPC	HIGH PRESSURE CONTROL		_____		
IBM	INDOOR BLOWER MOTOR BELT DRIVE		_____		
LAC	LOW AMBIENT COOLING CONTROL		_____		
LPC	LOW PRESSURE CONTROL		_____		
OAT	OUTSIDE AIR SENSOR		_____		
OFM	OUTDOOR FAN MOTOR		_____		
PL	PLUG		_____		
RAT	RETURN AIR SENSOR		_____		
RC	RUN CAPACITOR		_____		
RTU-C	ROOFTOP UNIT CONTROL		_____		
TS	TERMINAL BLOCK		_____		
W	WIRE NUT		_____		

DWG. NO. 90-103089-03 REV 02

DR. BY MGR APP. BY DATE 4-15-09 DWG. NO. 90-103089-03 REV 03

**WIRING DIAGRAM**  
(-)L?L-C090/102/120/150/151  
208-230/460/575V 3 PH, 60 HZ.  
PACKAGED A/C W/RTU-C

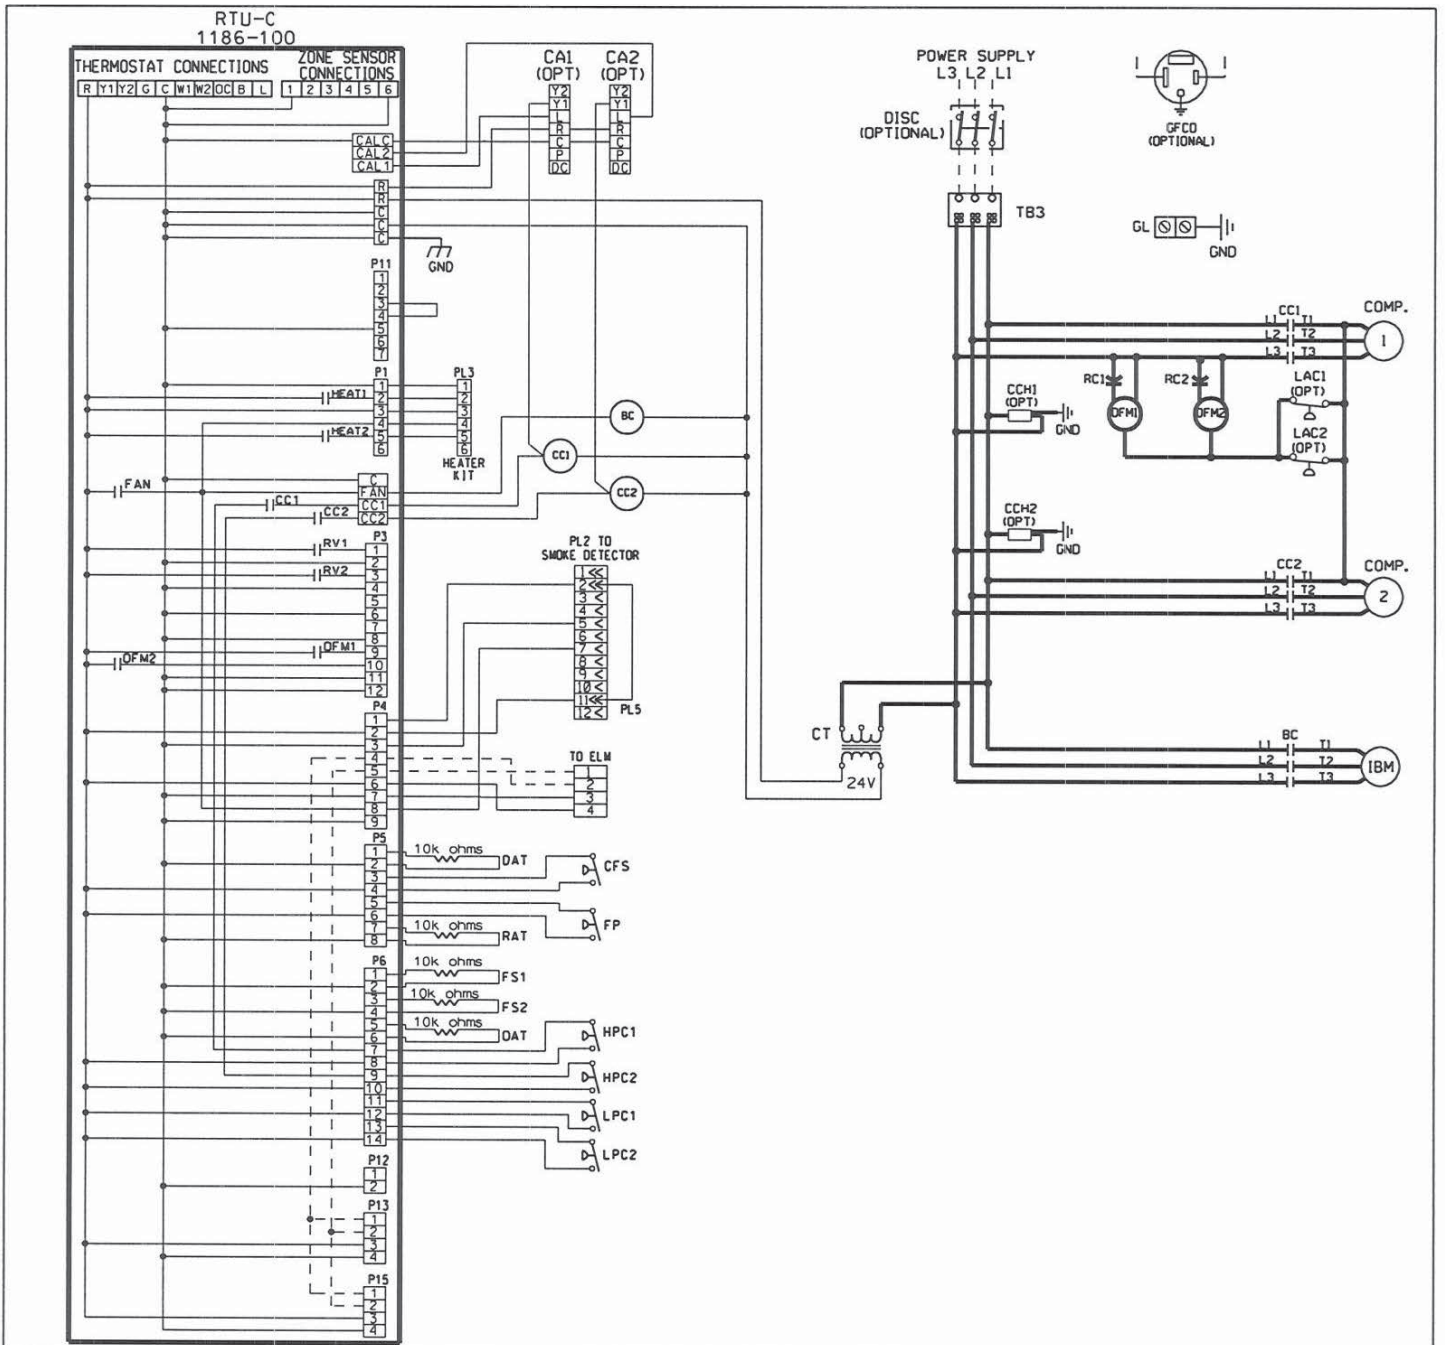

**COMPONENT CODE**

BC	BLOWER CONTACTOR	IFC	INTEGRATED FURNACE CONTROL
CA	COMFORT ALERT MODULE	LAC	LOW AMBIENT COOLING CONTROL
CC	COMPRESSOR CONTACTOR	LC	LIMIT CONTROL
CCH	CRANKCASE HEATER	LPC	LOW PRESSURE CONTROL
CFS	CLOGGED FILTER SWITCH	MAS	MIX AIR SENSOR
COMP	COMPRESSOR	OAT	OUTSIDE AIR SENSOR
CT	CONTROL TRANSFORMER	OFM	OUTDOOR FAN MOTOR
DJSC	DISCONNECT SWITCH	PL	PLUG
FP	FAN PROVING	RAT	RETURN AIR SENSOR
FS	FREEZE SENSOR	RC	RUN CAPACITOR
GFCO	GROUND FAULT CONVENIENCE OUTLET	SCC	SPACE COMFORT CONTROL
GL	GROUND LUG	SE	SPARK ELECTRODE
GND	GROUND	TB	TERMINAL BLOCK
HPC	HIGH PRESSURE CONTROL	▲	WIRE NUT
IBM	INDOOR BLOWER MOTOR BELT DRIVE		

**WIRING INFORMATION**

LINE VOLTAGE  
 -FACTORY STANDARD —————  
 -FACTORY OPTION - - - - -  
 -FIELD INSTALLED - - - - -

LOW VOLTAGE  
 -FACTORY STANDARD —————  
 -FACTORY OPTION - - - - -  
 -FIELD INSTALLED - - - - -

REPLACEMENT WIRE  
 -MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (105° C MIN.)

WARNING  
 -CABINET MUST BE PERMANENTLY GROUNDED AND CONFORM TO I.E.C., N.E.C., C.E.C., AND LOCAL CODES AS APPLICABLE.

**WIRE COLOR CODE**


BK	BLACK	O	ORANGE
BR	BROWN	PR	PURPLE
BL	BLUE	R	RED
G	GREEN	W	WHITE
GY	GRAY	Y	YELLOW

**WIRING SCHEMATIC**  
 (-)L?L-C090/102/120/150/151  
 208-230/460/575V 3 PH, 60 HZ.  
 PACKAGED A/C

DR. BY	APPR. BY	DATE	DWG. NO.	REV
MGR		7-16-09	90-103246-03	01





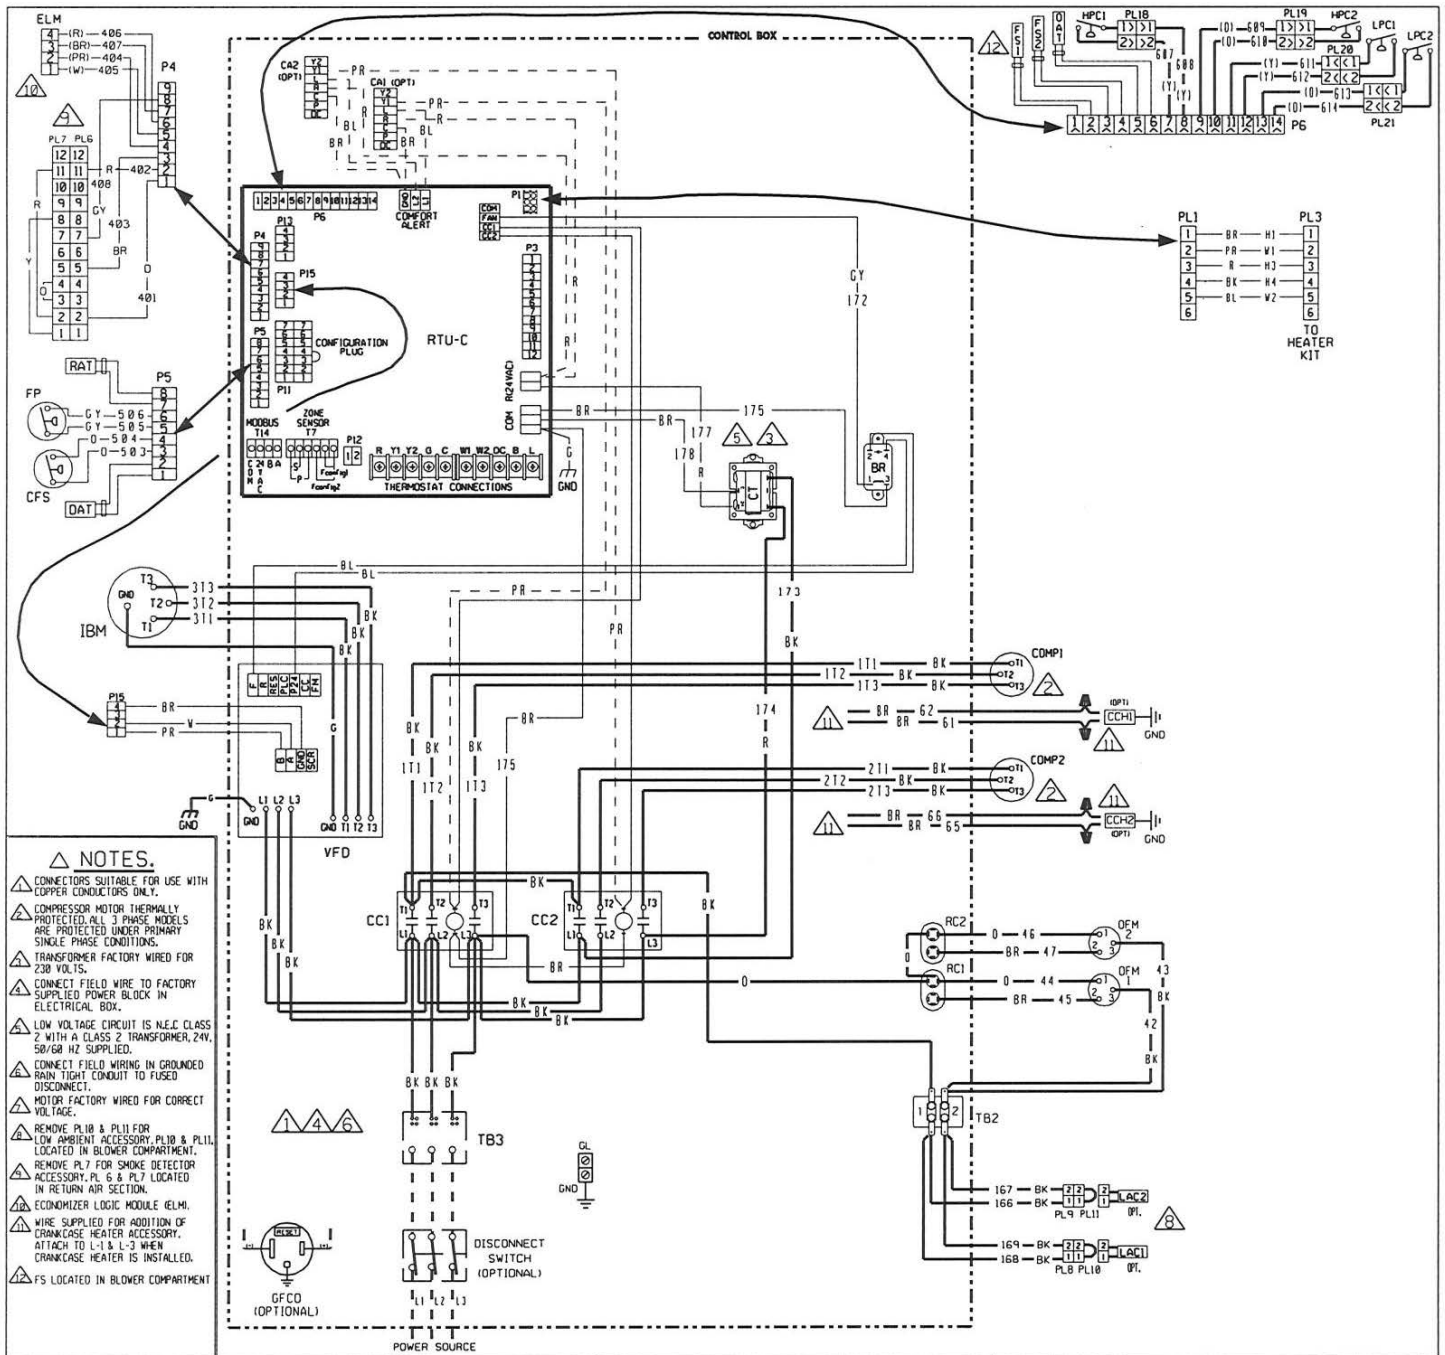

- NOTES.**
- △ CONNECTORS SUITABLE FOR USE WITH COPPER CONDUCTORS ONLY.
  - △ COMPRESSOR MOTOR THERMALLY PROTECTED. ALL 3 PHASE MODELS ARE PROTECTED UNDER PRIMARY SINGLE PHASE CONDITIONS.
  - △ TRANSFORMER FACTORY WIRING FOR 230 VOLTS.
  - △ CONNECT FIELD WIRE TO FACTORY SUPPLIED POWER BLOCK IN ELECTRICAL BOX.
  - △ LOW VOLTAGE CIRCUIT IS N.E.C. CLASS 2 WITH A CLASS 2 TRANSFORMER, 24V, 50/60 HZ SUPPLIED.
  - △ CONNECT FIELD WIRING IN GROUNDED RAIN TIGHT CONDUIT TO FUSED DISCONNECT.
  - △ MOTOR FACTORY WIRING FOR CORRECT VOLTAGE.
  - △ REMOVE PL10 & PL11 FOR LOW AMBIENT ACCESSORY. PL10 & PL11 LOCATED IN BLOWER COMPARTMENT.
  - △ REMOVE PL7 FOR SMOKE DETECTOR ACCESSORY. PL6 & PL7 LOCATED IN RETURN AIR SECTION.
  - △ ECONOMIZER LOGIC MODULE (ELM).
  - △ WIRE SUPPLIED FOR ADDITION OF CRANKCASE HEATER ACCESSORY.
  - △ ATTACH TO L-1 & L-3 WHEN CRANKCASE HEATER IS INSTALLED.
  - △ FS LOCATED IN BLOWER COMPARTMENT

**COMPONENT CODE**

BR	BLOWER RELAY	HPC	HIGH PRESSURE CONTROL
CA	COMFORT ALERT MODULE	IBM	INDOOR BLOWER MOTOR BELT DRIVE
CC	COMPRESSOR CONTACTOR	LAC	LOW AMBIENT COOLING CONTROL
CCH	CRANKCASE HEATER	LC	LIMIT CONTROL
CFS	CLOGGED FILTER SWITCH	LPC	LOW PRESSURE CONTROL
COMP	COMPRESSOR	DAT	OUTSIDE AIR SENSOR
CT	CONTROL TRANSFORMER	OPM	OUTDOOR FAN MOTOR
DAT	DISCHARGE AIR SENSOR	PL	PLUG
DISC	DISCONNECT SWITCH	RAT	RETURN AIR SENSOR
FP	FAN PROVING	RC	RUN CAPACITOR
FS	FREEZE SENSOR	RTU-C	ROOFTOP UNIT CONTROL
GFCD	GROUND FAULT CONVENIENCE OUTLET	TB	TERMINAL BLOCK
GL	GROUND LUG	VFD	VARIABLE FREQUENCY DRIVE
GND	GROUND		WIRE NUT

**WIRING INFORMATION**

LINE VOLTAGE  
 -FACTORY STANDARD  
 -FACTORY OPTION  
 -FIELD INSTALLED

LOW VOLTAGE  
 -FACTORY STANDARD  
 -FACTORY OPTION  
 -FIELD INSTALLED

REPLACEMENT WIRE  
 -MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (105°C MIN.)

WARNING  
 -CABINET MUST BE PERMANENTLY GROUNDED AND CONFORM TO I.E.C., N.E.C., C.E.C., AND LOCAL CODES AS APPLICABLE.



**WIRE COLOR CODE**

BK	BLACK	O	ORANGE
BR	BROWN	PR	PURPLE
BL	BLUE	R	RED
G	GREEN	W	WHITE
GY	GRAY	Y	YELLOW

**WIRING DIAGRAM**  
 090/102/120/151 W/VFD  
 208-230/460V 3 PH, 60 HZ.  
 PACKAGED A/C W/RTU-C

DR. BY	APP. BY	DATE	DWG. NO.	REV
JRJ	KST	01-12-12	90-103089-32	00

RTU-C 1186-100

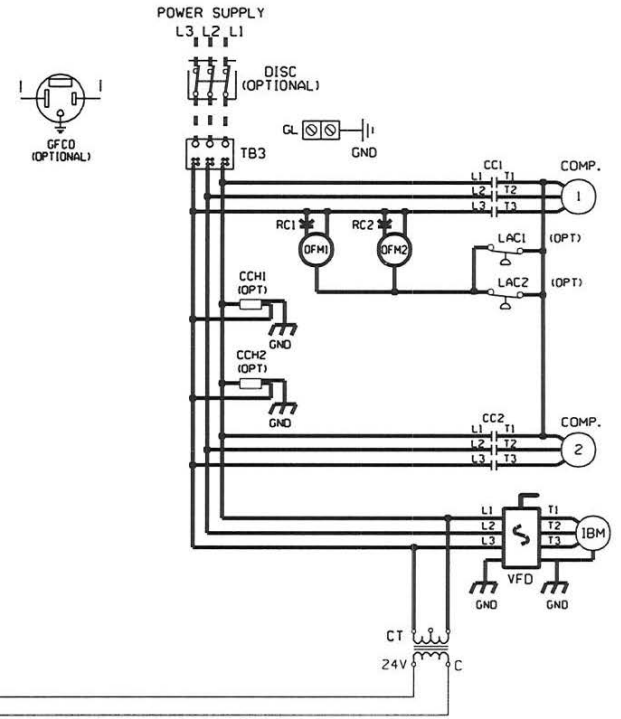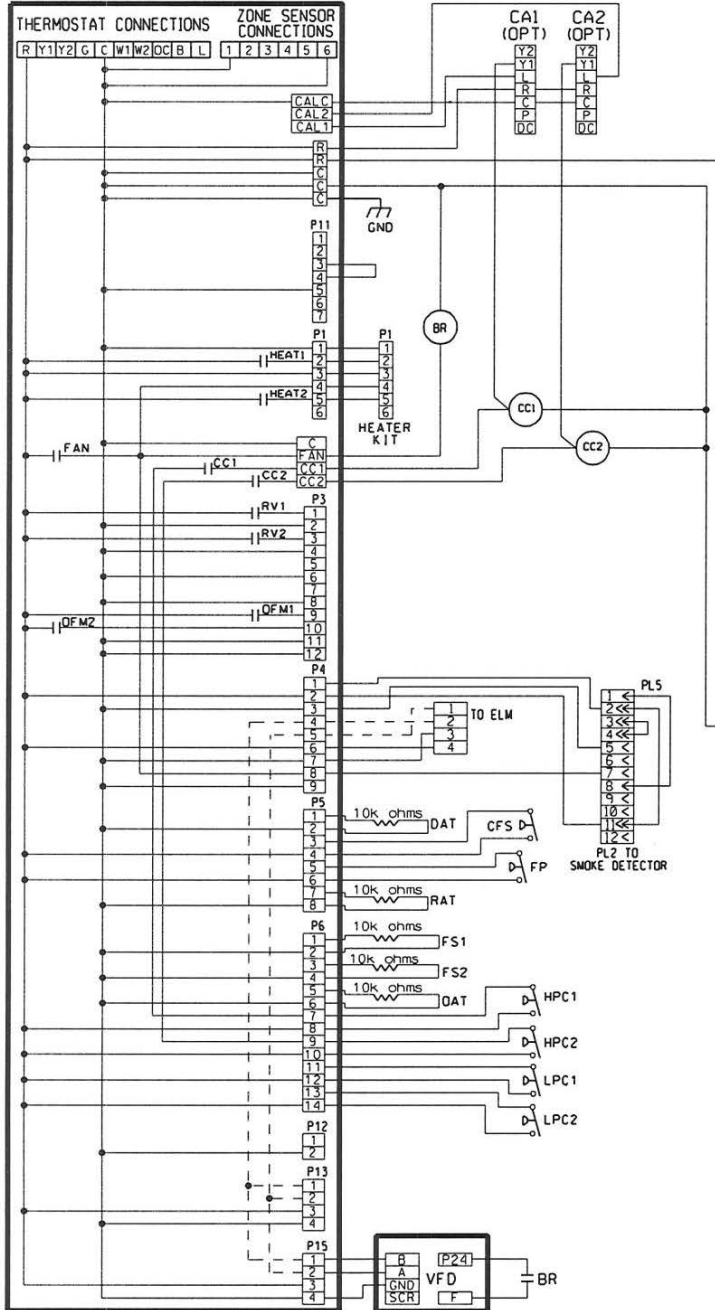

COMPONENT CODE

BR	BLOWER RELAY	HPC	HIGH PRESSURE CONTROL
CA	COMFORT ALERT MODULE	IBM	INDOOR BLOWER MOTOR BELT DRIVE
CC	COMPRESSOR CONTACTOR	LAC	LOW AMBIENT COOLING CONTROL
CCH	CRANKCASE HEATER	LC	LIMIT CONTROL
CFS	CLOGGED FILTER SWITCH	LPC	LOW PRESSURE CONTROL
COMP	COMPRESSOR	OAT	OUTSIDE AIR SENSOR
CT	CONTROL TRANSFORMER	OFM	OUTDOOR FAN MOTOR
DAT	DISCHARGE AIR SENSOR	PL	PLUG
DISC	DISCONNECT SWITCH	RAT	RETURN AIR SENSOR
FP	FAN PROVING	RC	RUN CAPACITOR
FS	FREEZE SENSOR	RTU-C	ROOFTOP UNIT CONTROL
GFCD	GROUND FAULT CONVENIENCE OUTLET	TB	TERMINAL BLOCK
GL	GROUND LUG	VFD	VARIABLE FREQUENCY DRIVE
GND	GROUND	▲	WIRE NUT

WIRING INFORMATION

LINE VOLTAGE  
 -FACTORY STANDARD —————  
 -FACTORY OPTION - - - - -  
 -FIELD INSTALLED - - - - -

LOW VOLTAGE  
 -FACTORY STANDARD —————  
 -FACTORY OPTION - - - - -  
 -FIELD INSTALLED - - - - -

REPLACEMENT WIRE  
 -MUST BE THE SAME SIZE AND TYPE OF INSULATION AS ORIGINAL (105° C MIN.)

WARNING  
 -CABINET MUST BE PERMANENTLY GROUNDED AND CONFORM TO I.E.C., N.E.C., C.E.C., AND LOCAL CODES AS APPLICABLE.

WIRE COLOR CODE

BK	BLACK	O	ORANGE
BR	BROWN	PR	PURPLE
BL	BLUE	R	RED
G	GREEN	W	WHITE
GY	GRAY	Y	YELLOW

WIRING SCHEMATIC  
 090/102/120/151 W/VFD  
 208-230/460V 3 PH. 60 HZ.  
 PACKAGED A/C

DR. BY	APP. BY	DATE	DWG. NO.	REV
JRJ	KST	01-12-12	90-103246-28	01



**BEFORE PURCHASING THIS APPLIANCE, READ IMPORTANT ENERGY COST AND EFFICIENCY INFORMATION AVAILABLE FROM YOUR RETAILER.**

### **GENERAL TERMS OF LIMITED WARRANTY\***

Rheem will furnish a replacement for any part of this product which fails in normal use and service within the applicable periods stated, in accordance with the terms of the limited warranty.

**\*For complete details of the Limited and Conditional Warranties, including applicable terms and conditions, contact your local contractor or the Manufacturer for a copy of the product warranty certificate.**

**Compressor**

3 Phase, Commercial Applications.....Five (5) Years

**Parts**

3 Phase, Commercial Applications.....One (1) Year



The new degree of comfort.™

*In keeping with its policy of continuous progress and product improvement, Rheem reserves the right to make changes without notice.*

Rheem Heating, Cooling & Water Heating • P.O. Box 17010  
Fort Smith, Arkansas 72917 • [www.rheem.com](http://www.rheem.com)

Rheem Canada Ltd./Ltée • 125 Edgeware Road, Unit 1  
Brampton, Ontario • L6Y 0P5



INTEGRATED AIR & WATER

PRINTED IN U.S.A 10/12 QG FORM NO. S11-961 REV. 1